

VICINITY MAP
1" = 5000'

STRATFORD WATER TOWER
1740 STRATFORD RD
LAWRENCE, KS 66044

LAWRENCE, KANSAS

UTILITIES DEPARTMENT

PROJECT NO. UT1984

CITY BID NO. B2120

STRATFORD WATER TOWER REPLACEMENT

PROJECT CONTACT INFORMATION

CITY OF LAWRENCE, KANSAS
PO BOX 708, LAWRENCE, KS 66044
785-832-7843
LEAH MORRIS
LEMORRIS@LAWRENCEKS.ORG

CONSULTING ENGINEER INFORMATION

BLACK & VEATCH
8400 WARD PARKWAY, KANSAS CITY, MO 64114
STEVE NAGRICH
913-458-9808
NAGRICHSN@BV.COM



LAWRENCE, KANSAS
PROJECT NO. 402979
2021

LIST OF UTILITIES

1-800-344-7233	DIG SAFE (ONE CALL)	DAVID CRONIN	dcronin@lawrenceks.org
1-785-832-3130	CITY OF LAWRENCE PUBLIC WORKS ENGINEERING	DAVID WOOSLEY	dwoosley@lawrenceks.org
1-785-832-3034	CITY OF LAWRENCE TRAFFIC ENGINEERING	LEAH MORRIS	lemorris@lawrenceks.org
1-785-832-7880	CITY OF LAWRENCE MUNICIPAL SERVICES	MATT BOND	mbond@lawrenceks.org
1-785-832-3142	CITY OF LAWRENCE STORMWATER ENGINEER	JACOB BARNES	jbarnes@lawrenceks.org
1-785-832-3190	CITY OF LAWRENCE RIGHT-OF-WAY MANAGER	CLIFFORD REUSCH	creusch@rwd4.com
1-785-594-3847	DOUGLAS COUNTY RURAL WATER DISTRICT #4	BILL WINEGAR	bwinegar@baldwincity.org
1-785-594-6907	BALDWIN CITY PUBLIC WORKS (WATER)	KEITH BROWNING	browning@douglas-county.com
1-785-832-5293	DOUGLAS COUNTY PUBLIC WORKS	CHUCK HOAG	chuck.hoag@blackhillscorp.com
1-785-832-3944	BLACK HILLS ENERGY (GAS)	BOONE HESTON	boone.heston@evergy.com
1-785-865-4862	EVERGY (ELECTRIC)	KEITH GATZEMEYER	kg4306@att.com
1-785-276-5377	AT&T (TELEPHONE)	HARV WAYMIRE	James.Waymire@wideopenwest.com
1-785-312-6922	WOW (CABLE TV)		

THESE PLANS HAVE BEEN PREPARED IN ACCORDANCE WITH THE CITY OF LAWRENCE'S DESIGN GUIDELINES, CITY CODE, STREET, STORM WATER, WATERLINE, AND SANITARY SEWER STANDARDS. THE CITY AND UTILITY ENGINEER'S REVIEW IS ONLY FOR GENERAL CONFORMANCE WITH THESE STANDARDS. THE CITY DID NOT VERIFY AND IS NOT RESPONSIBLE FOR THE ACCURACY AND ADEQUACY OF THE DESIGN, DIMENSIONS, ELEVATION, AND QUANTITIES. THE CITY OF LAWRENCE SHALL BE HELD HARMLESS FOR ERRORS AND OMISSIONS AS STATED HEREIN. THE CITY OF LAWRENCE THROUGH THE APPROVAL OF THIS DOCUMENT ASSUMES NO RESPONSIBILITY OTHER THAN STATED ABOVE FOR THE COMPLETENESS AND/OR ACCURACY OF THIS DOCUMENT. THESE PLANS ARE ACCEPTED FOR ONE YEAR FROM THE DATE OF APPROVAL, AFTER WHICH THEY BECOME VOID AND MUST BE UPDATED AND RE-APPROVED BY THE CITY BEFORE ANY CONSTRUCTION WILL BE PERMITTED, UNLESS CONSTRUCTION HAS BEEN COMPLETED AND APPROVED. RELEASED FOR CONSTRUCTION:

SANITARY SEWER EXTENSION APPROVAL:

KDHE _____ DATE _____

RELEASED FOR CONSTRUCTION:

MUNICIPAL SERVICES AND OPERATIONS _____ DATE _____

INDEX OF DRAWINGS

SHT	DWG #	DRAWING TITLE
GENERAL		
0	G-00-001	COVER SHEET, VICINITY MAP & SHEET LIST
1	G-00-002	CIVIL - LEGENDS, ABBREVIATIONS & GENERAL NOTES
2	G-00-003	STRUCTURAL - STANDARD NOTES
3	G-00-004	STRUCTURAL - ABBREVIATIONS AND LEGEND
4	G-00-005	PLUMBING - LEGENDS, ABBREVIATIONS & GENERAL NOTES
5	G-00-006	HVAC - LEGENDS, ABBREVIATIONS & GENERAL NOTES
6	G-00-007	PROCESS MECHANICAL - LEGENDS, ABBREVIATIONS & GENERAL NOTES
7	G-00-008	ELECTRICAL - LEGENDS
8	G-00-009	ELECTRICAL - ABBREVIATIONS & NOTES
9	G-00-010	INSTRUMENTATION - LEGENDS & ABBREVIATIONS
CIVIL		
10	C-10-100	CIVIL - OVERALL SITE PLAN
11	C-10-101	CIVIL - SANITARY SEWER PLAN
12	C-10-102	CIVIL - SANITARY SEWER PROFILES
13	C-10-103	CIVIL - EROSION CONTROL PLAN
14	C-10-104	CIVIL - TANK ELEVATION, INTERIOR SECTION AND ROOF PLAN
15	C-10-105	CIVIL/STRUCTURAL - ENLARGED TANK PLAN
16	C-10-301	CIVIL/STRUCTURAL - TANK SECTIONS & DETAILS
17	C-10-501	CIVIL - SITEWORK DETAILS
18	C-10-502	CIVIL - DETAILS
STRUCTURAL		
19	S-10-101	STRUCTURAL - ENLARGED TANK PLANS
20	S-10-301	STRUCTURAL - SECTIONS
21	S-10-501	STRUCTURAL - DETAILS
22	S-10-502	STRUCTURAL - STANDARD CONCRETE REINFORCEMENT DETAILS
23	S-10-503	STRUCTURAL - STANDARD CONCRETE JOINT DETAILS
24	S-10-504	STRUCTURAL - STANDARD CONCRETE MASONRY REINFORCEMENT DETAILS
25	S-10-505	STRUCTURAL - STANDARD CONCRETE MASONRY LINTEL AND JAMB REINFORCEMENT DETAILS
26	S-10-506	STRUCTURAL - STANDARD LADDER DETAILS
27	S-10-507	STRUCTURAL - STEEL DECKING SCHEDULE, FASTENER DETAILS, AND EMBED PLATE SCHEDULE
28	S-10-508	STRUCTURAL - STANDARD 3 RAIL - IBC GUARDRAIL
ELECTRICAL		
29	E-10-101	ELECTRICAL - SITE PLAN
30	E-10-102	ELECTRICAL - POWER AND LIGHTING PLANS, SECTIONS, DETAILS AND SCHEDULE
31	E-10-501	ELECTRICAL - DETAILS
32	E-10-701	ELECTRICAL - SCHEMATICS AND ONE-LINE DIAGRAMS
INSTRUMENTATION		
33	I-10-501	INSTRUMENTATION - SYSTEM INSTALLATION DETAILS
34	I-10-601	INSTRUMENTATION - P&ID WATER TOWER
35	I-10-602	INSTRUMENTATION - CONTROL BLOCK DIAGRAM
CITY OF LAWRENCE STANDARD DETAILS		
36	0010-1	EROSION AND SEDIMENT CONTROL
37	0010-2	EROSION AND SEDIMENT CONTROL
38	1500	CONCRETE COMMERCIAL DRIVEWAYS
39	1500-1	CONCRETE SIDEWALK AND SHARED USE PATH LAYOUTS
40	1500-2	CONCRETE SIDEWALK ACCESS RAMPS
41	1501	CONCRETE SIDEWALK AND SHARED USE PATH REPAIR
42	1506	CONCRETE CURB AND GUTTER
43	1800	STREET REPAIR
44	2500-1	SANITARY SEWER - GRAVITY
45	2500-2	SANITARY SEWER - GRAVITY
46	2900-1	WATERLINE
47	2900-2	WATERLINE
48	6000-1	STORM SEWER CURB INLETS
49	6000-2	STORM SEWER JUNCTION BOXES

	I HEREBY CERTIFY THAT THE FOLLOWING DOCUMENTS WERE PREPARED BY ME OR UNDER MY DIRECT PERSONAL SUPERVISION AND THAT I AM A DULY LICENSED PROFESSIONAL ENGINEER UNDER THE LAWS OF THE STATE OF KANSAS.	
		12/16/2021
	ANDREW J. HANSEN	(DATE)
	MY LICENSE NUMBER IS:	13933
	MY LICENSE EXPIRATION DATE IS:	APRIL 30TH, 2022
	MY SUBJECT MATTER IS:	CIVIL
	SHEETS COVERED BY THIS SEAL: G-00-001, G-00-002, G-00-007, C-10-100, C-10-101, C-10-102, C-10-103 C-10-104, C-10-105, C-10-301, C-10-501, C-10-502	

	I HEREBY CERTIFY THAT THE FOLLOWING DOCUMENTS WERE PREPARED BY ME OR UNDER MY DIRECT PERSONAL SUPERVISION AND THAT I AM A DULY LICENSED PROFESSIONAL ENGINEER UNDER THE LAWS OF THE STATE OF KANSAS.	
		12/16/2021
	JOSHUA L. TEDDER	(DATE)
	MY LICENSE NUMBER IS:	23787
	MY LICENSE EXPIRATION DATE IS:	APRIL 30TH, 2023
	MY SUBJECT MATTER IS:	STRUCTURAL
	SHEETS COVERED BY THIS SEAL: G-00-003, G-00-004, S10-101, S10-301, S10-501, S10-502 S10-503, S10-504, S10-505, S10-506, S10-507, S10-508	

	I HEREBY CERTIFY THAT THE FOLLOWING DOCUMENTS WERE PREPARED BY ME OR UNDER MY DIRECT PERSONAL SUPERVISION AND THAT I AM A DULY LICENSED PROFESSIONAL ENGINEER UNDER THE LAWS OF THE STATE OF KANSAS.	
		12/16/2021
	ETHAN JOSHUA BOGNER	(DATE)
	MY LICENSE NUMBER IS:	25367
	MY LICENSE EXPIRATION DATE IS:	APRIL 30TH, 2022
	MY SUBJECT MATTER IS:	ELECTRICAL
	SHEETS COVERED BY THIS SEAL: G-00-008, G-00-009, E-10-101, E-10-102, E-10-501, E-10-701	

	I HEREBY CERTIFY THAT THE FOLLOWING DOCUMENTS WERE PREPARED BY ME OR UNDER MY DIRECT PERSONAL SUPERVISION AND THAT I AM A DULY LICENSED PROFESSIONAL ENGINEER UNDER THE LAWS OF THE STATE OF KANSAS.	
		12/16/2021
	DAVID W. NELSON	(DATE)
	MY LICENSE NUMBER IS:	11286
	MY LICENSE EXPIRATION DATE IS:	APRIL 30TH, 2023
	MY SUBJECT MATTER IS:	MECHANICAL
	SHEETS COVERED BY THIS SEAL: G-00-005, G-00-006, C10-105, C10-502	

	I HEREBY CERTIFY THAT THE FOLLOWING DOCUMENTS WERE PREPARED BY ME OR UNDER MY DIRECT PERSONAL SUPERVISION AND THAT I AM A DULY LICENSED PROFESSIONAL ENGINEER UNDER THE LAWS OF THE STATE OF KANSAS.	
		12/16/2021
	HENRY A. BROWN	(DATE)
	MY LICENSE NUMBER IS:	26350
	MY LICENSE EXPIRATION DATE IS:	APRIL 30TH, 2022
	MY SUBJECT MATTER IS:	INSTRUMENTATION & CONTROLS
	SHEETS COVERED BY THIS SEAL: G-00-010, I-10-501, I-10-601, I-10-602	

FP09030A
D:\0000
PLOTTED: 12/13/2021 2:18 PM FILE: C:\pw_working\bwv_america\ssd0905479\G-00-002.dwg

	SURFACED STREET, ROAD OR DRIVE
	SURFACED STREET, ROAD OR DRIVE WITH CURBS
	NON-SURFACED STREET, ROAD OR DRIVE
	CONCRETE WALK
	CATCH BASIN
	MANHOLE
	DRAINAGE COURSE OR FLOW LINE
	STORMWATER DRAINAGE FLOW DIRECTION
	EXISTING GROUND CONTOUR
	FINISH GRADE CONTOUR
	BANK OR SLOPE LINES
	SOIL BORING
	CONCRETE ENCASEMENT-PLAN
	CONCRETE REACTION BLOCKING AT BEND, PLUG OR TEE
	DRAINS OR CULVERTS
	TUNNEL CASING - PLAN
	EXISTING
	EXISTING
	NEW
	NEW
	NEW WATER LINE OR SEWER IN PROFILE
	NON-CONNECTING PIPING
	CONSTRUCTION EASEMENT LINE
	EASEMENT LINE
	RIGHT-OF-WAY LINE
	PROPERTY LINE
	PERMANENT EASEMENT LINE
	TEMPORARY EASEMENT LINE
	UTILITY EASEMENT LINE
	SURVEY LINE SECTION LINE
	BUILDING SETBACK LINE
	WATER LINE
	GAS LINE
	SANITARY SEWER
	STORM SEWER
	UNDERGROUND TELEPHONE LINE
	OVERHEAD ELECTRIC LINE
	OVERHEAD CABLE TV LINE
	FIBER OPTIC LINE
	UNDERGROUND ELECTRIC LINE
	CHAINLINK FENCE LINE
	FENCE LINE
	AC UNIT
	GUY ANCHOR
	TREE STUMP
	SIGN
	POST
	UTILITY POST
	WATER METER
	WATER VALVE
	HANDHOLE
	BENCH MARK
	LIGHT POLE
	STOP SIGN
	BLDG = BUILDING
	M = MEASURED
	R = RECORD


FILL PATTERNS

	STONE		BATT INSULATION
	EARTH		SAND
	GRANULAR FILL		RIPRAP
	CONCRETE		BRICK
	STEEL		CMU
	ALUMINUM		DEMOLITION
	BEDROCK		FACE BLOCK
	CHECKERED PLATE		SOLID FILL
	RIGID INSULATION		ENGINEERED FILL
			GRATE

GENERAL NOTES:

- THIS IS A GENERAL LEGEND SHEET. SOME SYMBOLS MAY NOT BE USED ON THIS SPECIFIC PROJECT OR MAY BE NOTED AS OTHERWISE. SEE ADDITIONAL DISCIPLINE LEGENDS FOR MORE SYMBOLS.
- SEE ADDITIONAL NOTES THROUGHOUT DRAWING SET.

DRAWING NUMBERING SYSTEM

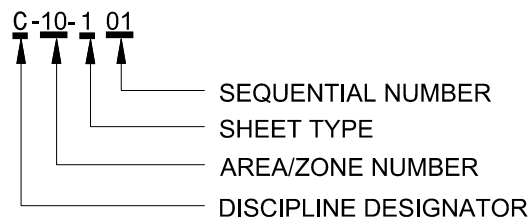

AREA/ZONE NUMBER

00	GENERAL
10	TANK AREA

DISCIPLINE DESIGNATORS

G	GENERAL
C	CIVIL
L	LANDSCAPE
S	STRUCTURAL
A	ARCHITECTURAL
MP	PLUMBING
P	PROCESS
MH	BUILDING MECHANICAL/HVAC
E	ELECTRICAL
I	INSTRUMENTATION AND CONTROLS
D	DEMOLITION
MP/H	MECHANICAL/PLUMBING

SHEET TYPE DESIGNATORS

0	GENERAL (SYMBOLS, LEGENDS, NOTES, ETC.)
1	PLANS
2	ELEVATIONS
3	SECTIONS
4	LARGE SCALE VIEWS (ENLARGED PLANS, STAIR SECTIONS OR SECTIONS THAT ARE NOT DETAILS)
5	DETAILS
7	SCHEDULES, DIAGRAMS, AND SCHEMATICS
9	3D PERSPECTIVES

DATUM CALLOUTS

	ELEVATION
	CONSTRUCTION
	FLOOR ELEVATION BV - Floor Elevation (Shared)
	SPOT ELEVATION BV - Elevation Target
	SPOT COORDINATE BV - Horizontal + EL (Shared)
	SPOT SLOPE BV - Sloped Down

ARCHITECTURAL CALLOUTS

	SHEET NOTE (MARK) NUMBER SEQUENCE
	DOOR (MARK) ROOM NUMBER + LETTER SEQUENCE
	LOUVER (MARK) ROOM NUMBER + LETTER SEQUENCE
	ROOF (TYPE) R + NUMERIC SEQUENCE

CROSS REFERENCE TAGS

ALL CROSS REFERENCE TAGS ARE GENERAL TEXT UNLESS OTHERWISE NOTED.	
	DETAIL HEAD CALLOUT 1/2" DIAMETER CIRCLE
	SECTION HEAD CALLOUT 1/2" DIAMETER CIRCLE
	ROOM NAME ROOM NAME AND NUMBER (MARK) NUMERIC SEQUENCE
	WINDOW (TYPE) LETTER SEQUENCE

	BUILDINGS, STRUCTURES
	FUTURE BUILDINGS, STRUCTURES
	EXISTING BUILDINGS, STRUCTURES

EROSION CONTROL LEGEND

	GRASS SOD AREA
	PERMANENT SEED AREA
	RIP RAP
	SILT FENCE EROSION CONTROL
	INLET SEDIMENT BARRIER
	CURB INLET PROTECTION

PAVEMENT LEGEND

	4" THICK CONCRETE SIDEWALK
	8" THICK CONCRETE PAVEMENT

GENERAL NOTES FOR CIVIL DRAWINGS

- HORIZONTAL CONTROL: COORDINATES ARE BASED ON STATE PLANE COORDINATES SYSTEM NAD 83 DATUM. SEE SHEET C-10-100 FOR MORE INFORMATION. COORDINATES ON STRUCTURES DEPICT THE EXTERIOR FACE OF THE CONCRETE SUBSTRUCTURE FOUNDATION WALL OR FOOTING WALL.
- VERTICAL CONTROL: ELEVATIONS ARE BASED ON NAVD 88 DATUM. BENCHMARKS AND/OR STRUCTURE ELEVATIONS FROM EXISTING SURVEYS OR REFERENCE DRAWINGS MAY RESULT IN VARIANCES WITH ELEVATIONS INDICATED ON THE DRAWINGS FOR EXISTING FACILITIES. SEE SHEET C-10-100 FOR MORE INFORMATION.
- EXISTING UTILITIES AND STRUCTURES (UNDERGROUND, SURFACE, OR OVERHEAD) ARE INDICATED ONLY TO THE EXTENT THAT SUCH INFORMATION WAS KNOWN, OR MADE AVAILABLE TO, OR DISCOVERED BY THE ENGINEER IN PREPARING THE DRAWINGS. THE LOCATIONS, CONFIGURATIONS, AND ELEVATIONS OF SUBSURFACE FACILITIES AND UTILITIES ARE APPROXIMATE, AND NOT ALL UTILITIES AND FACILITIES MAY BE INDICATED. OVERHEAD UTILITIES ARE NOT INDICATED IN ARCHITECTURAL ELEVATIONS, PROFILE OR SECTION DRAWINGS. THE ENGINEERING INVESTIGATIONS, LOCATION, AND DESIGNATION OF SUBSURFACE UTILITIES INDICATED IN THESE CONTRACT DOCUMENTS HAS BEEN PERFORMED TO QUALITY LEVEL C IN ACCORDANCE WITH GENERALLY ACCEPTED ENGINEERING PRINCIPLES AND PRACTICES AS OUTLINED IN ASCE STANDARD AND GUIDELINE BULLETIN C/ASCE 38-02 UNLESS OTHERWISE DESIGNATED. WHERE SUCH ACTIVITIES HAVE BEEN TO A HIGHER LEVEL OF QUALITY, THE HIGHER QUALITY LEVEL FOR THE AFFECTED AREAS IS INDICATED IN THE CONTRACT DOCUMENTS.
- "SCREENED" (LIGHT) DELINEATION INDICATED ON THE DRAWINGS DENOTES EXISTING FACILITIES. "SCREENED" INFORMATION WAS TAKEN FROM EXISTING CONSTRUCTION DRAWINGS AND DATA, IS FOR REFERENCE ONLY, AND SHALL BE FIELD VERIFIED BY THE CONTRACTOR PRIOR TO THE ORDERING OF MATERIALS AND BEGINNING OF CONSTRUCTION. "BOLD" DELINEATION IS NEW WORK TO BE CONSTRUCTED UNDER THIS CONTRACT.
- CALL BEFORE YOU DIG. CONTRACTOR SHALL VERIFY PRECISE LOCATIONS AND ELEVATIONS OF ALL UTILITIES AND STRUCTURES, WHETHER INDICATED ON THE DRAWINGS OR NOT, IN THE FIELD IN ADVANCE OF EXCAVATING, BY CONTACTING ALL UTILITIES AND OTHER AGENCIES, AND BY PROSPECTING. CONTRACTOR SHALL BE RESPONSIBLE FOR REMOVAL, DEMOLITION, RECONSTRUCTION, AND RECONNECTION OF EXISTING FACILITIES AS REQUIRED TO COMPLETE THE WORK. IF REQUIRED AFTER FIELD VERIFICATION, CONTRACTOR SHALL COORDINATE WITH THE ENGINEER TO DETERMINE ANY NECESSARY MODIFICATIONS TO PROPOSED NEW WORK.
- BEFORE CONSTRUCTION IS STARTED, CONTRACTOR SHALL COORDINATE WITH THE OWNER OF EACH UTILITY AND DEFINE THE REQUIREMENTS AND METHODS TO ACCOMMODATE THE PROTECTION, TEMPORARY SUPPORT, ADJUSTMENT, OR RELOCATION OF ANY UTILITIES AFFECTED BY THE PROPOSED NEW WORK.
- CONTRACTOR SHALL COMPLY WITH THE GOVERNING AGENCY NPDES CONSTRUCTION REQUIREMENTS, AND SHALL PROVIDE APPROPRIATE MITIGATION MEASURES OR PROTECTION AND RESTORATION AT ALL LOCATIONS AS REQUIRED BY THEIR OPERATIONS, AND AS DIRECTED BY ENGINEER. SPECIAL CONSTRUCTION REQUIREMENTS, TEMPORARY PROTECTIVE FENCING OR BARRICADES, SHEETING, SHORING, EROSION PROTECTION, AND SURFACE RESTORATION AT CERTAIN LOCATIONS ARE INDICATED ON THE DRAWINGS TO BRING CONTRACTOR'S ATTENTION TO SENSITIVE AREAS.
- THE CONTRACTOR SHALL BE RESPONSIBLE FOR THE PROTECTION OF ALL PROPERTY CORNER MARKERS. PROPERTY CORNER MARKERS DAMAGED BY CONSTRUCTION ACTIVITIES SHALL BE REESTABLISHED BY A PROFESSIONAL SURVEYOR LICENSED IN THE STATE OF KANSAS.
- THE LOCATION OF TEST HOLES INDICATED ON THE DRAWINGS IS APPROXIMATE. CONTRACTOR SHALL REFER TO THE GEOTECHNICAL REPORT FOR ACTUAL TEST HOLE LOCATIONS AND THE FINDINGS OF THE GEOTECHNICAL INVESTIGATIONS.
- CONTRACTOR SHALL PROTECT AND MAINTAIN ALL EXISTING TREES, SHRUBS, AND PLANTS UNLESS OTHERWISE NOTED.
- CONTRACTOR SHALL INSTALL ALL PIPELINES, PAVING, WALKWAYS, AND CURB AND GUTTER AT A UNIFORM GRADE BETWEEN ELEVATIONS DEPICTED ON THE DRAWINGS.
- FOR ALL SITE GRADING, SMOOTH PARABOLIC TRANSITIONS SHALL BE MADE BETWEEN CHANGES IN SLOPE. PARABOLIC ROUNDING SHALL APPLY TO ALL CUT AND FILL SECTIONS.
- FINISHED GRADE ELEVATION AT THE BUILDING FACE, WHERE NOT ADJACENT TO PAVEMENT, SHALL BE APPROXIMATELY 6 INCHES BELOW FINISHED FLOOR ELEVATION UNLESS OTHERWISE NOTED.
- THE CONTRACTOR'S OPERATIONS SHALL CONFORM TO THE RULES AND REGULATIONS OF THE STATE CONSTRUCTION SAFETY ORDERS PERTAINING TO EXCAVATION AND TRENCHING.
- RESTRAINED JOINTS SHALL BE PROVIDED FOR BURIED PIPING AS INDICATED ON THE DRAWINGS AND/OR AS SCHEDULED IN THE SPECIFICATIONS.
- THE DRAWINGS INDICATE TYPES OF PIPE SUPPORT SYSTEMS AT VARIOUS LOCATIONS. HOWEVER, ALL PIPE SUPPORTS, HANGERS, BRACKETS, INSERTS OR BRACES ARE NOT SHOWN. CONTRACTOR SHALL REFER TO THE SPECIFICATIONS AND PROVIDE A COMPLETE SUPPORT SYSTEM AS REQUIRED.
- THE TERM "PROPOSED" AS INDICATED ON THE DRAWINGS MEANS THE ITEM IS DESIGNED OR PLANNED TO BE PROVIDED BY OWNER OR OTHERS SEPARATE FROM THIS CONTRACT. THE TERM "FUTURE" AS INDICATED ON THE DRAWINGS REFERS TO THE ENGINEER'S INTERPRETATION OF THE ITEM FOR THE FUTURE, BASED ON AVAILABLE INFORMATION.
- STRUCTURES SUCH AS CURBS AND GUTTERS, CONCRETE AND ASPHALT DRIVES AND WALKWAYS, PAVING BRICKS, FENCING, RETAINING WALLS, ETC., CROSSED BY THE PIPELINE ARE NOT ALL INDICATED IN PROFILE. CONTRACTOR SHALL RESTORE ANY EXISTING STRUCTURES THAT ARE DISTURBED, DAMAGED OR REMOVED BY CONSTRUCTION.
- HORIZONTAL STATIONING ALONG THE PIPELINE ALIGNMENT IS FOR LEVEL LINE MEASUREMENT AND FOR PAYMENT OF THE PIPELINES. CONTRACTOR SHALL PROVIDE THE ACTUAL PIPE LENGTH TO BE DETERMINED BY THE SLOPE OR CURVE ON WHICH THE PIPE IS INSTALLED.
- CONTRACTOR SHALL FIELD VERIFY PRECISE LOCATION, ELEVATION, AND ARRANGEMENT OF CONNECTIONS OF NEW PIPELINES WITH EXISTING PIPELINES BASED ON FIELD CONDITIONS, INCLUDING EXPOSING EXISTING PIPING PRIOR TO FABRICATING NEW PIPING. CONTRACTOR SHALL PROVIDE FITTINGS, ADAPTERS, SOLID SLEEVE CLOSURES, AND HARNESS MECHANICAL COUPLING; ROTATE FITTINGS; DEFLECT JOINTS; AND MODIFY EXISTING PIPING AS APPLICABLE AND AS REQUIRED TO MAKE CONNECTIONS, INCLUDING ADJUSTMENTS FOR ANY OFFSETS IN CENTERLINE ELEVATIONS BETWEEN PIPELINES. CONTRACTOR SHALL PROVIDE TEMPORARY PLUG WITH FACTORY OUTLET SIZED AS REQUIRED FOR CONTRACTOR'S TESTING AND DISINFECTION WORK BEFORE MAKING CONNECTION, WHEN APPLICABLE. CONTRACTOR SHALL COORDINATE MAKING EACH CONNECTION WITH THE OWNER.
- MINIMUM BURY DEPTHS FOR NEW PIPING SHALL BE AS FOLLOWS:
 - POTABLE WATER - 42"
 - GAS - 36"
 - ELECT - 24"
- ANY VERTICAL CONFLICTS, INCLUDING WITH DUCT BANKS SHALL BE RESOLVED BY EITHER DEFLECTING THE PIPE WITHIN THE MANUFACTURER'S RECOMMENDED SPECIFICATIONS OR BY USING VERTICAL BENDS. NON POTABLE WATER SHALL BE ROUTED BELOW POTABLE WATER IN ALL INSTANCES. ALL PIPING SHALL BE ROUTED BELOW ELECT DUCT BANKS.
- GRAVITY SEWER AND DRAIN LINES SHALL BE SDR 26 PVC CONFORMING TO CITY OF LAWRENCE STANDARD SPECIFICATIONS UNLESS OTHERWISE NOTED.

GENERAL NOTES FOR CIVIL DRAWINGS

R/W	RIGHT-OF-WAY
EX	EXISTING
RT	ALIGN OFFSET RIGHT SIDE
LT	ALIGN OFFSET LEFT SIDE
FG	FINISHED GRADE ELEVATION
TC	TOP OF CURB ELEVATION
GT	GUTTER OF CURB ELEVATION
TP	TOP OF PAVEMENT ELEVATION
DIP	DUCTILE IRON PIPE
ME	MATCH EXISTING ELEVATION
TW	TOP OF WALL ELEVATION
BW	BOTTOM OF WALL AT GRADE ELEVATION
EOA	EDGE OF ASPHALT PAVEMENT
WL	WATERLINE
UGG	UNDER GROUND GAS
UGT	UNDER GROUND TELEPHONE
DND	DO NOT DISTURB

LAWRENCE, KANSAS
STRATFORD WATER TOWER REPLACEMENT

CIVIL
LEGENDS, ABBREVIATIONS,
& GENERAL NOTES

DESIGNED: SNW
DETAILED: BSG
CHECKED: JJW
APPROVED: AJH
DATE: 12/16/2021

0 1/2 1
IF THIS BAR DOES NOT MEASURE 1" THEN DRAWING IS NOT TO FULL SCALE

PROJECT NO. 402979

G-00-002 SHEET 1 OF 35



BLACK & VEATCH

Black & Veatch Corporation
Kansas City, Missouri

REVISIONS AND RECORD OF USE

DATE

NO. BY CHK/APP


FP0909A
D:\0000
PLOTTED: 5/31/2022 9:36 AM FILE: C:\pwworking\bw_americas\009505494\C-10-100.dwg

ALL THAT PART OF A TRACT OF LAND DESCRIBED IN DEED BOOK 131 PAGE 403, AND DEED BOOK 12 PAGE 612, IN THE SOUTHWEST QUARTER OF SECTION 36 TOWNSHIP 12 SOUTH RANGE 19 EAST OF THE SIXTH PRINCIPAL MERIDIAN, MORE PARTICULARLY DESCRIBED AS FOLLOWS:

BEGINNING AT THE NORTHEAST CORNER OF LOT 1, STRATFORD ADDITION, THENCE NORTH 01 DEGREES 30 MINUTES 35 SECONDS WEST, COINCIDENT WITH THE EAST LINE OF BLOCK 4, HILLCREST ADDITION, A DISTANCE OF 351.95 FEET, TO THE SOUTHWEST CORNER OF LOT 5, BLOCK 12, HILLCREST ADDITION; THENCE NORTH 88 DEGREES 21 MINUTES 36 SECONDS EAST, COINCIDENT WITH THE SOUTH LINE OF BLOCK 12 HILLCREST ADDITION, A DISTANCE OF 333.33 FEET (MEASURED), 333.5 FEET (DEED), TO THE SOUTHEAST CORNER OF LOT 5, BLOCK 12, HILLCREST ADDITION; THENCE SOUTH 01 DEGREE 29 MINUTES 38 SECONDS EAST, COINCIDENT WITH THE WEST RIGHT-OF-WAY LINE OF SUNSET DRIVE, A DISTANCE OF 351.36 FEET, TO THE NORTHEAST CORNER OF LOT 1, BLOCK 1, UNIVERSITY HILLS ADDITION NO.2; THENCE SOUTH 88 DEGREES 15 MINUTES 33 SECONDS WEST, COINCIDENT WITH THE NORTH LINE OF BLOCK 1, UNIVERSITY HILLS ADDITION NO.2, AND THE NORTH LINE OF LOT 3, BLOCK 1, UNIVERSITY HILLS ADDITION, A DISTANCE OF 333.24 FEET (MEASURED), 333.5 FEET (DEED) TO THE POINT OF BEGINNING.

LEGAL DESCRIPTION

NO.	NORTHING	EASTING	ELEVATION
1000	240951.04	2091850.06	TC 1041.77
1001	240938.91	2091849.85	TC 1041.73
1002	240916.10	2091839.34	TC 1041.57
1003	240909.60	2091832.07	TC 1041.53
1004	240912.67	2091843.35	ME 1041.97
1005	240913.15	2091855.02	ME 1041.77
1006	240913.56	2091876.71	ME 1041.86
1007	240929.56	2091876.79	ME 1041.84
1008	240938.57	2091857.10	ME 1041.75
1009	240962.63	2092206.13	TC 1041.38
1010	240937.85	2092206.83	TC 1041.11
1011	240919.84	2092207.51	TC 1040.99
1012	240896.91	2092208.20	TC 1040.72
1013	240914.74	2092197.79	ME 1041.17
1014	240921.08	2092182.28	ME 1040.89
1015	240937.23	2092181.98	ME 1041.10
1016	240944.40	2092196.95	ME 1041.36
1017	240629.54	2091886.11	ME 1035.86

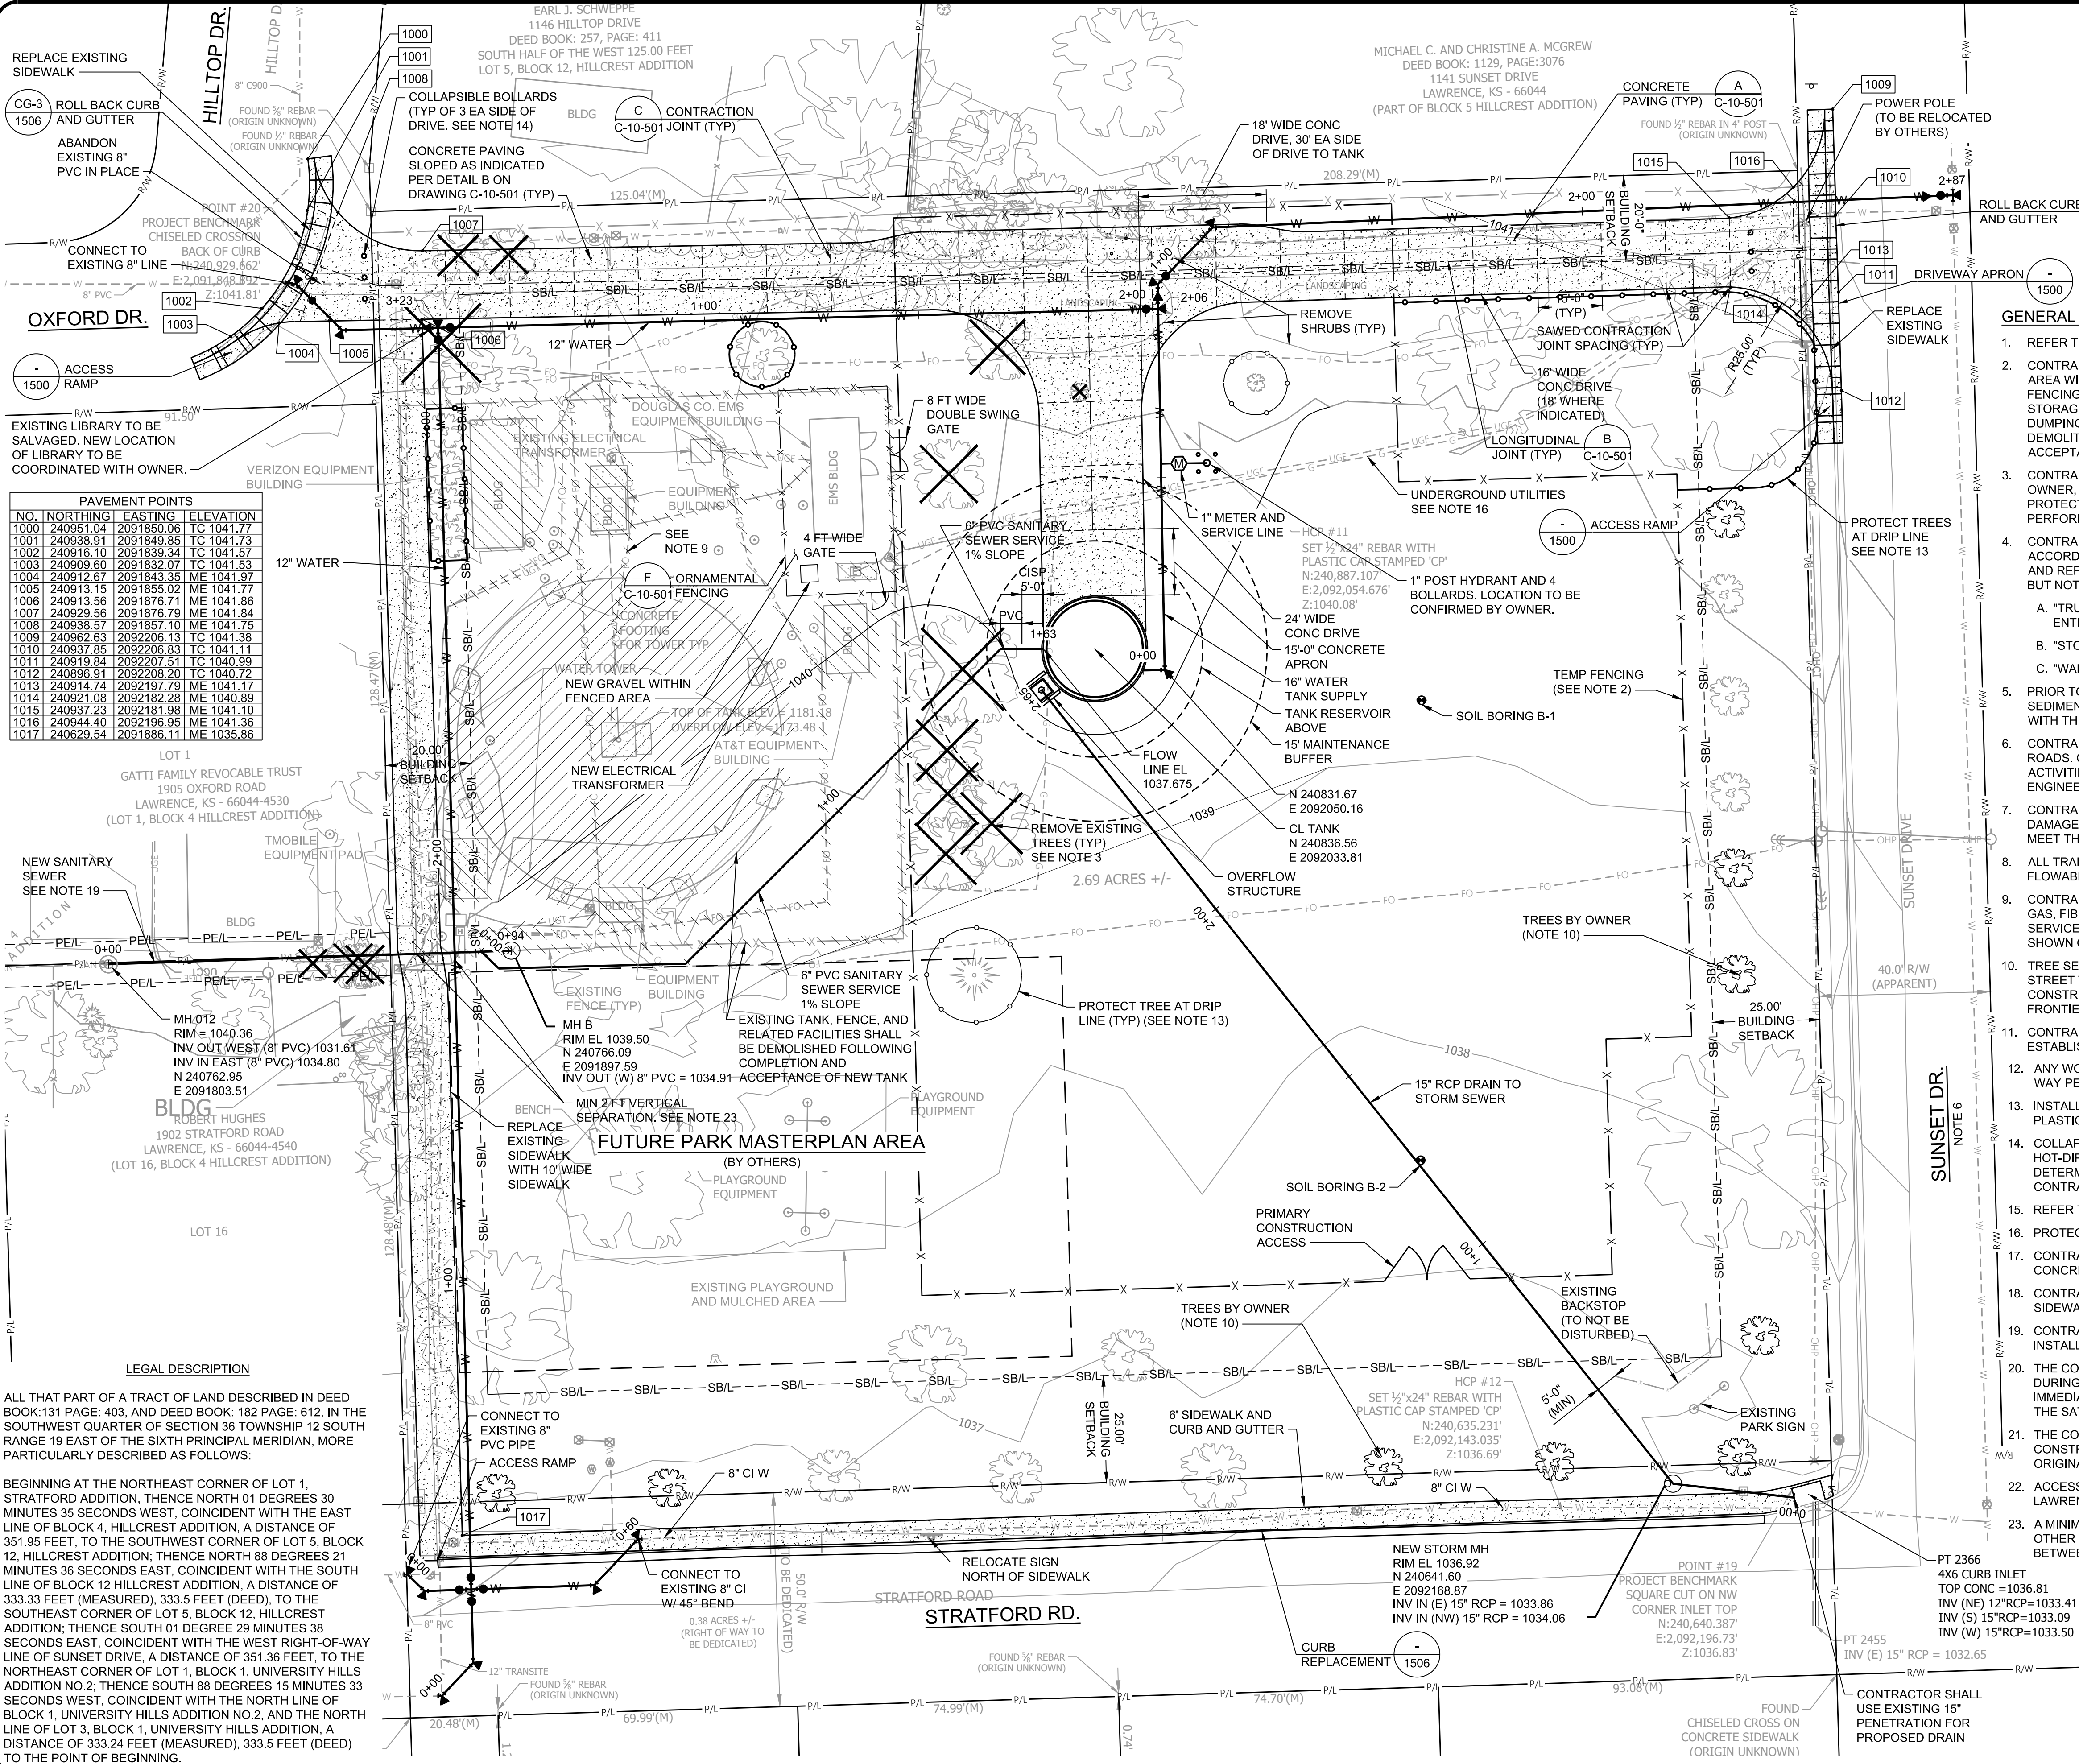

GENERAL NOTES:

- REFER TO DWG G-00-001 FOR LEGENDS, ABBREVIATIONS, & GENERAL NOTES.
- CONTRACTOR'S STAGING, PARKING, AND MATERIAL STORAGE SHALL BE LIMITED TO THE AREA WITHIN THE LIMITS OF THE TEMPORARY FENCING AS INDICATED. TEMPORARY FENCING SHALL BE 6 FT HIGH AND PROVIDED WITH SCREENING MATERIAL. ADDITIONAL STORAGE OR PARKING AREA SHALL BE THE RESPONSIBILITY OF THE CONTRACTOR. NO DUMPING OF EXCESS MATERIALS IS ALLOWED WITHIN THE PARK. DURING TANK DEMOLITION, THE ENTIRE PARK SHALL BE CLOSED WITH TEMPORARY BARRICADES ACCEPTABLE TO OWNER.
- CONTRACTOR SHALL NOT REMOVE OR TRIM ANY TREES WITHOUT APPROVAL FROM THE OWNER, OR UNLESS NOTED OTHERWISE ON THE DRAWINGS. EXISTING TREES SHALL BE PROTECTED IN A MANNER ACCEPTABLE TO OWNER. TREE REMOVAL SHALL BE PERFORMED BY A CITY LICENSED TREE TRIMMER.
- CONTRACTOR SHALL ERECT AND MAINTAIN TRAFFIC CONTROL SIGNAGE IN ACCORDANCE WITH PART VI OF THE MANUAL OF UNIFORM TRAFFIC CONTROL DEVICES, AND REFLECTIVE PER ASTM D4956 TYPE VI. AT A MINIMUM, SIGNAGE SHALL INCLUDE BUT NOT LIMITED TO THE FOLLOWING:
 - "TRUCKS ENTERING ROADWAY" SIGNAGE 300 FT EITHER DIRECTION FROM SITE ENTRANCE ON SUNSET DR.
 - "STOP" SIGNS FOR TRUCKS LEAVING SITE.
 - "WARNING: TRUCKS CROSSING SIDEWALK AHEAD"
- PRIOR TO CONSTRUCTION ON-SITE, CONTRACTOR SHALL IMPLEMENT EROSION & SEDIMENT CONTROL MEASURES AS SHOWN ON DWG C-10-103 AND IN ACCORDANCE WITH THE STORM WATER POLLUTION PREVENTION PLAN.
- CONTRACTOR SHALL IMPLEMENT MEASURES TO PREVENT TRACKING OF MUD ONTO ROADS. CONTRACTOR SHALL BE RESPONSIBLE TO COORDINATE ROAD CLEANING ACTIVITIES AT THE DISCRETION OF AND TO THE ACCEPTANCE OF THE OWNER OR ENGINEER AS REQUIRED.
- CONTRACTOR SHALL REPLACE ALL CURB AND GUTTER, SIDEWALKS, AND PAVING DAMAGED BY CONSTRUCTION ACTIVITIES. ANY EXISTING SIDEWALK THAT DOES NOT MEET THE CITY SIDEWALK STANDARDS SHALL BE REPLACED.
- CONTRACTOR SHALL COORDINATE ABANDONMENT OF THE EXISTING UNDERGROUND GAS, FIBER OPTIC, TELEPHONE, AND ELECTRIC LINES WITH THE OWNING UTILITY. NEW SERVICES WILL BE REQUIRED FOR THE NEW TANK AND EXISTING EMS BUILDING AS SHOWN ON DWG E-10-101.
- TREE SELECTION AND SPACING IN ACCORDANCE WITH CITY OF LAWRENCE MASTER STREET TREE PLAN. TREES WILL BE FURNISHED AND PLANTED BY OWNER AFTER CONSTRUCTION. TREES WILL BE OF THE FOLLOWING SPECIES: SWAMP WHITE OAK, FRONTIER ELM, KENTUCKY COFFEE, AND SAWTOOTH OAK.
- CONTRACTOR SHALL SEED ALL DISTURBED AREAS AND MAINTAIN UNTIL GRASS IS ESTABLISHED.
- ANY WORK PERFORMED WITHIN THE CITY RIGHT OF WAY WILL REQUIRE A RIGHT OF WAY PERMIT.
- INSTALL 4' (MIN) TALL TEMP WIRE/METAL FENCE 10' (MIN) BEYOND DRIP LINE. ORANGE PLASTIC CONSTRUCTION FENCING IS NOT ACCEPTABLE.
- COLLAPSIBLE BOLLARDS SHALL BE 32" TALL ABOVEGRADE, MADE FROM 3"x6" TUBING, HOT-DIPPED GALV WITH POWDER COATING AND REFLECTIVE TAPE (COLORS DETERMINED BY OWNER), MANUFACTURED BY MAXIFORCE, OR APPROVED EQUAL. CONTRACTOR SHALL COORDINATE BOLLARD COLOR WITH OWNER.
- REFER TO DWG E-10-101 FOR THE ELECTRICAL SITE PLAN.
- PROTECT UTILITIES DURING CONSTRUCTION OF NEW TOWER.
- CONTRACTOR TO MATCH EXISTING CONTOURS WHEN CONSTRUCTING THE NEW CONCRETE DRIVE. FINAL SITE SHALL MATCH EXISTING SITE CONTOURS.
- CONTRACTOR SHALL FOLLOW CITY STANDARD SIDEWALKS TO INLET DOWELING FOR SIDEWALKS ADJOINING STORM STRUCTURES.
- CONTRACTOR SHALL PERFORM ALL WORK WITHIN EXSITING EASEMENTS FOR INSTALLATION OF THE NEW SANITARY SEWER BETWEEN MH B AND MH12.
- THE CONTRACTOR SHALL PROTECT ALL AREAS FROM DAMAGE WHICH MAY OCCUR DURING CONSTRUCTION. ANY DAMAGE TO NEW AND/OR EXISTING FACILITIES SHALL BE IMMEDIATELY REPAIRED OR REPLACED, AT THE EXPENSE OF THE CONTRACTOR, TO THE SATISFACTION OF THE OWNER.
- THE CONTRACTOR SHALL SAFEGUARD THE OWNER'S PROPERTY DURING CONSTRUCTION AND SHALL REPLACE ANY DAMAGED PROPERTY OF THE OWNER TO ORIGINAL CONDITION.
- ACCESS TO THE WATER TOWER SITE SHALL BE COORDINATED WITH CITY OF LAWRENCE MUNICIPAL SERVICES & OPERATIONS DEPARTMENT, 785-832-7800.
- A MINIMUM OF 5 FT HORIZONTAL SEPARATION BETWEEN SANITARY SEWER AND ALL OTHER UTILITIES SHALL BE MAINTAINED. A MINIMUM OF 2 FT VERTICAL SEPARATION BETWEEN SANITARY SEWER AND WATERLINES SHALL ALSO BE MAINTAINED.



PROPERTY SURFACE SUMMARY			
SUMMARY OF EXISTING CONDITIONS		SUMMARY AFTER PROJECT COMPLETION	
TOTAL BUILDINGS	1,134 R²	TOTAL BUILDINGS	1,096 R²
TOTAL PAVEMENT	3,081 R²	TOTAL PAVEMENT	12,953 R²
TOTAL IMPERVIOUS	4,215 R²	TOTAL IMPERVIOUS	14,049 R²
TOTAL PERVIOUS	112,800 R²	TOTAL PERVIOUS	102,966 R²
TOTAL PROPERTY AREA	117,015 R²	TOTAL PROPERTY AREA	117,015 R²

LAWRENCE, KANSAS - UT1984

STRATFORD WATER TOWER REPLACEMENT

CIVIL
OVERALL SITE PLAN

DESIGNED: SNW, GJS
DETAILED: BSG
CHECKED: JJW
APPROVED: AJH
DATE: 12/16/2021


0 1/2 1
IF THIS BAR DOES NOT
MEASURE 1" THEN DRAWING
IS NOT TO FULL SCALE

PROJECT NO.
402979

C-10-100
SHEET
10 OF 49

BLACK & VEATCH

Black & Veatch Corporation
Kansas City, Missouri

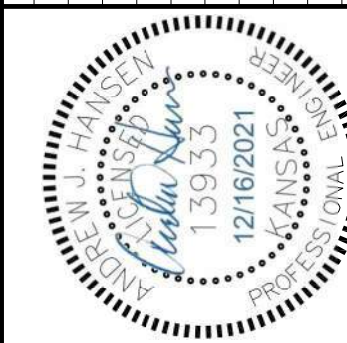

REVISIONS AND RECORD OF USE

DATE


NO. BY CHK/APP

FP0909A
D:\0000
PLOTTED: 5/31/2022 9:33 AM FILE: C:\pwworking\bw_america\00905494\C-10-101.dwg

LEGAL DESCRIPTION

ALL THAT PART OF A TRACT OF LAND DESCRIBED IN DEED BOOK:131 PAGE:403, AND DEED BOOK: 182 PAGE:612, IN THE SOUTHWEST QUARTER OF SECTION 36 TOWNSHIP 12 SOUTH RANGE 19 EAST OF THE SIXTH PRINCIPAL MERIDIAN, MORE PARTICULARLY DESCRIBED AS FOLLOWS:

BEGINNING AT THE NORTHEAST CORNER OF LOT 1, STRATFORD ADDITION, THENCE NORTH 01 DEGREES 30 MINUTES 35 SECONDS WEST, COINCIDENT WITH THE EAST LINE OF BLOCK 4, HILLCREST ADDITION, A DISTANCE OF 351.95 FEET, TO THE SOUTHWEST CORNER OF LOT 5, BLOCK 12, HILLCREST ADDITION; THENCE NORTH 88 DEGREES 21 MINUTES 36 SECONDS EAST, COINCIDENT WITH THE SOUTH LINE OF BLOCK 12 HILLCREST ADDITION, A DISTANCE OF 333.33 FEET (MEASURED), 333.5 FEET (DEED), TO THE SOUTHEAST CORNER OF LOT 5, BLOCK 12, HILLCREST ADDITION; THENCE SOUTH 01 DEGREE 29 MINUTES 38 SECONDS EAST, COINCIDENT WITH THE WEST RIGHT-OF-WAY LINE OF SUNSET DRIVE, A DISTANCE OF 351.36 FEET, TO THE NORTHEAST CORNER OF LOT 1, BLOCK 1, UNIVERSITY HILLS ADDITION NO.2; THENCE SOUTH 88 DEGREES 15 MINUTES 33 SECONDS WEST, COINCIDENT WITH THE NORTH LINE OF BLOCK 1, UNIVERSITY HILLS ADDITION NO.2, AND THE NORTH LINE OF LOT 3, BLOCK 1, UNIVERSITY HILLS ADDITION, A DISTANCE OF 333.24 FEET (MEASURED), 333.5 FEET (DEED) TO THE POINT OF BEGINNING.

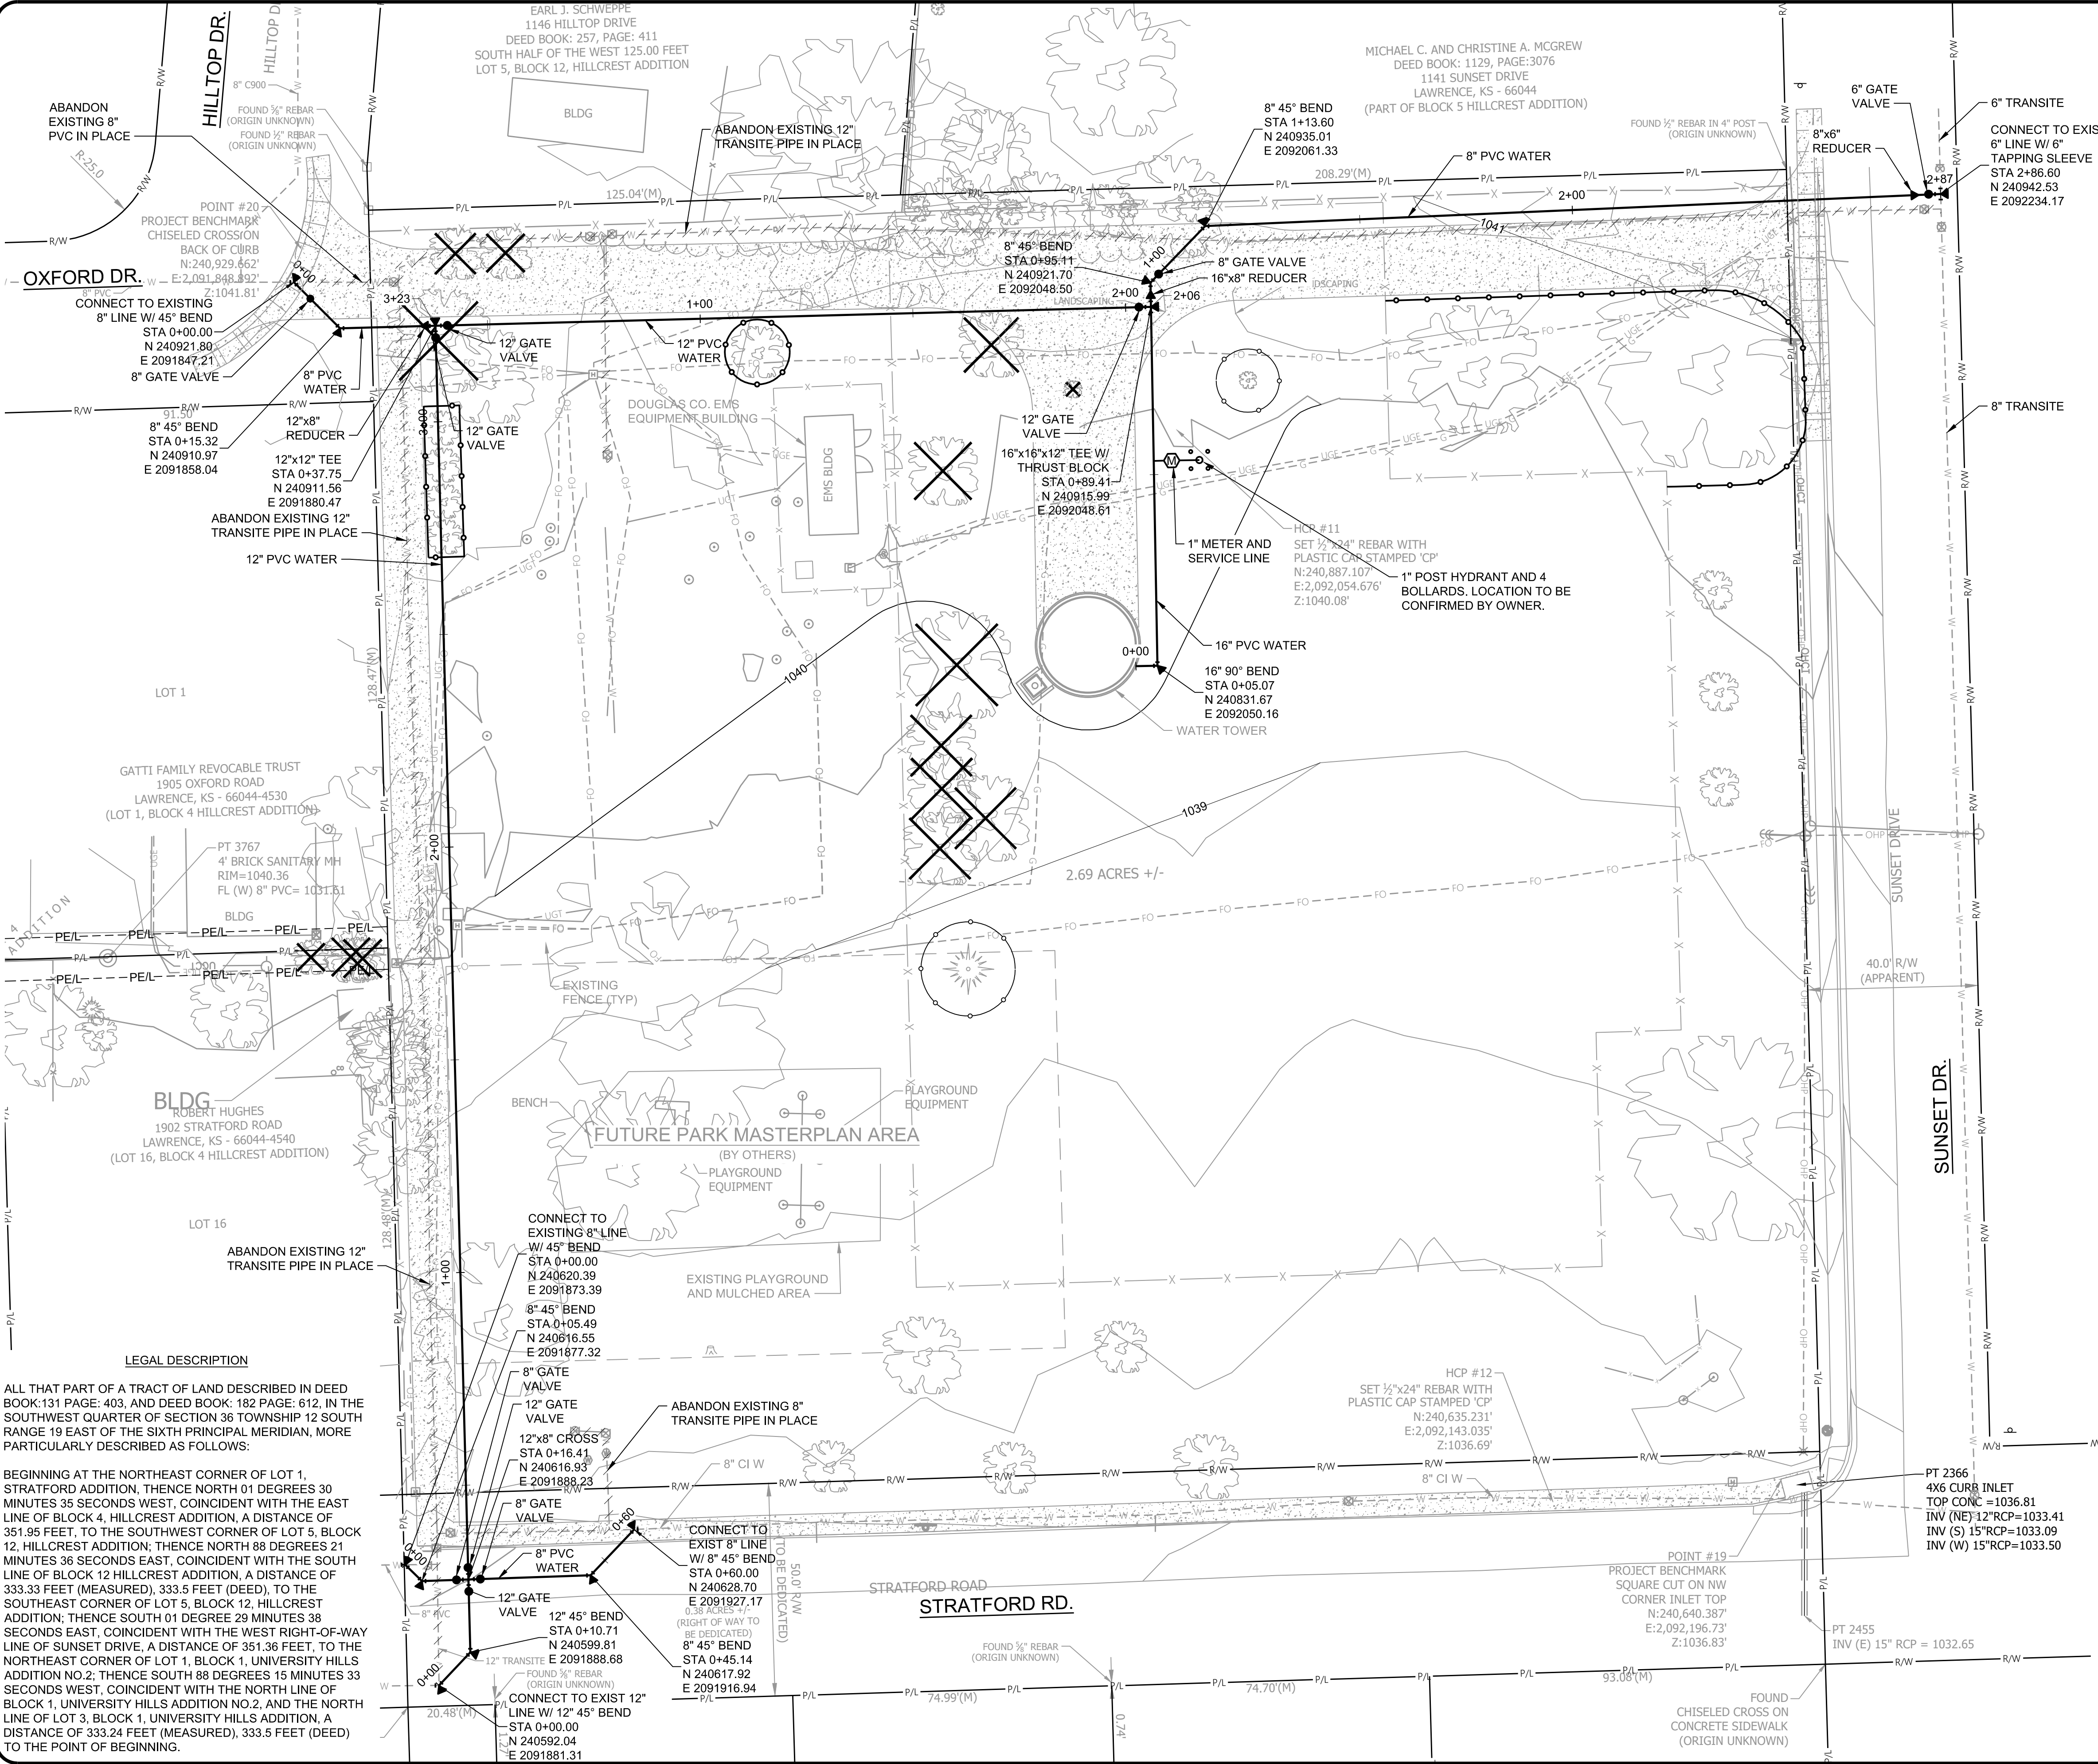

GENERAL NOTES:

- CONTRACTOR TO ABANDON WATER LINES IN PLACE AS INDICATED ON THE DRAWINGS. CONTRACTOR TO REMOVE AND FILL IN ALL VALVE BOX LOCATIONS FOR ABANDONED WATER LINES.
- PER CITY STANDARD, BACK OF CURB WATER LINES SHALL HAVE A MINIMUM OF 42" COVER. WATER LINES UNDER PAVEMENT SHALL HAVE A MINIMUM COVER OF 60".
- REFER TO DWG G-00-001 FOR LEGENDS, ABBREVIATIONS, & GENERAL NOTES.
- CONTRACTOR SHALL NOT REMOVE OR TRIM ANY TREES WITHOUT APPROVAL FROM THE OWNER, OR UNLESS NOTED OTHERWISE ON THE DRAWINGS. EXISTING TREES SHALL BE PROTECTED IN A MANNER ACCEPTABLE TO OWNER. TREE REMOVAL SHALL BE PERFORMED BY A CITY LICENSED TREE TRIMMER.
- CONTRACTOR SHALL ERECT AND MAINTAIN TRAFFIC CONTROL SIGNAGE IN ACCORDANCE WITH PART VI OF THE MANUAL OF UNIFORM TRAFFIC CONTROL DEVICES AND REFLECTIVE PER ASTM D4956 TYPE VI. AT A MINIMUM, SIGNAGE SHALL INCLUDE BUT NOT LIMITED TO THE FOLLOWING:
 - "TRUCKS ENTERING ROADWAY" SIGNAGE 300 FT EITHER DIRECTION FROM SITE ENTRANCE ON SUNSET DR.
 - "STOP" SIGNS FOR TRUCKS LEAVING SITE.
 - "WARNING: TRUCKS CROSSING SIDEWALK AHEAD"
- PRIOR TO CONSTRUCTION ON-SITE, CONTRACTOR SHALL IMPLEMENT EROSION & SEDIMENT CONTROL MEASURES AS SHOWN ON DWG C-10-103 AND IN ACCORDANCE WITH THE STORM WATER POLLUTION PREVENTION PLAN.
- ALL TRANSITE AND CAST IRON PIPE TO BE ABANDONED SHALL BE FILLED WITH FLOWABLE FILL AND CAPPED ON EACH END.
- ANY WORK PERFORMED WITHIN THE CITY RIGHT-OF-WAY WILL REQUIRE A RIGHT-OF-WAY PERMIT.
- INSTALL 4' (MIN) TALL TEMP WIRE/METAL FENCE 10' (MIN) BEYOND DRIP LINE. ORANGE PLASTIC CONSTRUCTION FENCING IS NOT ACCEPTABLE.
- THE CONTRACTOR SHALL PROTECT ALL AREAS FROM DAMAGE WHICH MAY OCCUR DURING CONSTRUCTION. ANY DAMAGE TO NEW AND/OR EXISTING FACILITIES SHALL BE IMMEDIATELY REPAIRED OR REPLACED, AT THE EXPENSE OF THE CONTRACTOR, TO THE SATISFACTION OF THE OWNER.
- THE CONTRACTOR SHALL SAFEGUARD THE OWNER'S PROPERTY DURING CONSTRUCTION AND SHALL REPLACE ANY DAMAGED PROPERTY OF THE OWNER TO ORIGINAL CONDITION.
- ACCESS TO THE WATER TOWER SITE SHALL BE COORDINATED WITH CITY OF LAWRENCE MUNICIPAL SERVICES & OPERATIONS DEPARTMENT, 785-832-7800.

LAWRENCE, KANSAS - UT1984
STRATFORD WATER TOWER REPLACEMENT

DESIGNED: SNW GJS
DETAILED: BSG
CHECKED: JJW
APPROVED: AJH
DATE: 12/16/2021

0 1/2 1
IF THIS BAR DOES NOT MEASURE 1" THEN DRAWING IS NOT TO FULL SCALE

PROJECT NO.
402979


C-10-101
SHEET
11 OF 49

BLACK & VEATCH


Black & Veatch Corporation
Kansas City, Missouri




NO. BY CHK/APP
REVISIONS AND RECORD OF USE
DATE

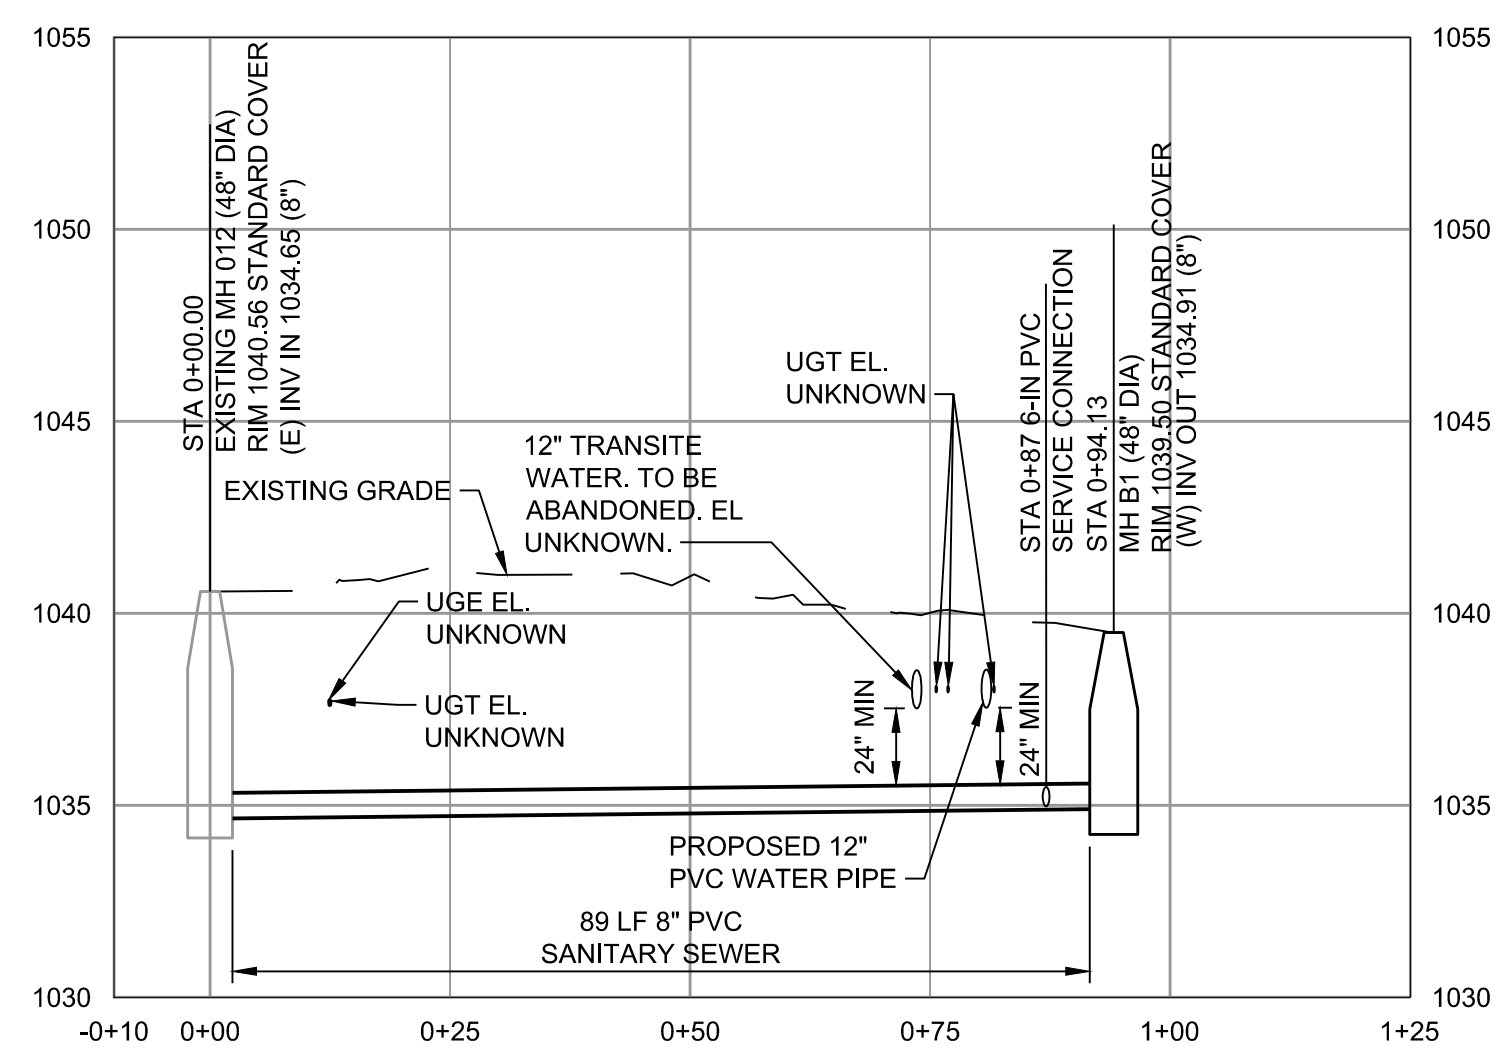


1 MAIN SEWER ALIGNMENT
C-10-100 1"=20'

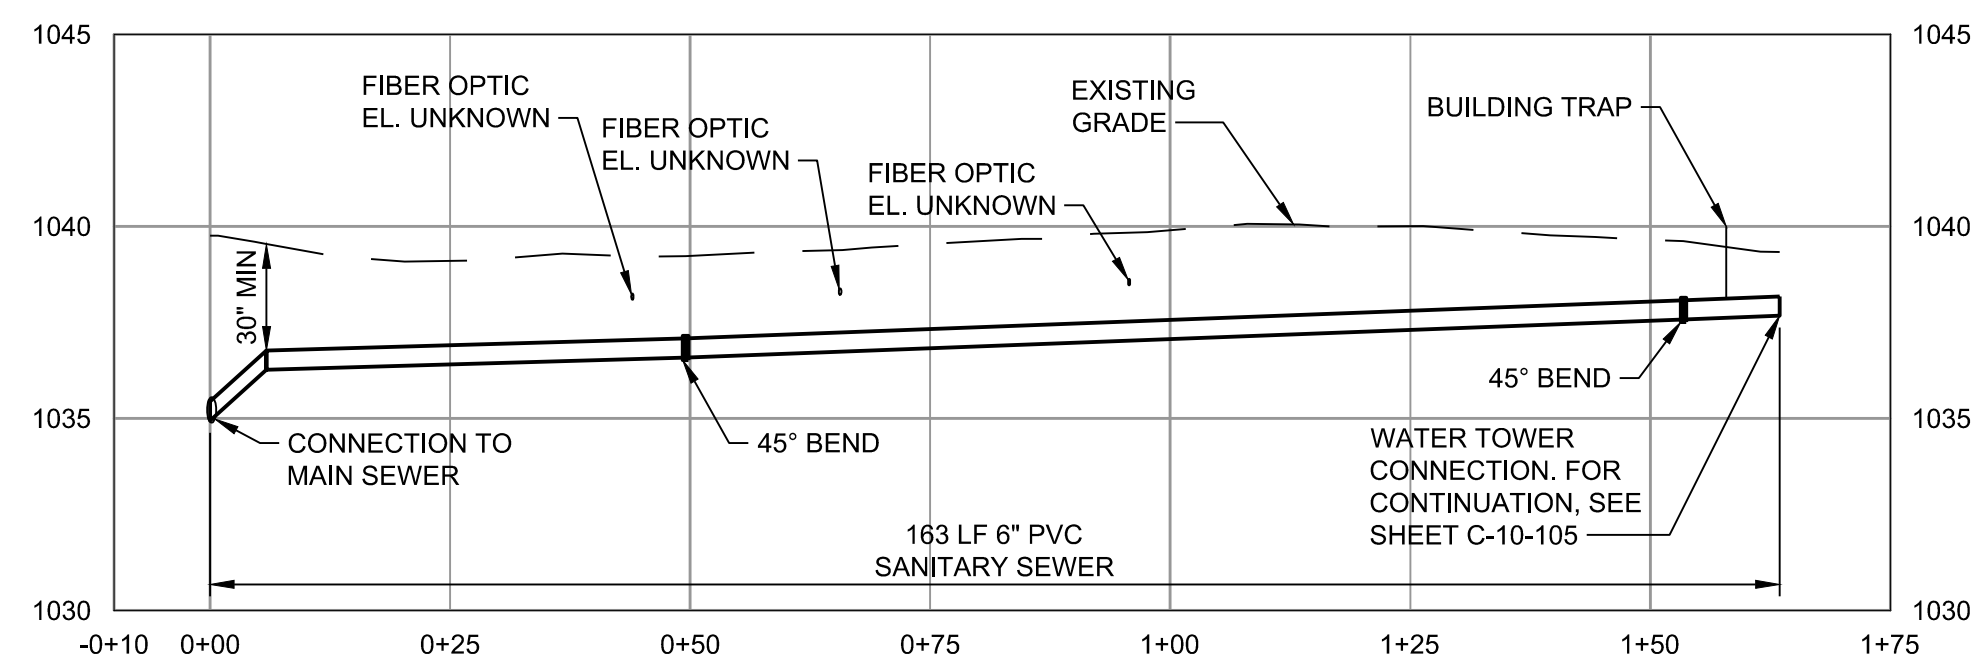

WATER TOWER SERVICE
LATERAL ALIGNMENT

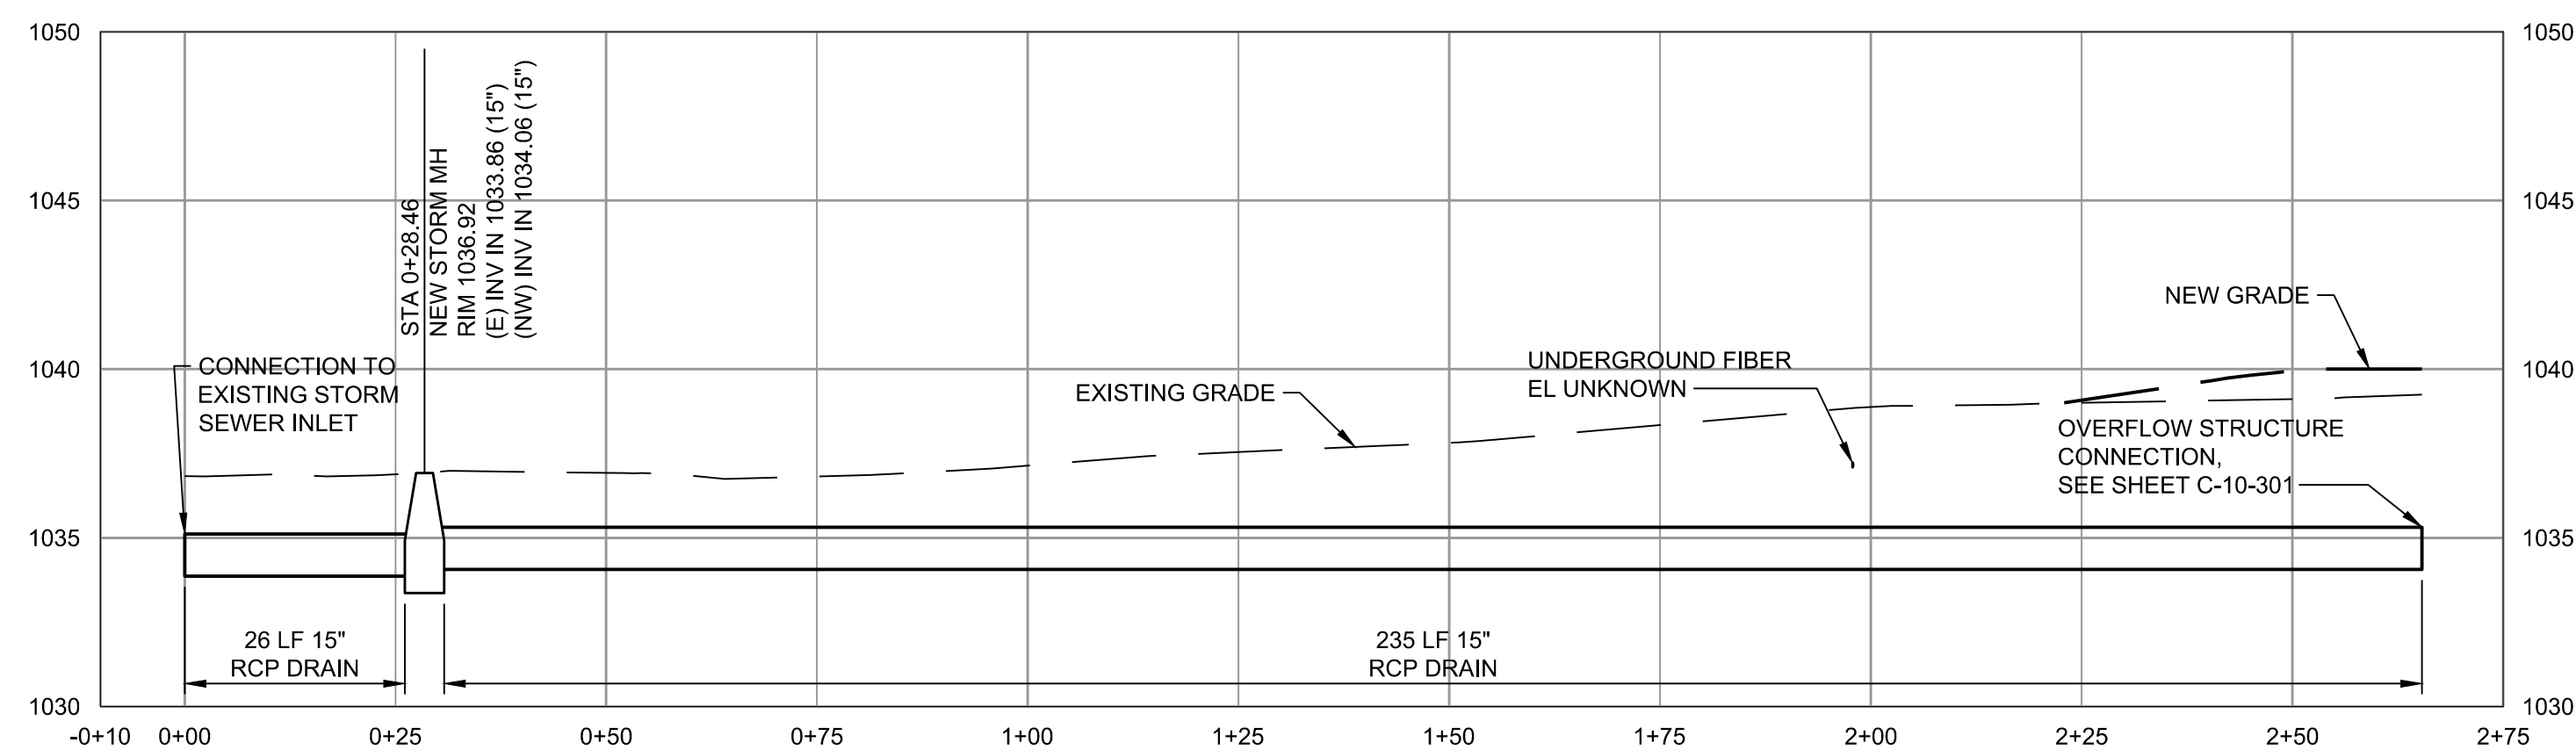


3
C-10-100 1"=20'

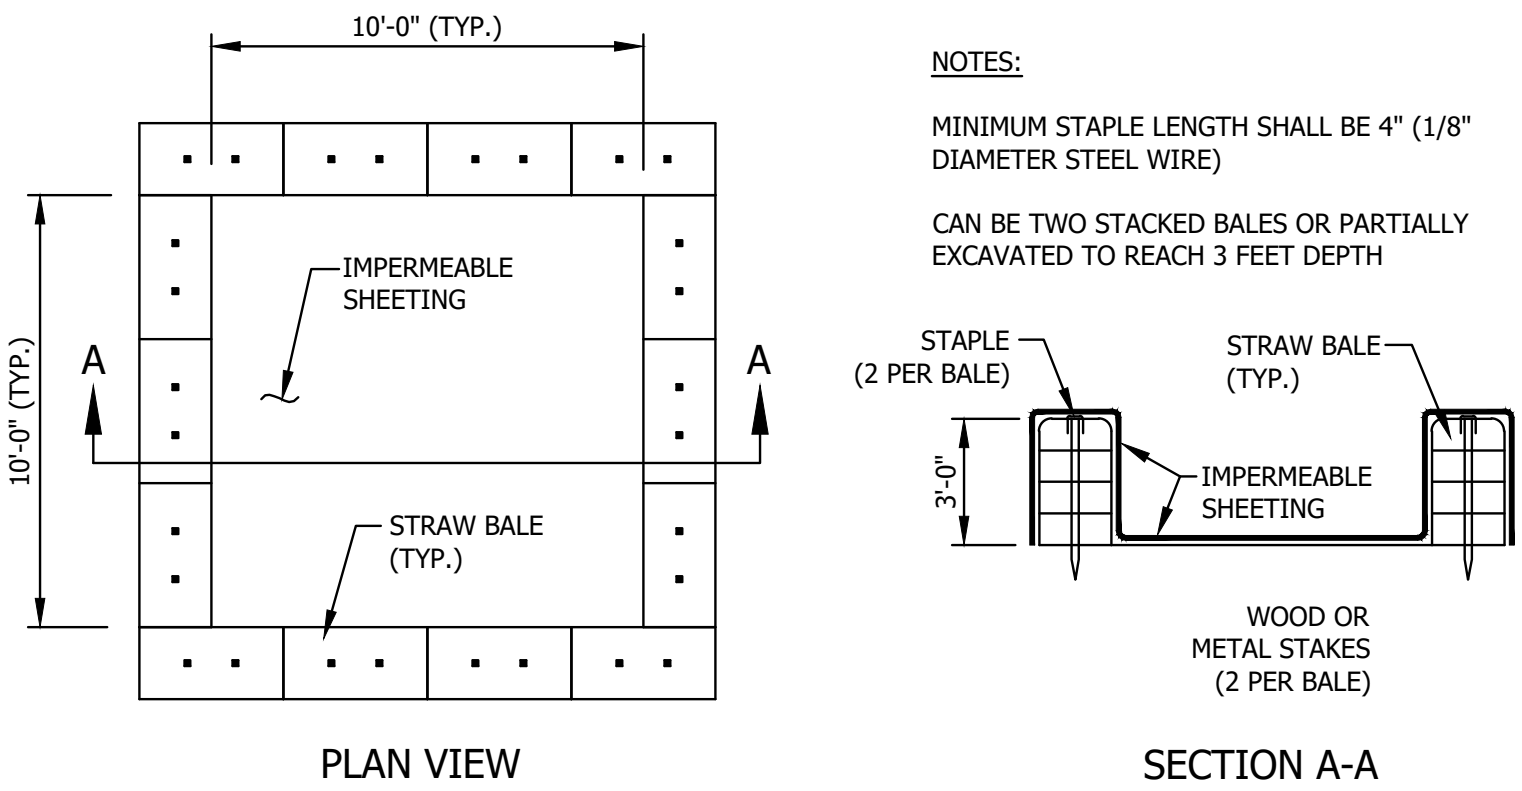

WASHOUT STRUCTURE WITH STRAW BALES

CONCRETE WASHOUT

NTS

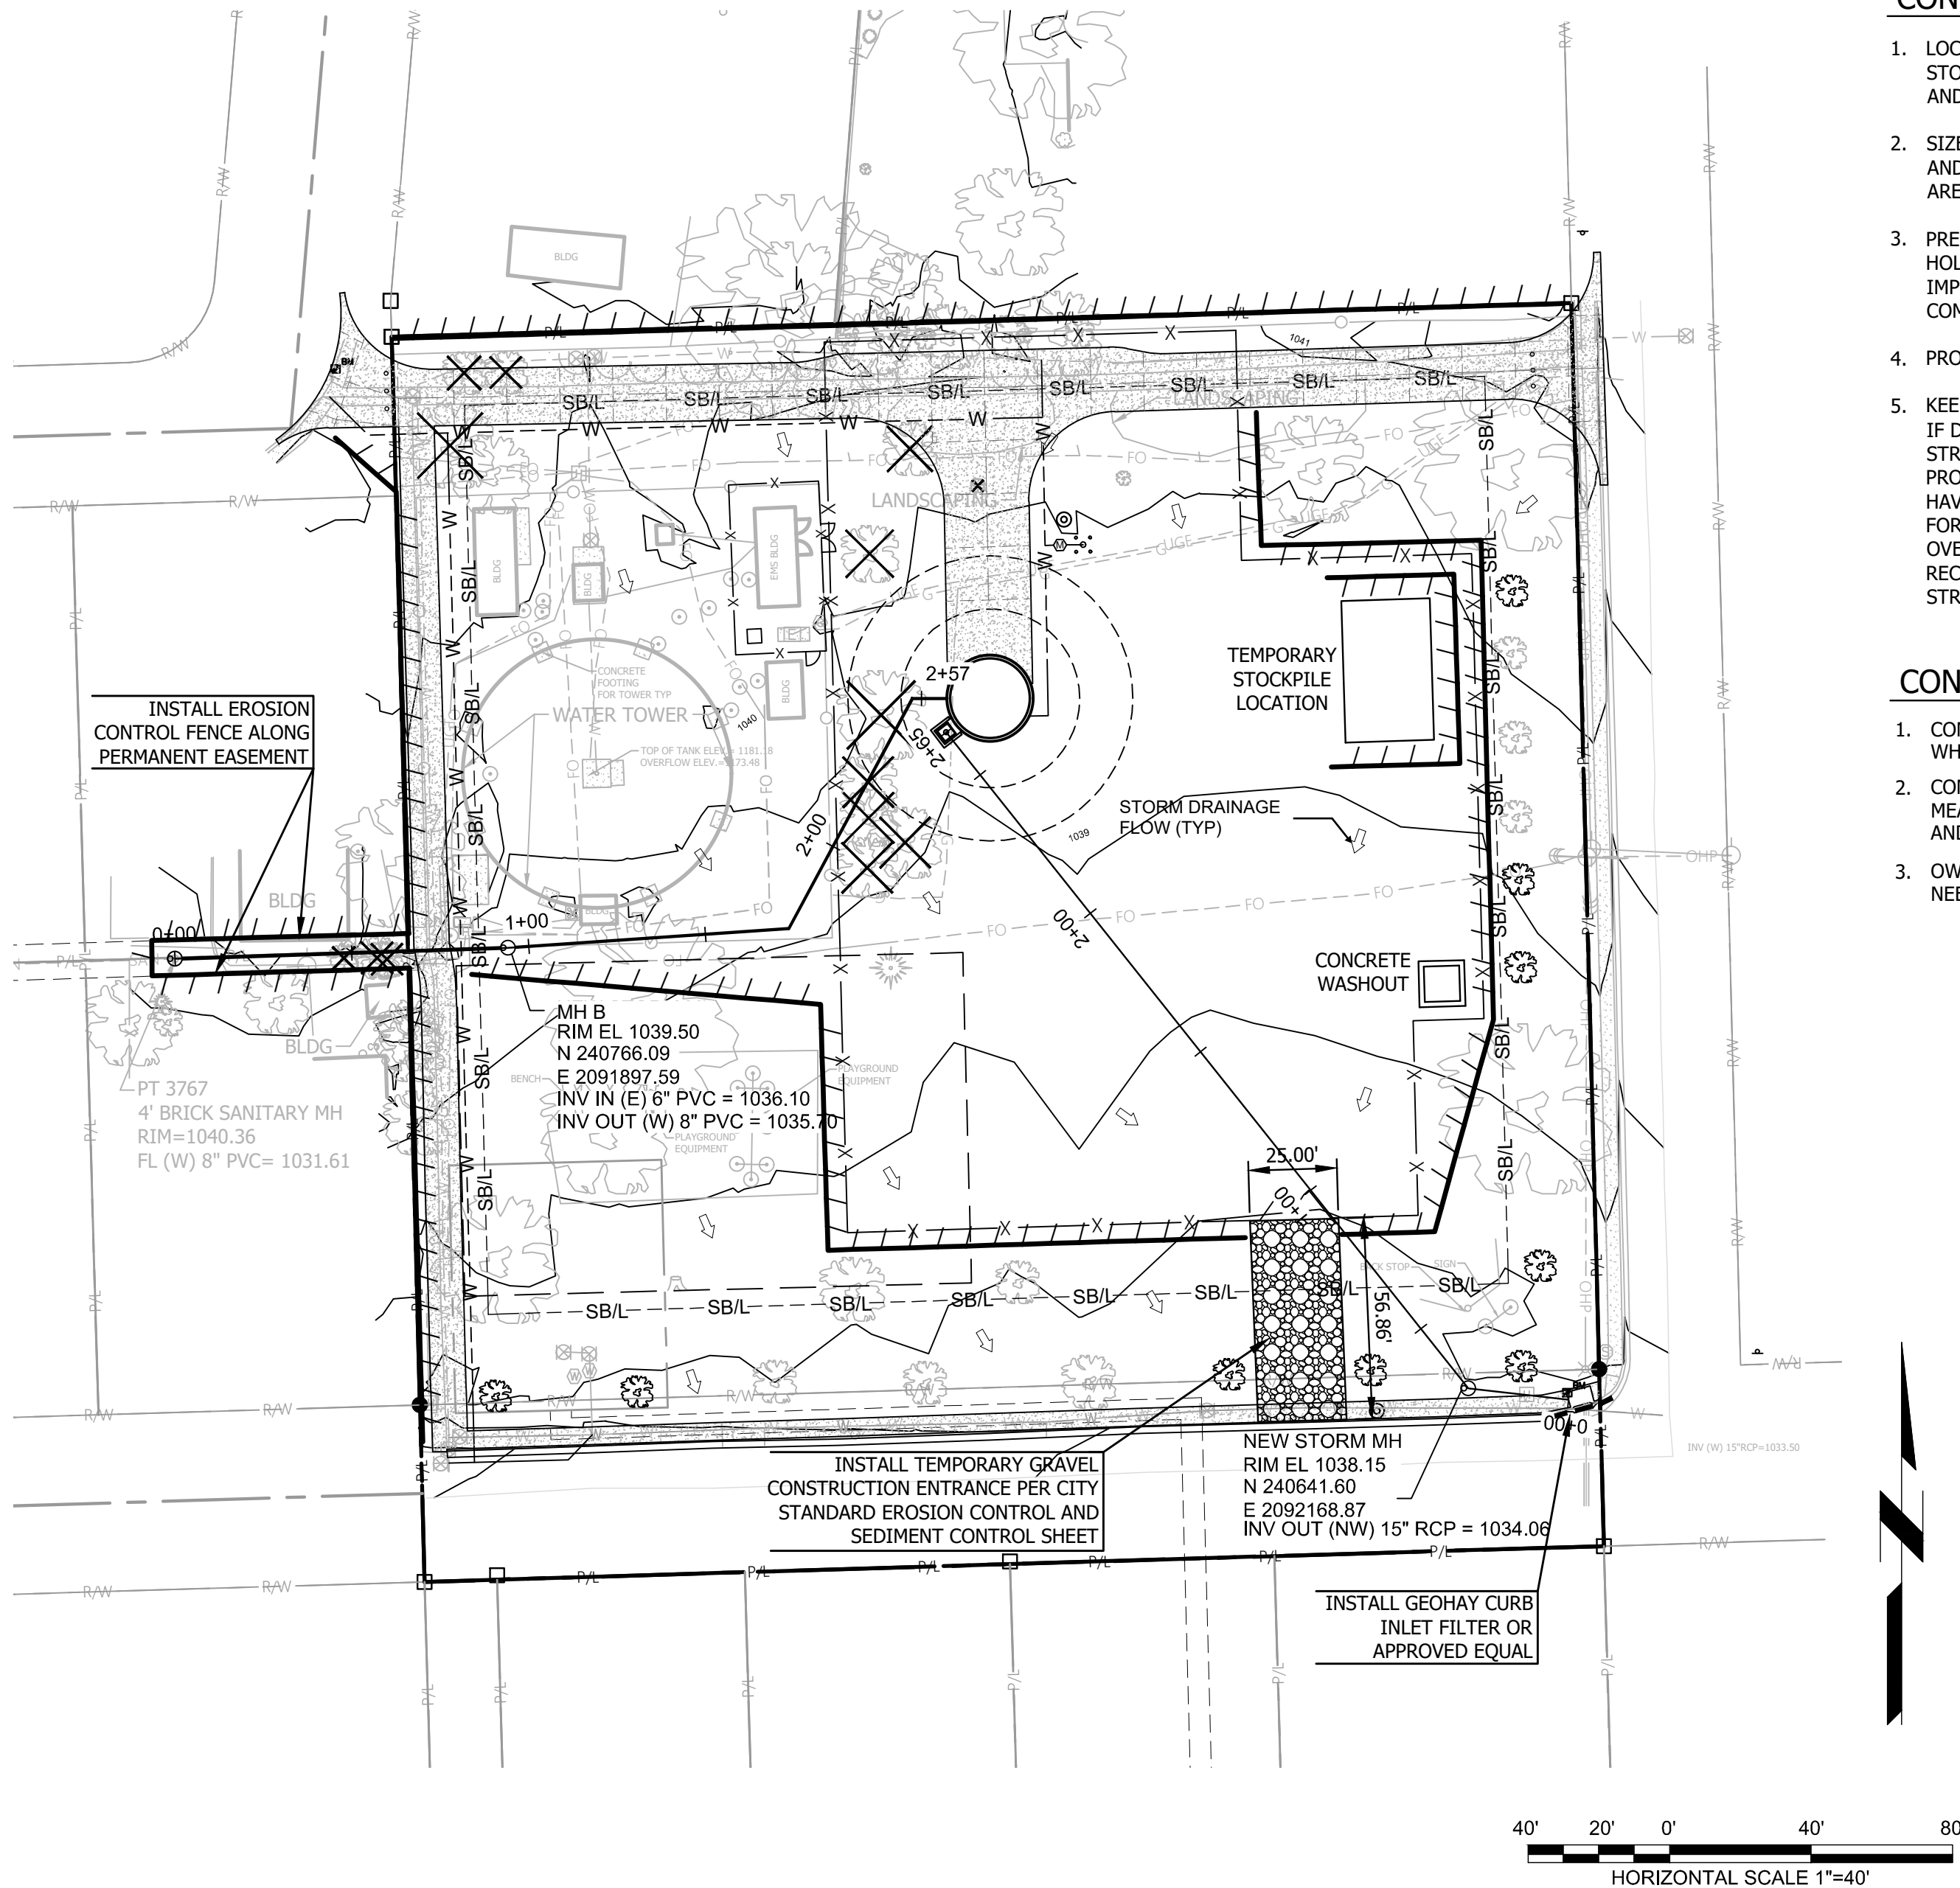

CONSTRUCTION SEQUENCE:

1. PRECONSTRUCTION MEETING
2. CONSTRUCT TEMPORARY GRAVEL CONSTRUCTION ENTRANCES
3. INSTALL PERIMETER SILT FENCING AND STRAW WATTLES
4. PERFORM PAVEMENT AND SITE DEMOLITION
5. CLEAR SITE OF TREES AND STOCKPILE TOPSOIL
6. CONSTRUCT SITE AND ROAD BEDS TO ROUGH GRADES AND EXCAVATE FOR SITE UTILITY INSTALLATION
7. INSTALL TEMPORARY CURB INLET AND AREA INLET SEDIMENT BARRIERS
8. SOD AND STABILIZE ALL OPEN AREAS EXCLUSIVE OF ROADWAYS, SIDEWALK AND PARKING SPACES
9. CONSTRUCT ROADWAYS, SIDEWALKS AND PARKING TO FINAL GRADES
10. SOD, SEED AND STABILIZE ALL REMAINING DISTURBED AREAS
11. REMOVE SILT FENCE, STRAW WATTLES AND INLET PROTECTION

GENERAL NOTES:

1. THE SITE CONTRACTOR SHALL MAINTAIN A CLEAN WORK AREA. TRASH AND WASTE MATERIALS SHALL BE COLLECTED AT A SAFE POINT, AWAY FROM FLAMES OR OTHER FIRE SOURCES. THE SITE CONTRACTOR SHALL PREVENT ANY LEAKS OR DRIPS OF HYDRAULIC FLUID, MOTOR OIL, MOTOR FUELS, SOLVENTS, AND OTHER HYDROCARBONS FROM CONTAMINATING THE GROUND. SUCH SPILLS SHALL BE IMMEDIATELY COVERED WITH AN OIL ABSORBING MEDIUM (E.G. "OIL DRY") AND REMOVED FROM THE SITE IN A LEGAL AND ENVIRONMENTALLY SOUND MANNER. TRASH SHALL BE PROPERLY DISPOSED OF DAILY, UNLESS A COVERED DUMPSTER IS PROVIDED AND ITS LOCATION APPROVED BY THE OWNER'S REPRESENTATIVE.


CONCRETE WASHOUT CONSTRUCTION SPECIFICATIONS:

1. LOCATE WASHOUT STRUCTURE A MINIMUM OF 50 FEET AWAY FROM OPEN CHANNELS, STORM DRAIN INLETS, SENSITIVE AREAS, WETLANDS, BUFFERS AND WATER COURSES AND AWAY FROM CONSTRUCTION TRAFFIC.
2. SIZE WASHOUT STRUCTURE FOR VOLUME NECESSARY TO CONTAIN WASH WATER AND SOLIDS AND MAINTAIN AT LEAST 4 INCHS OF FREEBOARD. TYPICAL DIMENSIONS ARE 10 FEET x 10 FEET x 3 FEET DEEP.
3. PREPARE SOIL BASE FREE OF ROCKS OR OTHER DEBRIS THAT MAY CAUSE TEARS OR HOLES IN THE LINER. FOR LINER, USE 10 MIL OR THICKER UV RESISTANT, IMPERMEABLE SHEETING, FREE OF HOLES AND TEARS OR OTHER DEFECTS THAT COMPROMISE IMPERMEABILITY OF THE MATERIAL.
4. PROVIDE A SIGN FOR THE WASHOUT IN CLOSE PROXIMITY OF THE FACILITY.
5. KEEP CONCRETE WASHOUT STRUCTURE WATER TIGHT. REPLACE IMPERMEABLE LINE IF DAMAGED (E.G., RIPPED OR PUNCTURED). EMPTY OR REPLACE WASHOUT STRUCTURE THAT IS 75 PERCENT FULL AND DISPOSE OF ACCUMULATED MATERIAL PROPERLY. DO NOT REUSE PLASTIC LINER. WET-VACUUM STORED LIQUIDS THAT HAVE NOT EVAPORATED AND DISPOSE OF IN AN APPROVED MANNER. PRIOR TO FORECASTED RAINSTORMS REMOVE LIQUIDS OR COVER STRUCTURE TO PREVENT OVERFLOWS. REMOVE HARDENED SOLIDS, WHOLE OR BROKEN UP, FOR DISPOSAL OR RECYCLING. MAINTAIN RUNOFF DIVERSION AROUND EXCAVATED WASHOUT STRUCTURE UNTIL STRUCTURE IS REMOVED.

CONCRETE WASHOUT NOTES:

1. CONTRACTOR SHALL BE RESPONSIBLE FOR PROVIDING A TEMPORARY COVER OF WHEAT OR OATS AS AN EROSION CONTROL METHOD AS DIRECTED BY THE OWNER.
2. CONTRACTOR SHALL BE RESPONSIBLE FOR MAINTENANCE OF ALL EROSION CONTROL MEASURES, CONTRACTOR SHALL MAINTAIN SLOPE INCLUDING GRADING OF ALL RILLS AND GULLEYS RESULTING FROM EROSION.
3. OWNER RESERVES THE RIGHT TO REQUIRE ADDITIONAL SILT FENCE AS THE NEED ARISES.

EROSION CONTROL LEGEND

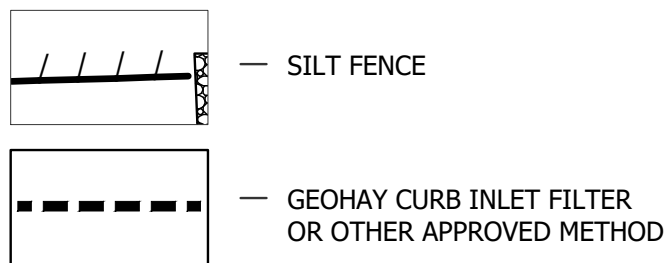

REFER TO CITY OF LAWRENCE STANDARD DETAIL SHEET "EROSION AND SEDIMENT CONTROL" FOR NOTES AND DETAILS PERTAINING TO, BUT NOT LIMITED TO, CONSTRUCTION ENTRANCE, SILT FENCE AND INLET PROTECTION

EROSION CONTROL GENERAL NOTES:

1. THE CONTRACTOR SHALL KEEP A WRITTEN LOG OF WHEN CONSTRUCTION ACTIVITIES BEGIN, EROSION AND SEDIMENT CONTROLS ARE INSTALLED, INSPECTED AND REPAIRED. COPIES OF LOG SHALL BE FURNISHED TO THE PROJECT ENGINEER AND SUBMIT A COPY TO CITY ENGINEER.
2. THE CONTRACTOR SHALL MONITOR EROSION AND SEDIMENT CONTROL MEASURES THROUGHOUT THE PROJECT. THIS PLAN MAY BE UPDATED AS CONSTRUCTION PROGRESSES WITH APPROVAL OF ENGINEER.
3. THE CONTRACTOR SHALL COMPLY WITH THE SOIL EROSION CODE FOR THE CITY OF LAWRENCE, KS.
4. TEMPORARY EROSION AND SEDIMENT CONTROL MEASURES INSTALLED AS PART OF THIS PLAN SHALL NOT BE REMOVED FOLLOWING CONSTRUCTION UNTIL SLOPES ARE STABILIZED TO A NON-EROSIVE STATE WITH ESTABLISHED GRASS.
5. IMMEDIATELY AFTER MOBILIZATION AND PRIOR TO STARTING ANY SOIL DISTURBING ACTIVITIES, THE CONTRACTOR SHALL INSTALL ANY PERIMETER EROSION AND SEDIMENT CONTROL MEASURES IN LOCATIONS SHOWN, GRAVEL CONSTRUCTION ENTRANCE AND ANY TEMPORARY SEDIMENT BASIN. IT IS RECOGNIZED THAT SOME SITE CLEARING AND PREPARATION MAY BY REQUIRED TO PROPERLY INSTALL SUCH MEASURES. EROSION & SEDIMENT CONTROL REQUIREMENTS SHALL BE FOLLOWED PER CHAPTER IX ARTICLE 9 OF THE CITY OF LAWRENCE CITY CODE.
6. PERIMETER SILT FENCE, DITCH CHECKS AND CONSTRUCTION ENTRANCE SHALL BE CONSTRUCTED IN ACCORDANCE WITH THESE PLANS AND CITY OF LAWRENCE STANDARDS. INSTALL SILT FENCE WHERE REPRESENTED ON PLAN AS DITCH CHECKS AND SLOPE CONTROL, ALONG ROADWAYS, AREAS DRAINING TO DRAINAGE WAYS SUCH AS A STREAM AND OTHER LOCATIONS AS NEEDED TO PREVENT SEDIMENT FROM LEAVING THE SITE. MEASURES WILL BE KEPT IN PLACE UNTIL FULL GRASS COVER IS ESTABLISHED.
7. ALL EROSION CONTROL MEASURES SHALL BE INSPECTED AND MAINTAINED BY THE CONTRACTOR NOT LESS THAN WEEKLY OR WITHIN 24 HOURS AFTER A RAINFALL EVENT OF 0.5 INCHES OR MORE. MAINTENANCE SHALL INCLUDE BUT NOT LIMITED TO SEDIMENT REMOVAL, SILT FENCE BARRIER REPAIR AND/OR REPLACEMENT.
8. CONSTRUCTION ENTRANCES SHALL BE MAINTAINED BY THE CONTRACTOR IN A CONDITION THAT WILL PREVENT TRACKING OR FLOWING OF SEDIMENT ONTO PUBLIC RIGHT-OF-WAYS AND PAVED STREETS. THIS MAY INCLUDE PERIODIC TOP DRESSING WITH ADDITIONAL CRUSHED STONE AS CONDITIONS WARRANT. REPAIR OF ENTRANCES, CLEANING ON A DAILY BASIS OF RIGHT-OF-WAYS AND PAVED STREETS THAT HAVE BEEN SOILED BY CONSTRUCTION ACTIVITIES SHALL BE THE GENERAL CONTRACTOR'S RESPONSIBILITY. A SHAKER RACK MAY BE REQUIRED IF ROCK PAD IS NOT TOP DRESSED AND CONSISTENTLY MAINTAINED.
9. THE CONTRACTOR SHALL NOTIFY EACH SUB-CONTRACTOR OR ENTITY (INCLUDING UTILITY CREWS AND CITY EMPLOYEES OR THEIR AGENTS) THAT WILL BE PERFORMING WORK AT THE SITE OF THE EROSION CONTROL PLAN AND WHAT ACTIONS OR PRECAUTIONS SHALL BE TAKEN TO MINIMIZE THE POTENTIAL FOR SOIL EROSION.
10. DURING ALL SOIL DISTURBING ACTIVITIES, THE CONTRACTOR WILL TAKE APPROPRIATE STEPS USING ACCEPTED CONSTRUCTION METHODS TO MINIMIZE THE TIME OF EXPOSURE OF UNPROTECTED SOIL AND OTHER CONSTRUCTION MATERIALS TO RAINFALL.
11. NO GROUND SHALL BE LEFT OPEN FOR MORE THAN 7 DAYS OF NON-ACTIVITY WITHOUT BEING MULCHED OR SIMILAR EFFECTIVE SOIL STABILIZATION BMP SUCH AS SEED WITH MULCH OR PLACING SOD.
12. SOIL STOCKPILED FOR MORE THAN 7 DAYS SHALL HAVE SILT FENCE OR BALES PLACED ON THE DOWNHILL SLOPES TO TRAP SEDIMENT.
13. WHENEVER SOIL, ROCK, VEGETATION OR OTHER MATERIALS ARE EXPORTED FOR PLACEMENT IN AREAS OFF OF THE CONSTRUCTION SITE COVERED IN THIS PLAN, THE CONTRACTOR IS RESPONSIBLE FOR DETERMINING THAT EPA STORM WATER PERMITTING REQUIREMENTS ARE MET. PRIOR TO THE REMOVAL OF ANY MATERIALS FROM THE SITE THE CONTRACTOR WILL FURNISH THE ENGINEER WITH WRITTEN AGREEMENT, SIGNED BY EACH LANDOWNER WHO WILL RECEIVE EXPORTED MATERIALS, STATING THAT THEY ACCEPT THE MATERIAL AND THAT RECEIVING SITE IS PROPERLY PERMITTED, WHEN REQUIRED.
14. NOI LAND DISTURBANCE PERMIT WILL BE PREPARED AND SUBMITTED BY ENGINEER AND SUPPLIED TO CONTRACTOR UPON APPROVAL.

PRE-CLEARING CONSTRUCTION SEQUENCE:

1. CONSTRUCT CONSTRUCTION ENTRANCE.
2. ALL STRUCTURAL BMP'S MUST BE IN PLACE BEFORE GENERAL CLEARING AND DEMOLITION OPERATIONS BEGIN. CLEARING NECESSARY TO PLACE STRUCTURAL BMP'S SHALL BE THE MINIMUM REQUIRED FOR INSTALLATION. COORDINATE CLEARING NECESSARY TO PLACE STRUCTURAL BMP'S WITH LOCAL WEATHER FORECAST SO THAT CLEARING AND PLACEMENT MAY BE COMPLETED WITHIN A FORECAST DRY PERIOD.
3. CLEAR SITE AND COMPLETE ROUGH GRADING.
4. PLAN MODIFICATION: THE CONTRACTOR MUST MODIFY THE PLAN IF THE PLAN FAILS TO SUBSTANTIALLY CONTROL EROSION AND OFFSITE SEDIMENTATION. PLAN MODIFICATIONS DUE TO INEFFECTIVENESS MAY BE TAKEN WITHOUT PRIOR APPROVAL OF THE REVIEW AGENCY, BUT MUST BE FULLY DOCUMENTED AND APPROVAL SECURED FROM THE PERMITTING AUTHORITY AS SOON AS PRACTICABLE. THE CONTRACTOR MAY MODIFY THE PLAN OR CONSTRUCTION SEQUENCE IF IMPLEMENTATION IS INFEASIBLE FOR SITE CONDITIONS OR CONTRACTOR METHODS. ANY SUCH MODIFICATION SHALL CONTROL EROSION AND OFFSITE SEDIMENTATION TO THE MAXIMUM EXTENT PRACTICABLE. ANY SUCH MODIFICATION SHALL REQUIRE THE PRIOR APPROVAL OF THE PERMITTING AUTHORITY.




INTERIM PHASING CONSTRUCTION SEQUENCE:

1. CLEAR SITE AND COMPLETE GRADING.
2. DEFINE CONCRETE WASHOUT AND TOPSOIL STOCKPILE LOCATIONS, INSTALL ASSOCIATED SILT FENCING.

3. PLAN MODIFICATION: THE CONTRACTOR MUST MODIFY THE PLAN IF THE PLAN FAILS TO SUBSTANTIALLY CONTROL EROSION AND OFFSITE SEDIMENTATION. PLAN MODIFICATIONS DUE TO INEFFECTIVENESS MAY BE TAKEN WITHOUT PRIOR APPROVAL OF THE REVIEW AGENCY, BUT MUST BE FULLY DOCUMENTED AND APPROVAL SECURED FROM THE PERMITTING AUTHORITY AS SOON AS PRACTICABLE. THE CONTRACTOR MAY MODIFY THE PLAN OR CONSTRUCTION SEQUENCE IF IMPLEMENTATION IS INFEASIBLE FOR SITE CONDITIONS OR CONTRACTOR METHODS. ANY SUCH MODIFICATION SHALL CONTROL EROSION AND OFFSITE SEDIMENTATION TO THE MAXIMUM EXTENT PRACTICABLE. ANY SUCH MODIFICATION SHALL REQUIRE THE PRIOR APPROVAL OF THE PERMITTING AUTHORITY.

FINAL RESTORATION PLAN CONSTRUCTION SEQUENCE:

1. REMOVE ANY BMP'S THAT WERE CONSTRUCTED WITH THE PRE-CLEARING PLAN THAT ARE NOT SHOWN ON THIS SHEET.
2. IMPLEMENT FINAL STABILIZATION: COORDINATE REMOVAL OF CONSTRUCTION PHASE BMPS NECESSARY TO PLACE FINAL STABILIZATION WITH LOCAL WEATHER FORECAST SO THAT REMOVAL AND PLACEMENT MAY BE COMPLETED WITHIN A FORECAST DRY PERIOD. DOWN-SLOPE PERIMETER CONTROLS SHALL NOT BE REMOVED UNTIL FINAL STABILIZATION IS PLACED AND VEGETATIVE COVER IS ESTABLISHED OVER THE REMAINDER OF THE SITE.
3. ESTABLISHMENT AND FINAL CONSTRUCTION: ONCE THE REMAINDER OF THE SITE IS STABILIZED INCLUDING ESTABLISHMENT OF SEEDDED COVER TYPES, CONSTRUCT PERMANENT WATER QUALITY BMPS AND REMOVE THE SEDIMENT CONTROLS AND THE REMAINING ACCESS CONTROLS. RESTORE AREA DISTURBED BY REMOVAL OF SEDIMENT CONTROLS.
4. PLAN MODIFICATION: THE CONTRACTOR MUST MODIFY THE PLAN IF THE PLAN FAILS TO SUBSTANTIALLY CONTROL EROSION AND OFFSITE SEDIMENTATION. THE CONTRACTOR MAY MODIFY THE PLAN OR CONSTRUCTION SEQUENCE IF IMPLEMENTATION IS INFEASIBLE FOR SITE CONDITIONS OR CONTRACTOR METHODS. ANY SUCH MODIFICATION SHALL CONTROL EROSION AND OFFSITE SEDIMENTATION TO THE MAXIMUM EXTENT PRACTICABLE. PLAN MODIFICATIONS DUE TO INEFFECTIVENESS MAY BE TAKEN WITHOUT PRIOR APPROVAL OF THE REVIEW AGENCY, BUT MUST BE FULLY DOCUMENTED AND APPROVAL SECURED FROM THE PERMITTING AUTHORITY AS SOON AS PRACTICABLE. THE DOCUMENTATION LOG IS TO INCLUDE THE DATE AND A BRIEF DESCRIPTION OF THE CHANGE AND THE NAME & TITLE OF THE PERSON WHO AUTHORIZES THE CHANGE, PER PART 7.3.1 OF THE NOI PERMIT.
5. CONTRACTOR SHALL REPLACE DISTURBED AREAS WITH SEED OR SOD, AS INDICATED ON THE PLAN WITHIN 14 DAYS AFTER PAVING COMPLETION AND FINAL TOPSOIL GRADING. REFER TO LANDSCAPE PLAN FOR TOPSOIL SPECIFICATIONS.
6. THE RETENTION OF ACCESS CONTROLS AND SEDIMENT CONTROLS UNTIL VEGETATIVE DENSITY OF AT LEAST 70% IS ESTABLISHED COMPARED TO OFFSITE UNDISTURBED VEGETATIVE COVER

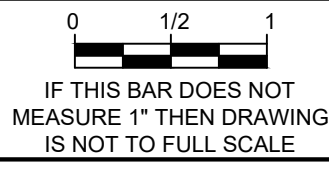NO. BY CHK APP	
REVISIONS AND RECORD OF USE	
DATE	
	
 BLACK & VEATCH Black & Veatch Corporation Kansas City, Missouri	
LAWRENCE, KANSAS - UT1984 STRATFORD WATER TOWER REPLACEMENT	
CIVIL EROSION CONTROL PLAN	
DESIGNED: JAC DETAILED: RLW CHECKED: CBC APPROVED: AJH DATE: 12/16/2021	
	
PROJECT NO. 402979	
C-10-103 SHEET 15 OF 35	







1. 30"x30" COMBINATION INTAKE LOUVER/DAMPER RUSKIN MODEL "ELC6375DAX" WITH BIRDSCREEN AND MANUFACTURER STANDARD COATING AND FINISH. DAMPER MOTOR TO BE INTERLOCKED WITH PROPELLER FAN (PF-1) TO OPEN WHEN FAN IS ENERGIZED. BOT EL APPROX 4'-0" AFF. REFER TO DETAIL E ON DWG C-10-502. DAMPER OPERATOR SHALL BE BELIMO "NFBUP-S".
2. 24"x24" COMBINATION EXHAUST LOUVER/DAMPER RUSKIN MODEL "ELC6375DAX". DAMPER MOTOR TO BE INTERLOCKED WITH PROPELLER FAN (PF-1) TO OPEN WHEN FAN IS ENERGIZED. BOT EL APPROX 8'-0" AFF. REFER TO DETAIL E ON DWG C-10-502. DAMPER OPERATOR SHALL BE BELIMO "NFBUP-S".
3. CAPPED CONDUIT TERMINALS FOR FUTURE CONNECTION.
4. PROVIDE 2" FUNNEL RECEPTOR FOR INSTRUMENTATION DRAIN. FIELD VERIFY LOCATION, FUNNEL RECEPTOR TO BE SMITH FIGURE NUMBER SQ-3-1793 WITH DOME BOTTOM STRAINER.

Black & Veatch Corporation
Kansas City, Missouri

CIVIL/STRUCTURAL
ENLARGED TANK PLAN

C-10-105
SHEET
15 OF 49

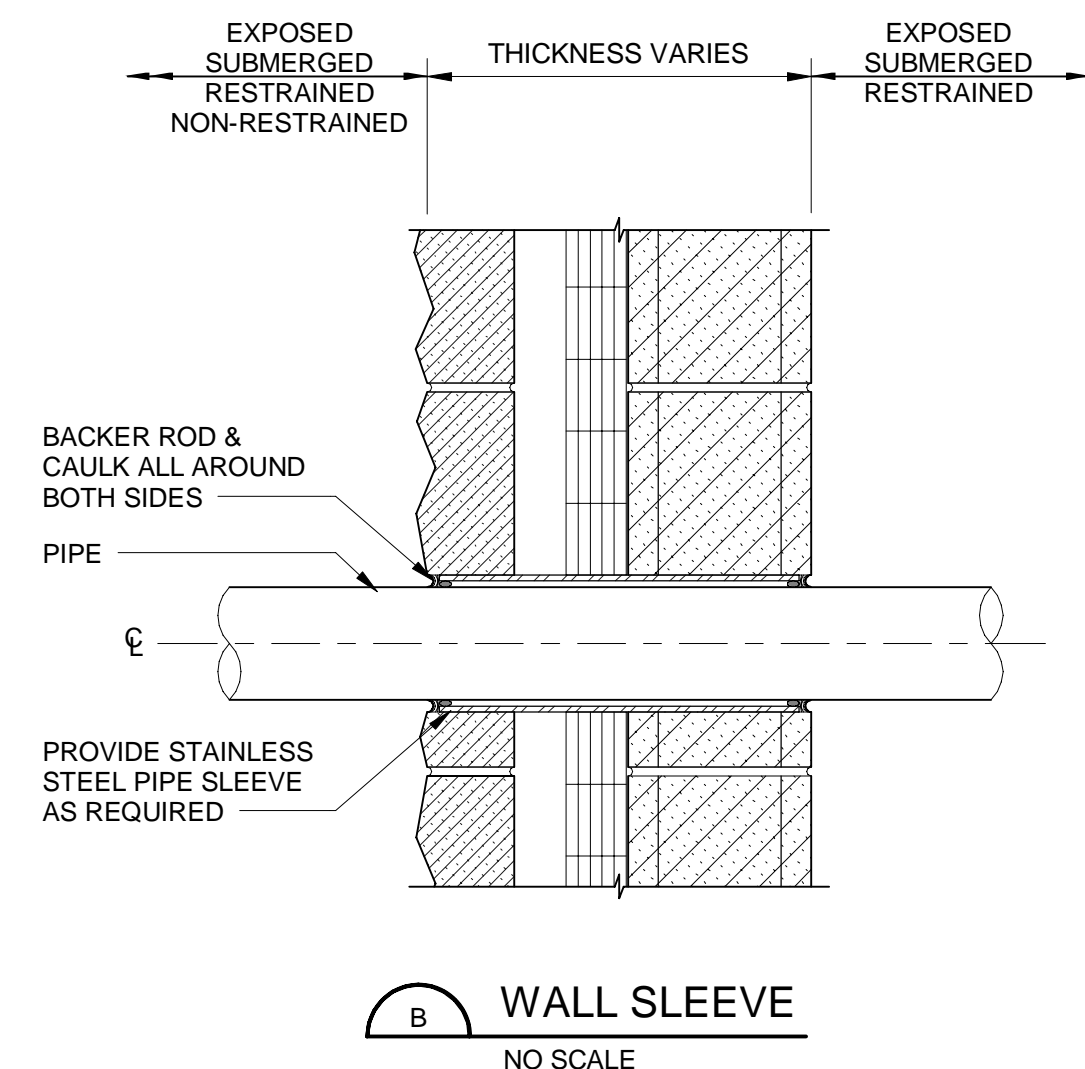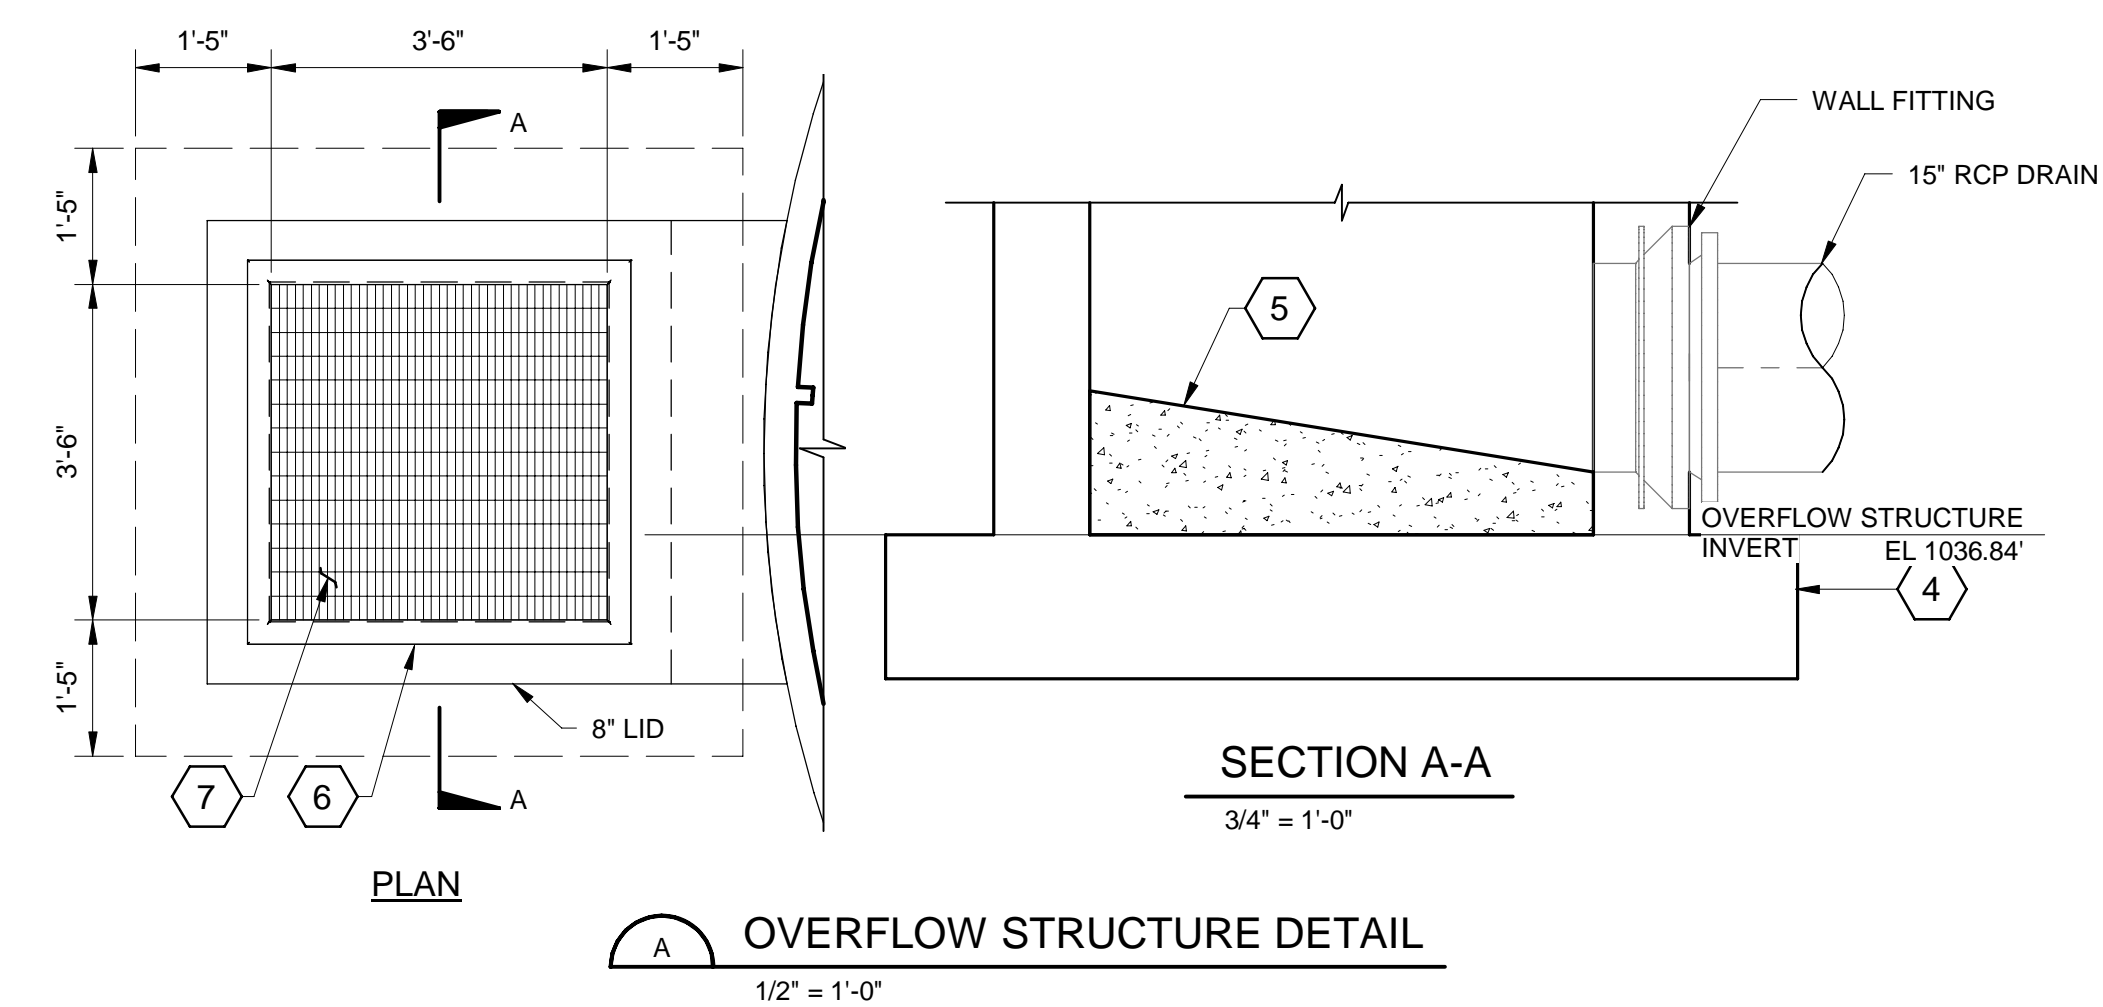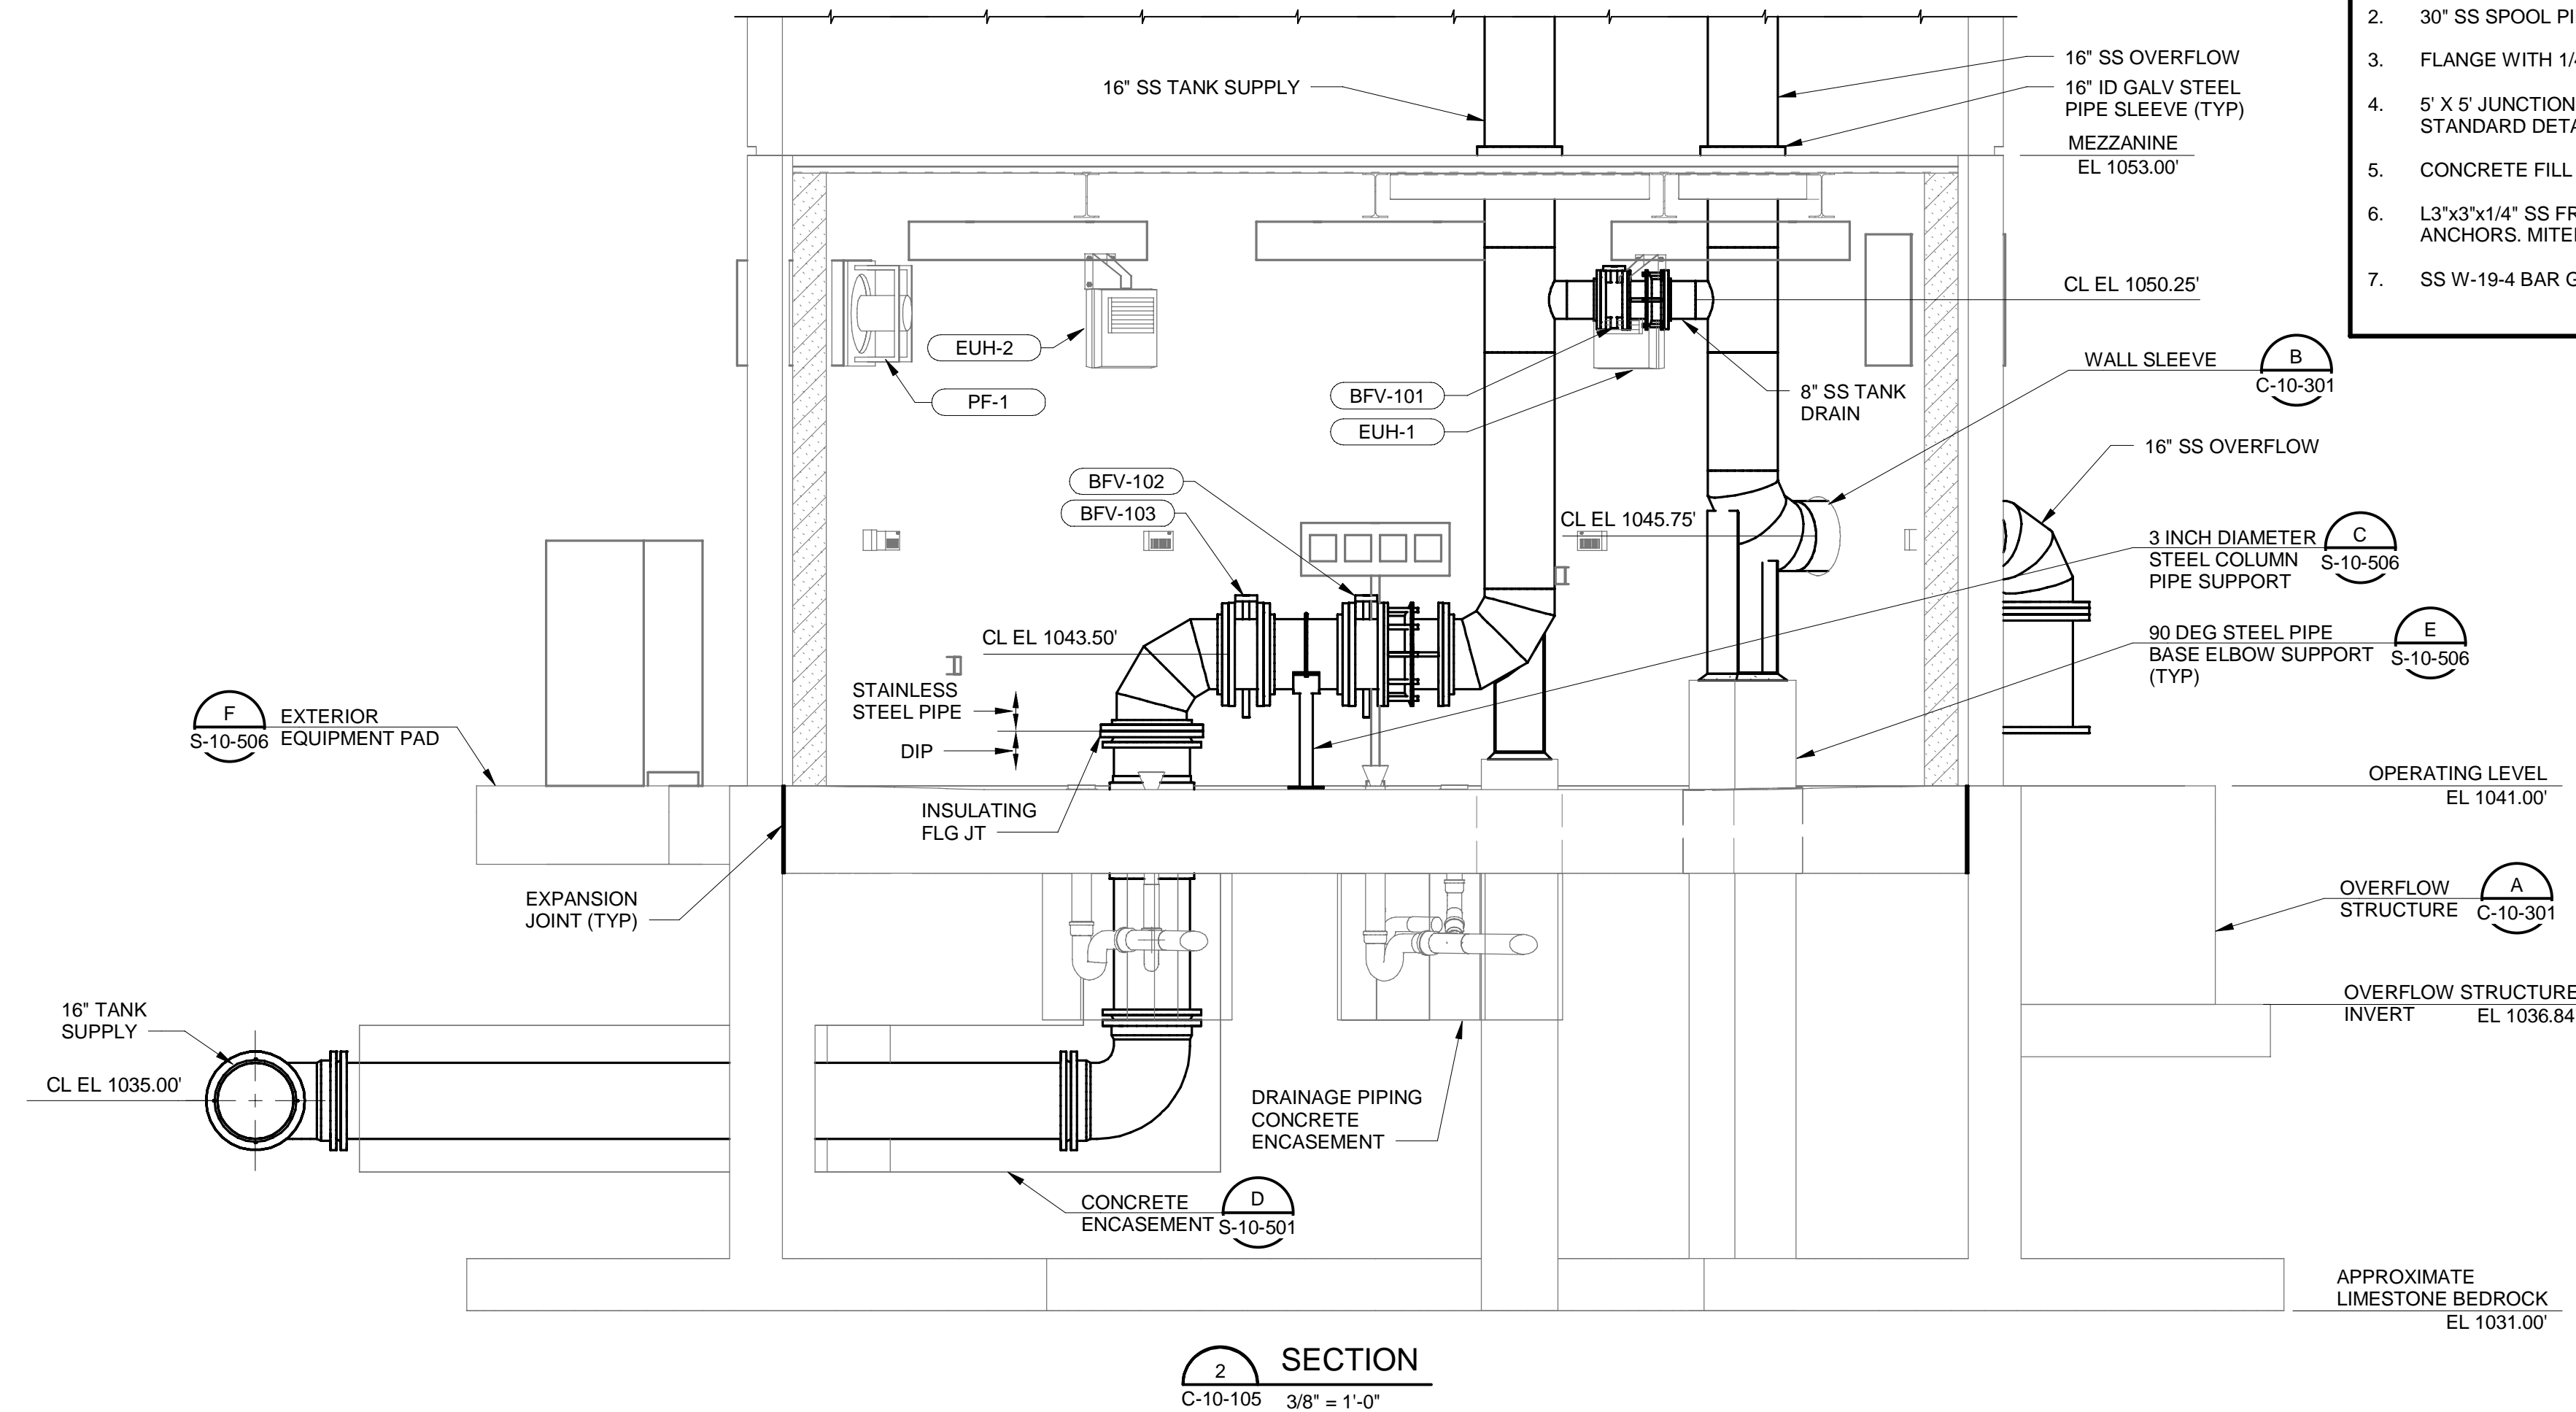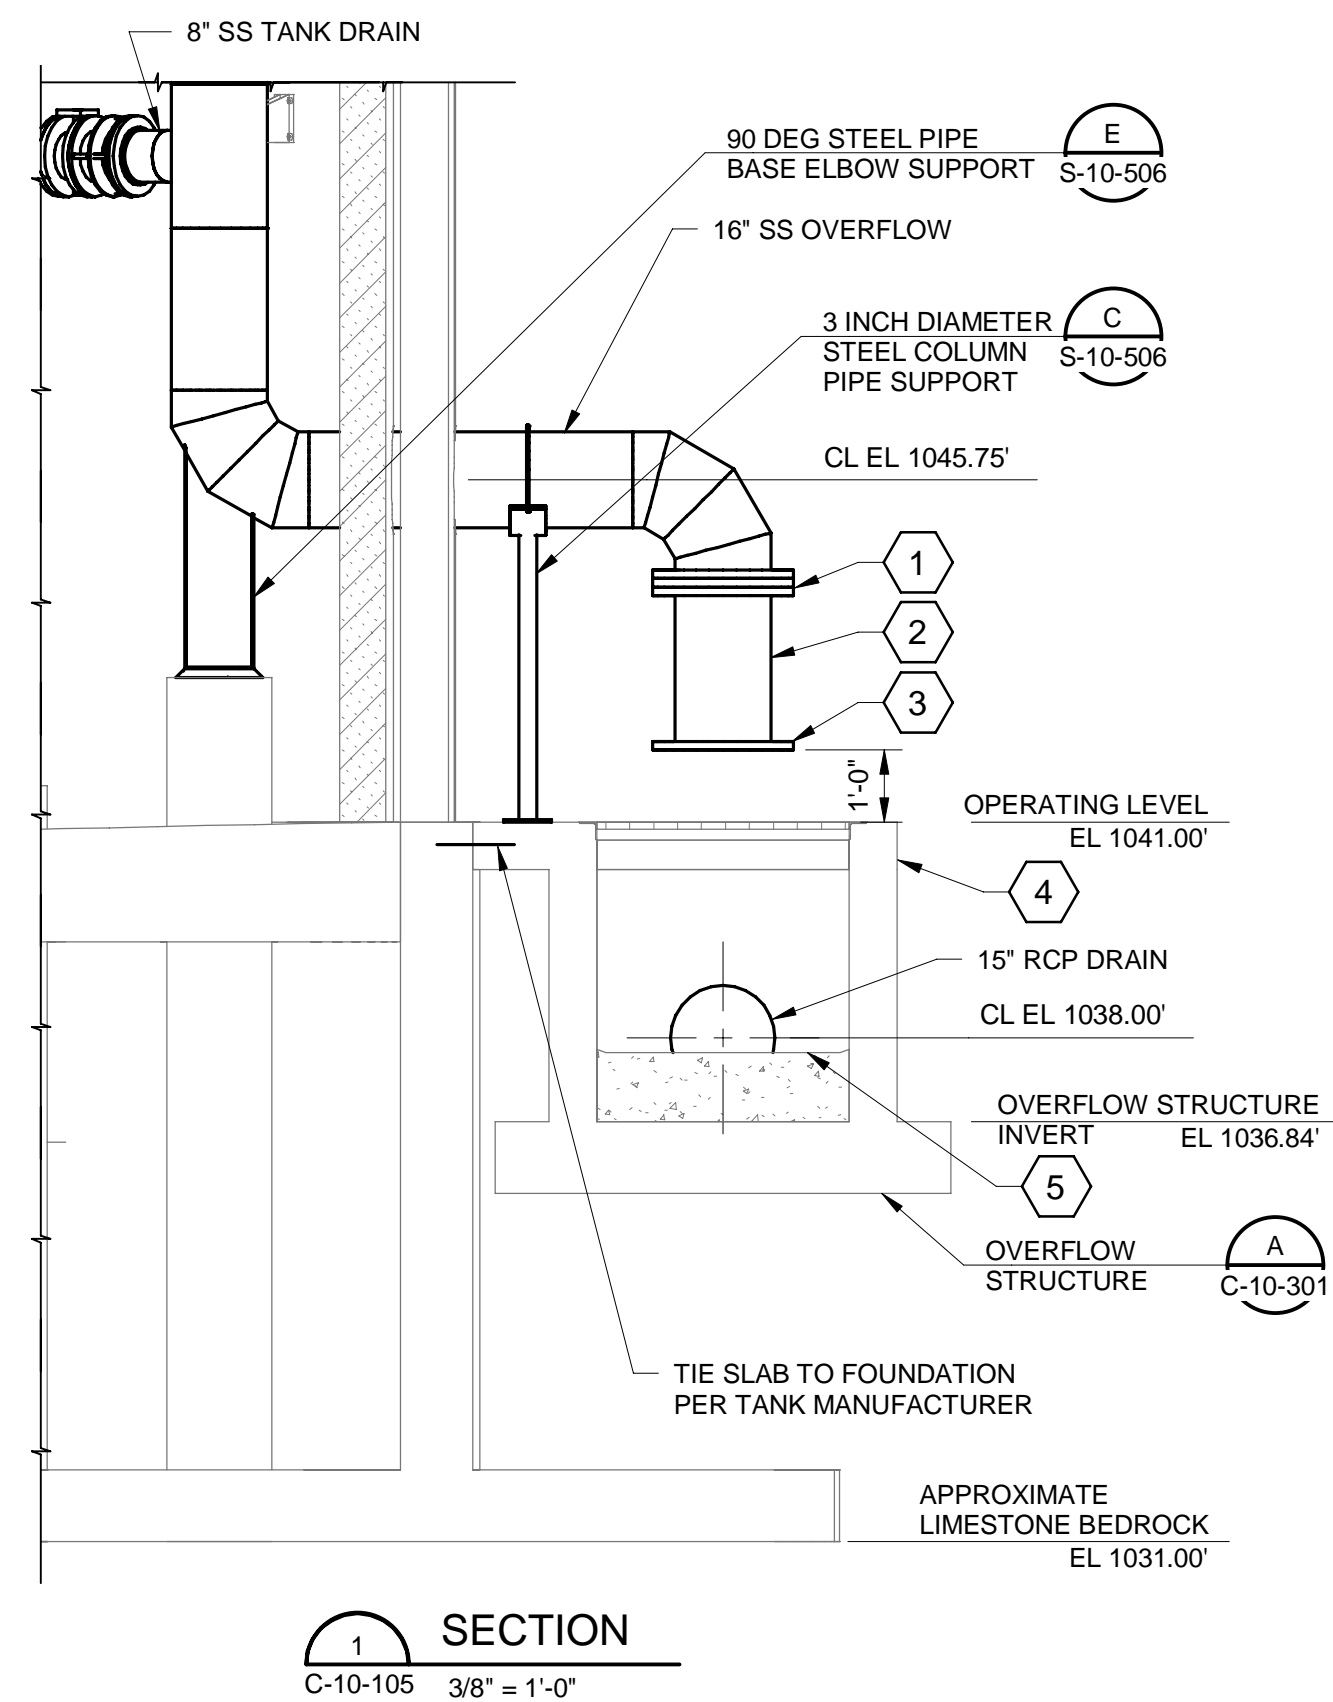

- SHEET KEYNOTES

1. 16" TIDEFLEX SERIES 37 INTERIOR CHECK VALVE, OR APPROVED EQUAL (NSF 61 PRODUCT CERTIFIED)
2. 30" SS SPOOL PIECE
3. FLANGE WITH 1/4-INCH SS SCREEN
4. 5' X 5' JUNCTION BOX. REFER TO CITY OF LAWRENCE STANDARD DETAILS.
5. CONCRETE FILL SLOPED TO DRAIN
6. L3"x3"x1/4" SS FRAME. ANCHOR TO CONCRETE WITH 4-5/8" SS ANCHORS. BITER AND WELD CORNERS.
7. SS W-19-4 BAR GRATING WELDED TO ANGLE FRAME




BLACK & VEATCH
Black & Veatch Corporation
Kansas City, Missouri

LAWRENCE, KANSAS - UI1984
STRATFORD WATER TOWER REPLACEMENT


CIVIL/STRUCTURAL TANK SECTIONS & DETAILS

DESIGNED: SNN
ETAILED: STK
CHECKED: JJW
APPROVED: AJH
DATE: 12/16/2021




PROJECT NO.
402979


C-10-301
SHEET
16 OF 49

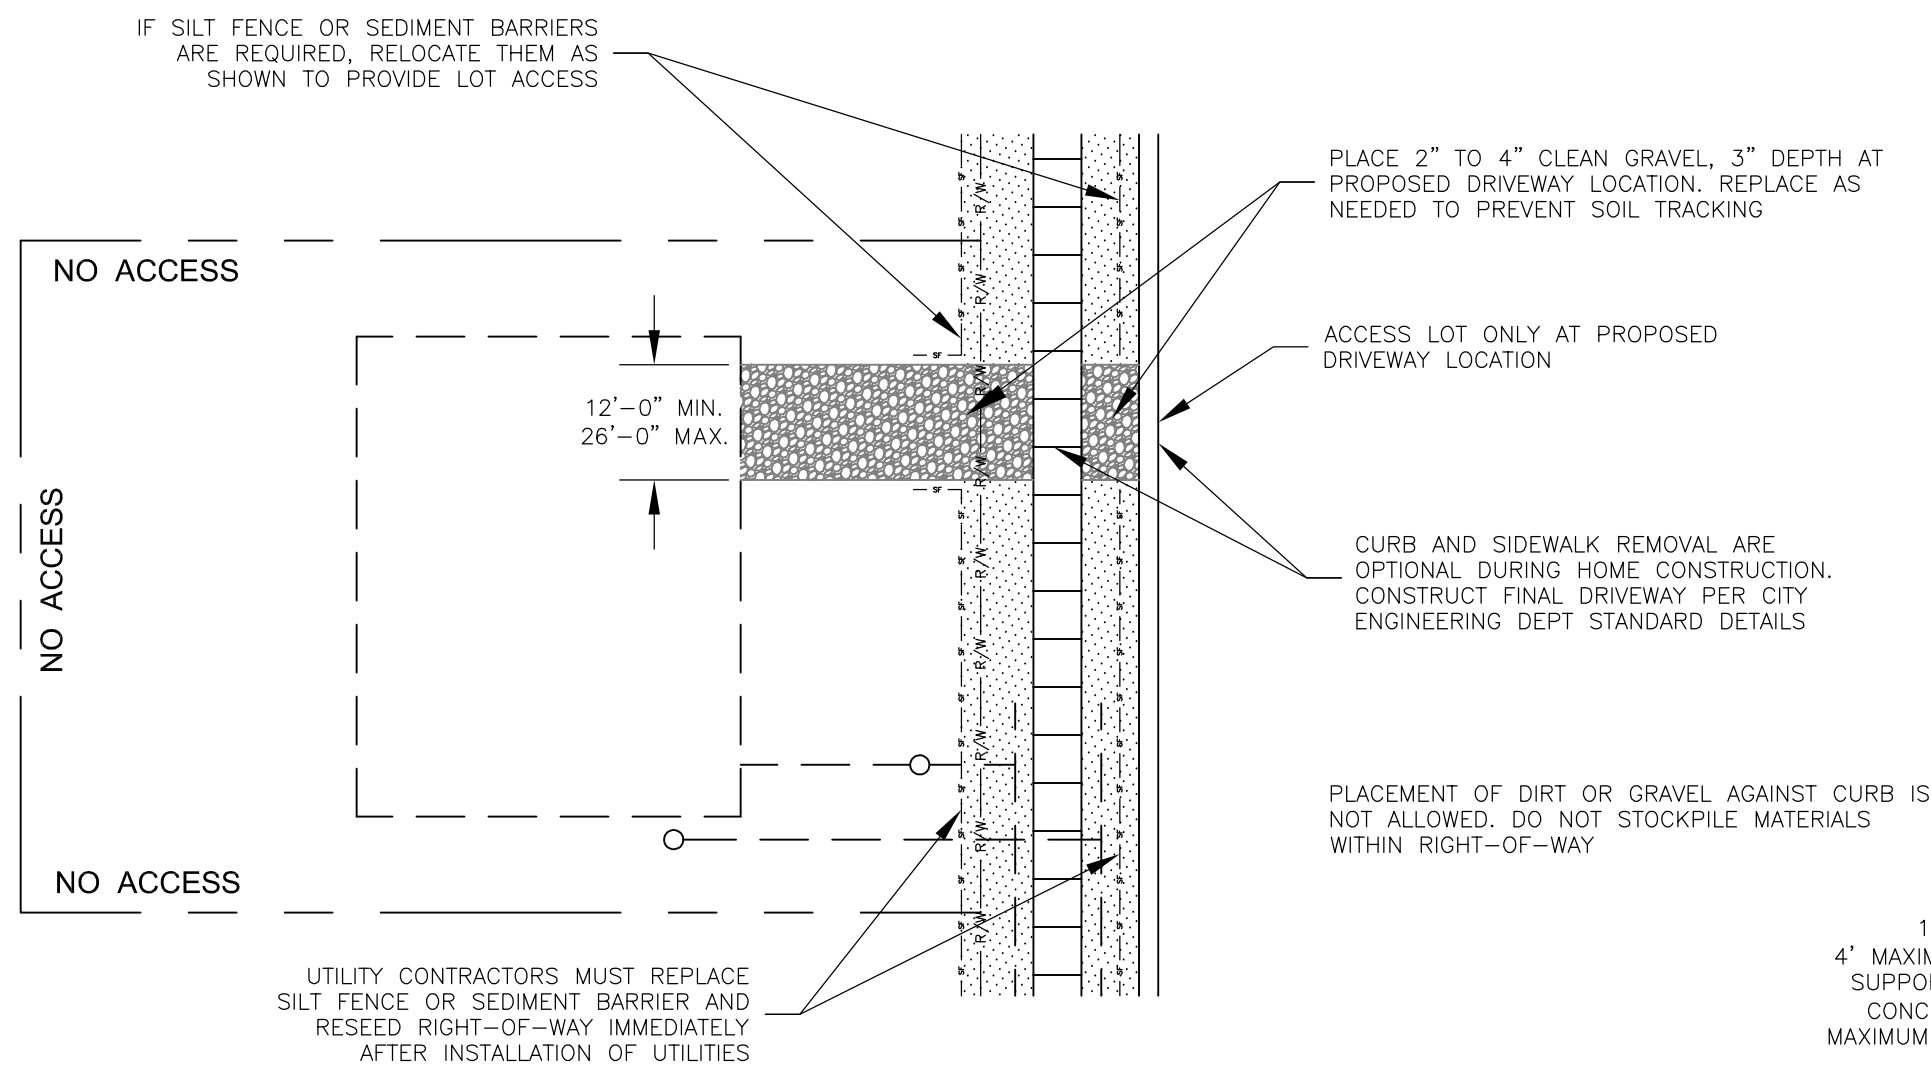


LOT ACCESS DETAIL
APPLIES TO ALL RESIDENTIAL LOTS

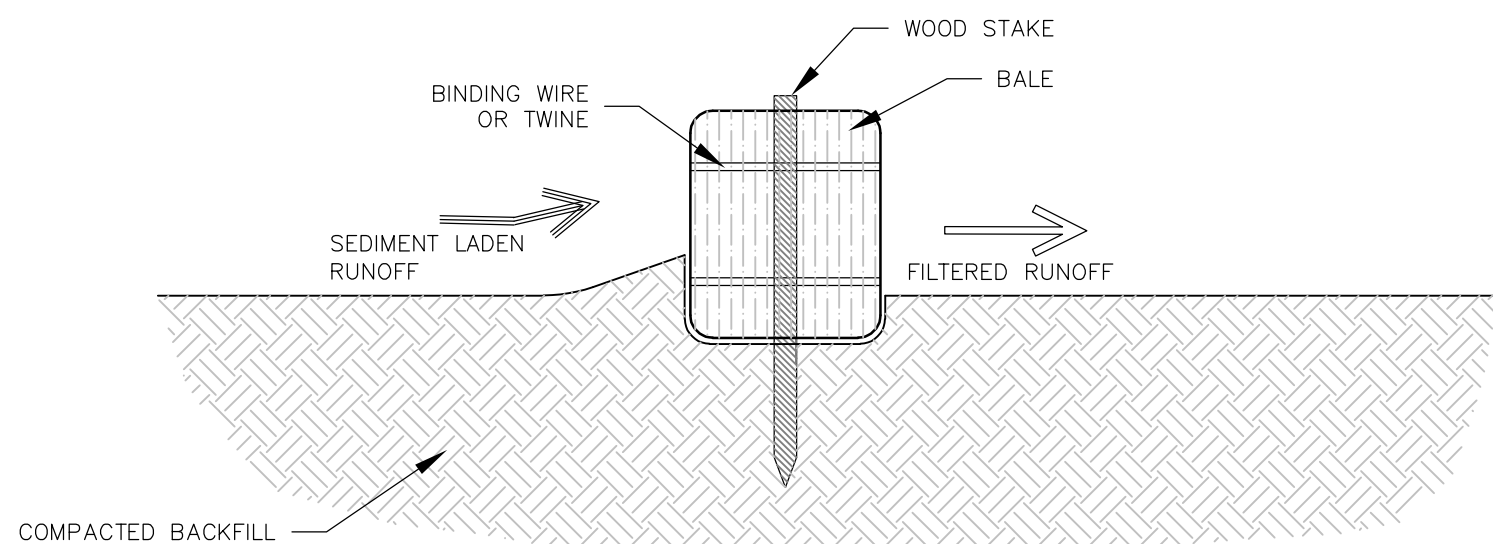


INSTALLATION OF BALE DITCH CHECKS
NO SCALE

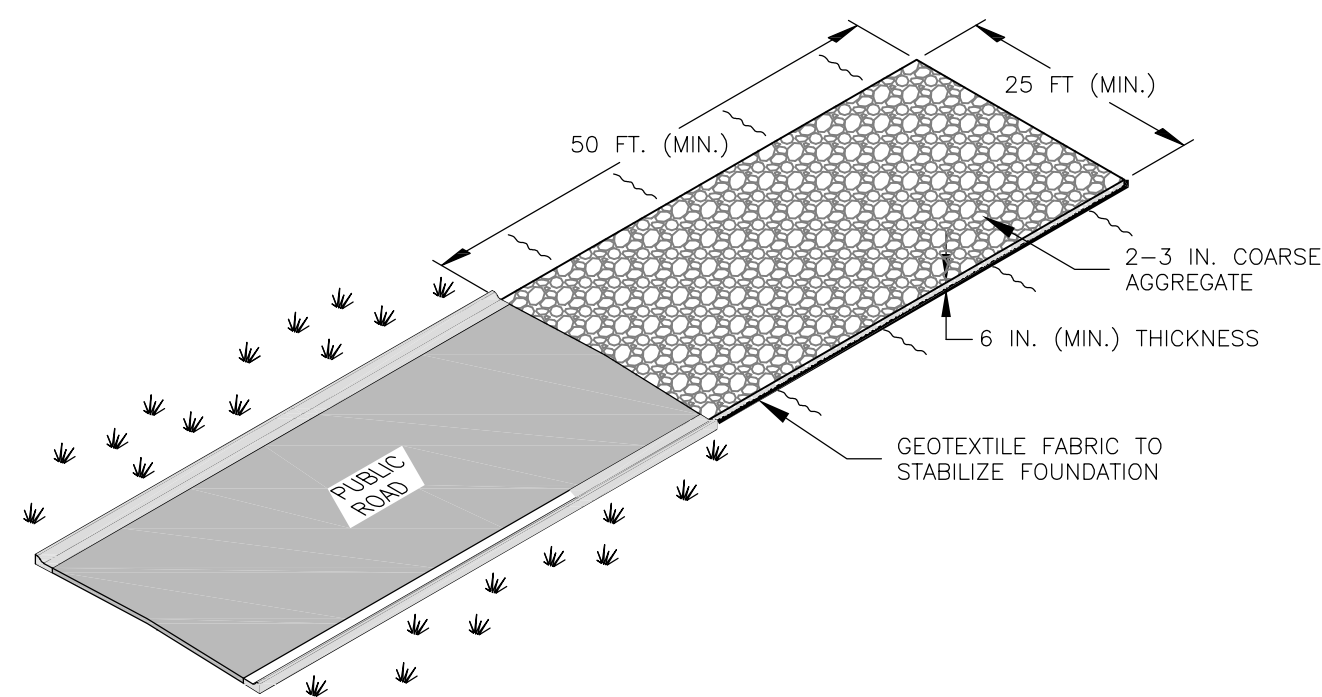


TEMPORARY GRAVEL CONSTRUCTION ENTRANCE PAD
NO SCALE

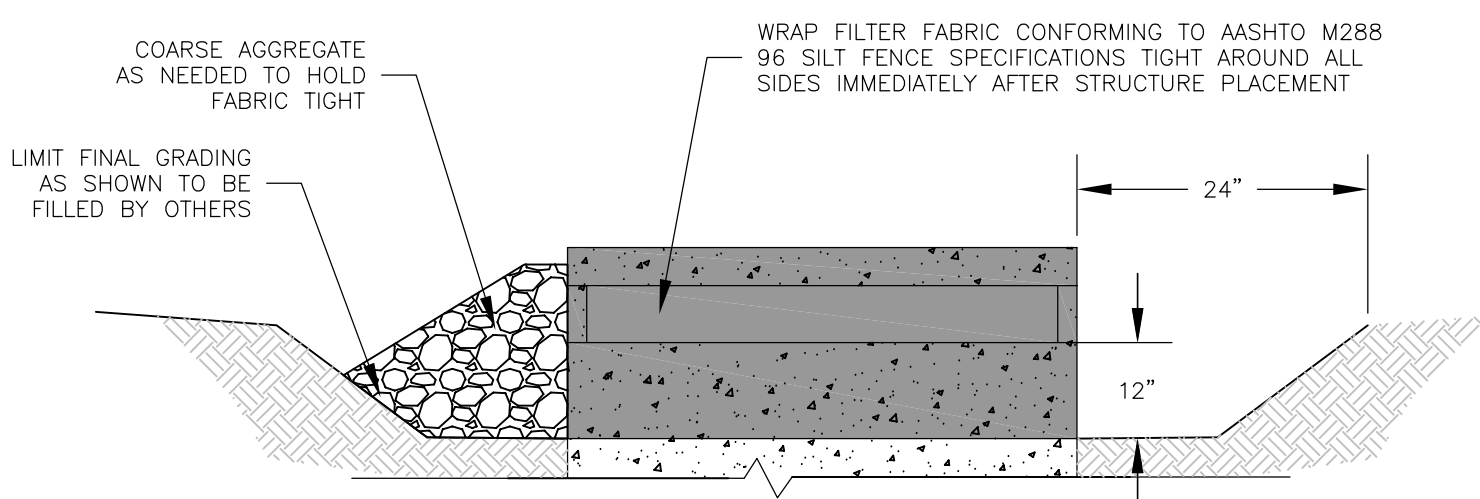


AREA INLET SEDIMENT BARRIER
NO SCALE

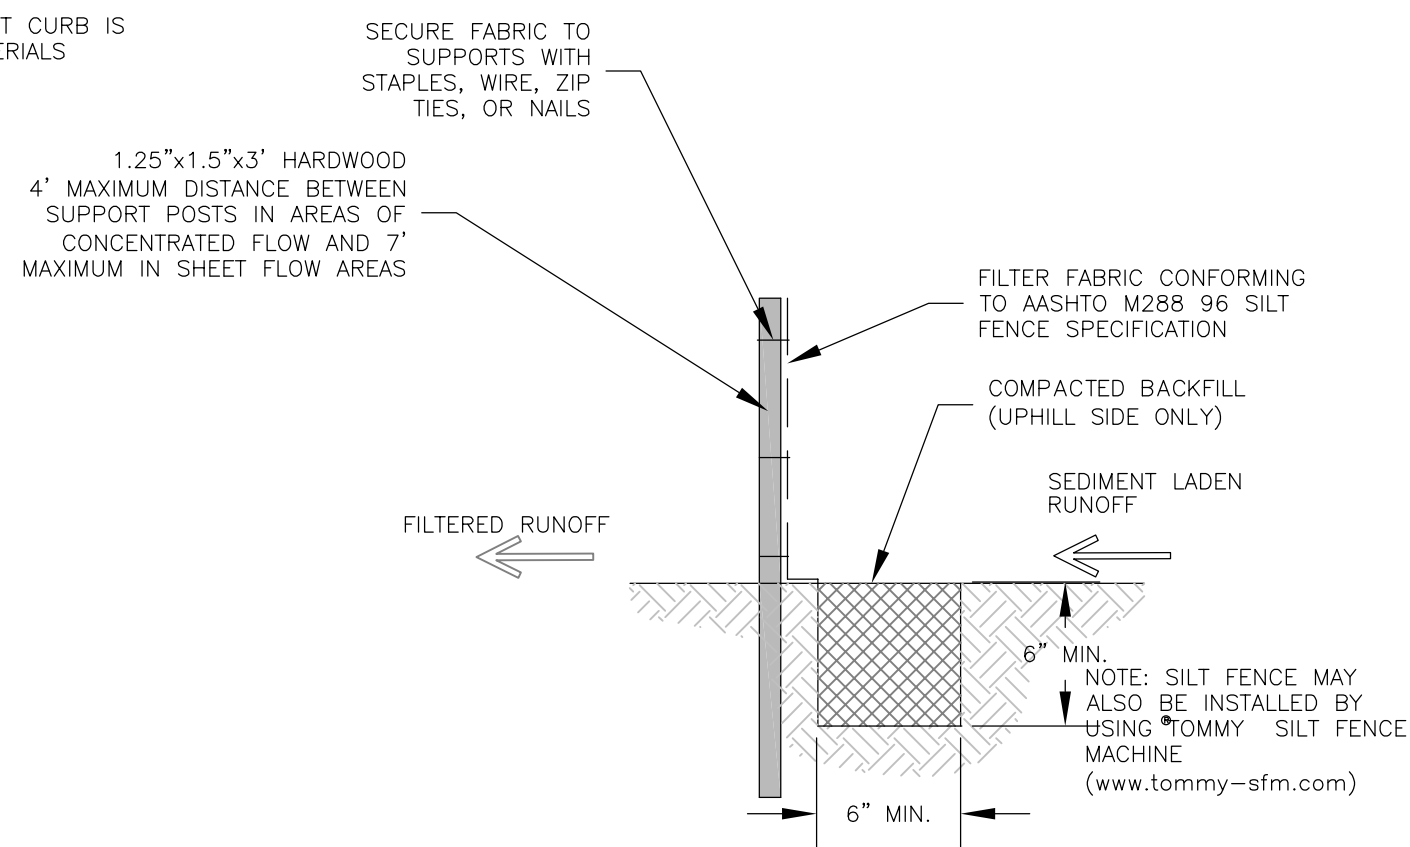


SILT FENCE SLOPE BARRIER DETAIL
NO SCALE

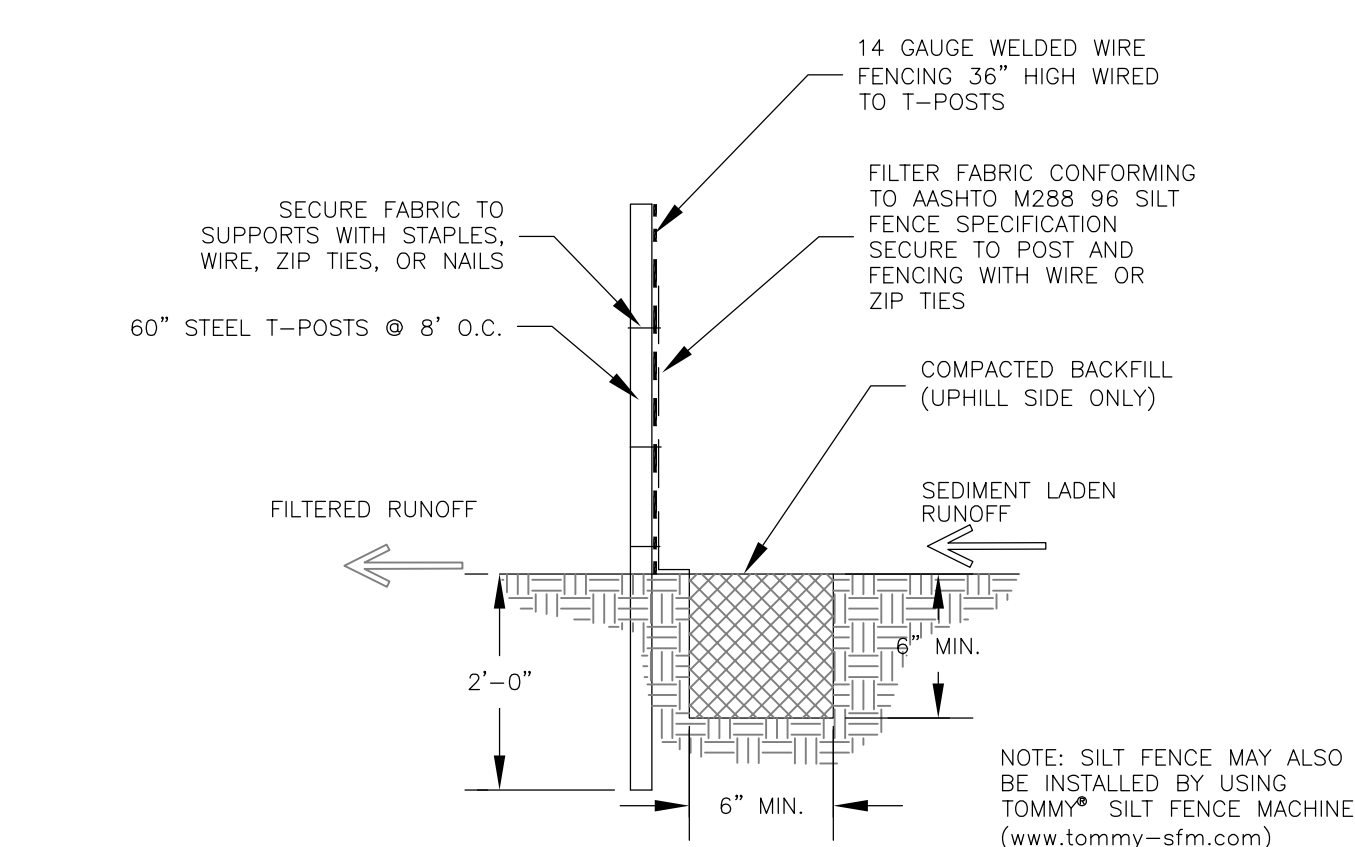


REINFORCED SILT FENCE SLOPE BARRIER DETAIL
NO SCALE

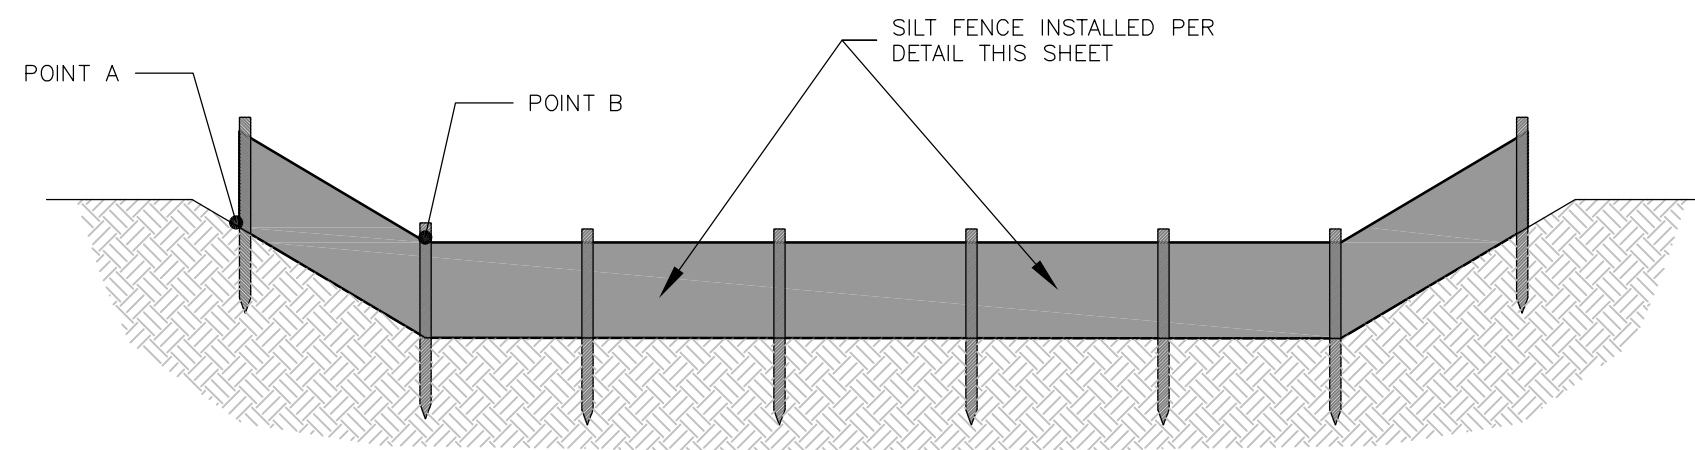

INSTALLATION OF SILT FENCE DITCH CHECKS
NO SCALE

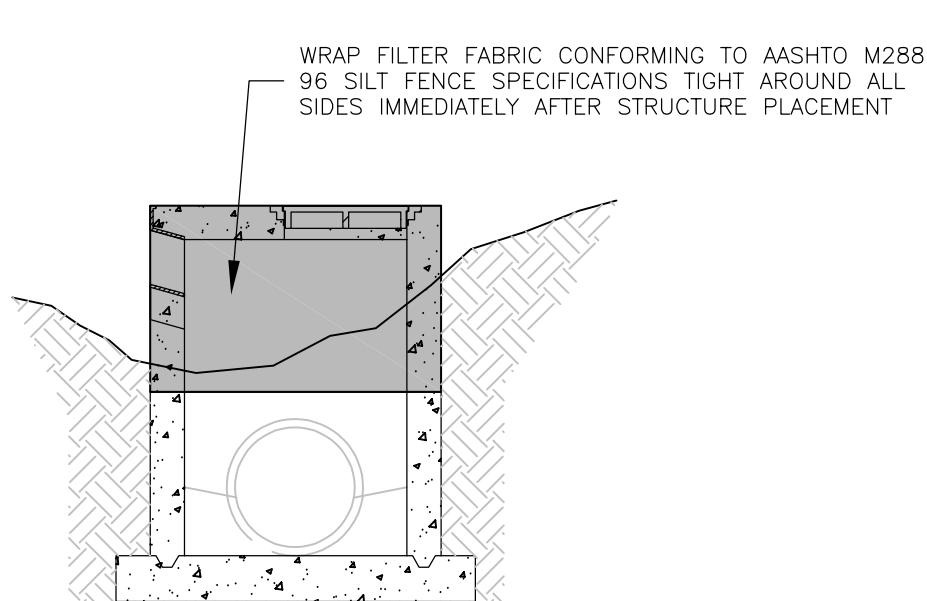

TEMPORARY CURB INLET SEDIMENT BARRIER
NO SCALE

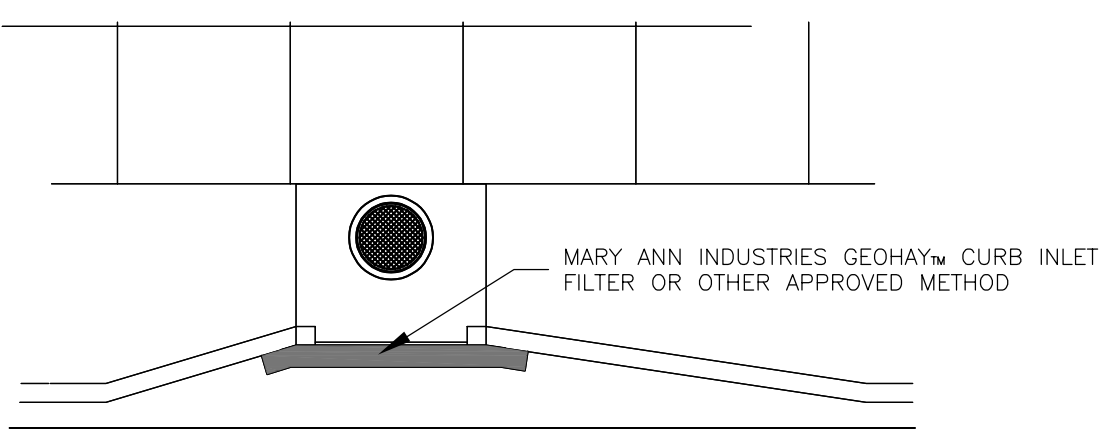

LONG-TERM CURB INLET SEDIMENT BARRIER
NO SCALE

GENERAL NOTES:

- ALL CONSTRUCTION ACTIVITIES SHALL COMPLY WITH CITY OF LAWRENCE CODE 9-903 REGARDING STORMWATER POLLUTION PREVENTION.
- CONTRACTOR SHALL BE RESPONSIBLE FOR IMPLEMENTATION, INSPECTION, AND MAINTENANCE OF ALL BEST MANAGEMENT PRACTICES (BMPs) AS SHOWN ON THE APPROVED STORMWATER POLLUTION PREVENTION PLAN (SWP3) EXCLUDING CONSTRUCTION UNDER THE CONTROL OF SUBSEQUENT OWNERS OF INDIVIDUAL LOTS AND CONSTRUCTION BY UTILITIES.
- SUBSEQUENT OWNERS OF INDIVIDUAL LOTS ARE RESPONSIBLE FOR CONTINUED IMPLEMENTATION, INSPECTION, AND MAINTENANCE OF ALL BMPs WITHIN THE LOT AS SHOWN ON THE APPROVED SWP3.
- CONTRACTOR SHALL PROVIDE A COPY OF THE APPROVED SWP3 TO ALL CONTRACTORS, UTILITIES, AND SUBSEQUENT OWNERS OF INDIVIDUAL LOTS PRIOR TO ANY WORK WITHIN THE SUBDIVISION.
- CONTRACTORS WILL BE RESPONSIBLE FOR THE IMMEDIATE REMOVAL OF SOIL TRACKED ONTO PAVED STREETS.
- STREET CONTRACTOR WILL BE RESPONSIBLE FOR MARKING ALL LIMITS OF DISTURBANCE (LOD) AND WILL NOT DISTURB VEGETATIVE COVER OUTSIDE OF THESE LIMITS.
- INSPECTION OF BMPs SHALL OCCUR AT LEAST ONCE EVERY 14 DAYS AND WITHIN 24 HOURS AFTER A RAINFALL EVENT OF 1/2" OR MORE OF RAIN AS MEASURED ON SITE.
- MAINTENANCE OF BMPs SHALL INCLUDE NECESSARY REPAIRS, REMOVAL OF SEDIMENT, AND ANY NECESSARY MODIFICATIONS TO BMPs AS AUTHORIZED BY CITY OF LAWRENCE.
- SILT FENCE WILL BE INSTALLED AS SHOWN ON THIS PLAN WITH MODIFICATIONS (AS APPROVED BY THE CITY) AS NECESSARY AT THE TIME OF INSTALLATION TO FIT THE EXISTING CONDITIONS.
- TOPSOIL MUST BE STOCKPILED UPSTREAM OF SILT FENCE.
- SILT FENCE SHALL BE RELOCATED IMMEDIATELY DOWNSTREAM OF ANY ADDITIONAL GRADING OR TRENCHING REQUIRED TO COMPLETE WORK SHOWN ON THESE PLANS.
- R/W SILT FENCE SHALL BE INSTALLED AT A DISTANCE OF 3' ON THE UPSLOPE SIDE OF FUTURE SIDEWALKS AND AT A DISTANCE OF 8' FROM THE BACK OF CURB IF NO SIDEWALK IS TO BE CONSTRUCTED AND INSTALLED IMMEDIATELY AFTER FINAL STREET GRADING.
- TEMPORARY CURB INLET SEDIMENT BARRIERS MUST BE INSTALLED IMMEDIATELY AFTER STRUCTURE PLACEMENT AND ONLY REMOVED JUST PRIOR TO PLACEMENT OF CURB AND GUTTER.
- AFTER INITIAL DETENTION BASIN GRADING ALL DISTURBED AREAS SHALL BE SEEDED WITH A TEMPORARY COVER CROP OF ANNUAL RYE OR WHEAT. TEMPORARY BASIN OUTLET STRUCTURES SHALL BE INSTALLED PER DETAIL THIS SHEET.
- AFTER VEGETATIVE COVER OF THE REST OF THE SITE IS ESTABLISHED REMOVE TEMPORARY BASIN OUTLET STRUCTURES, REGARDED BASINS TO REMOVE SEDIMENT, AND RESEED ALL SEEDED AREAS SHALL BE MULCHED PER CITY OF LAWRENCE STANDARD SPECIFICATIONS.

2021 EDITION

SHEET 36 OF 49


DATE	BY	REVISION
03-01-21	LJM	REPLACES ALL PREVIOUS VERSIONS OF EROSION AND SEDIMENT CONTROL DETAILS
03-01-20	LJM	REPLACES ALL PREVIOUS VERSIONS OF EROSION AND SEDIMENT CONTROL DETAILS





STANDARD DETAILS FOR
EROSION AND SEDIMENT CONTROL

DAVID P. CRONIN
CITY ENGINEER


CRAIG S. OWENS
CITY MANAGER

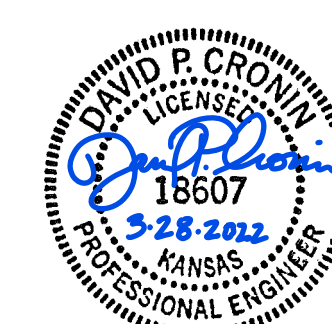

- GENERAL NOTES FOR SKIMMER DETAILS
1. PROPER DESIGN MUST BE COMPLETED TO MINIMIZE PIPING AROUND DISCHARGE PIPE.
 2. PROPER ORIFICE OPENING MUST BE SELECTED TO ENSURE POND DRAINS IN CORRECT AMOUNT OF TIME. MODIFICATIONS MAY BE REQUIRED IF FIELD CONDITIONS WARRANT A CHANGE.
 3. EMBANKMENT MUST BE COMPACTED TO DESIGN SPECIFICATIONS.
 4. EMERGENCY SPILLWAY MUST BE CORRECTLY SIZED AND EROSION PROTECTION INSTALLED.
 5. EROSION PROTECTION MUST BE INSTALLED ALONG THE EMBANKMENT AND AT THE DISCHARGE END OF THE PIPE.
 6. INSPECT SYSTEM REGULARLY TO ENSURE IT IS FUNCTIONING IN A CORRECT MANNER.
 7. SKIMMER SIZE DEPENDENT UPON VOLUME OF BASIN TO BE DRAINED AND NUMBER OF DAYS TO DRAIN THE BASIN.

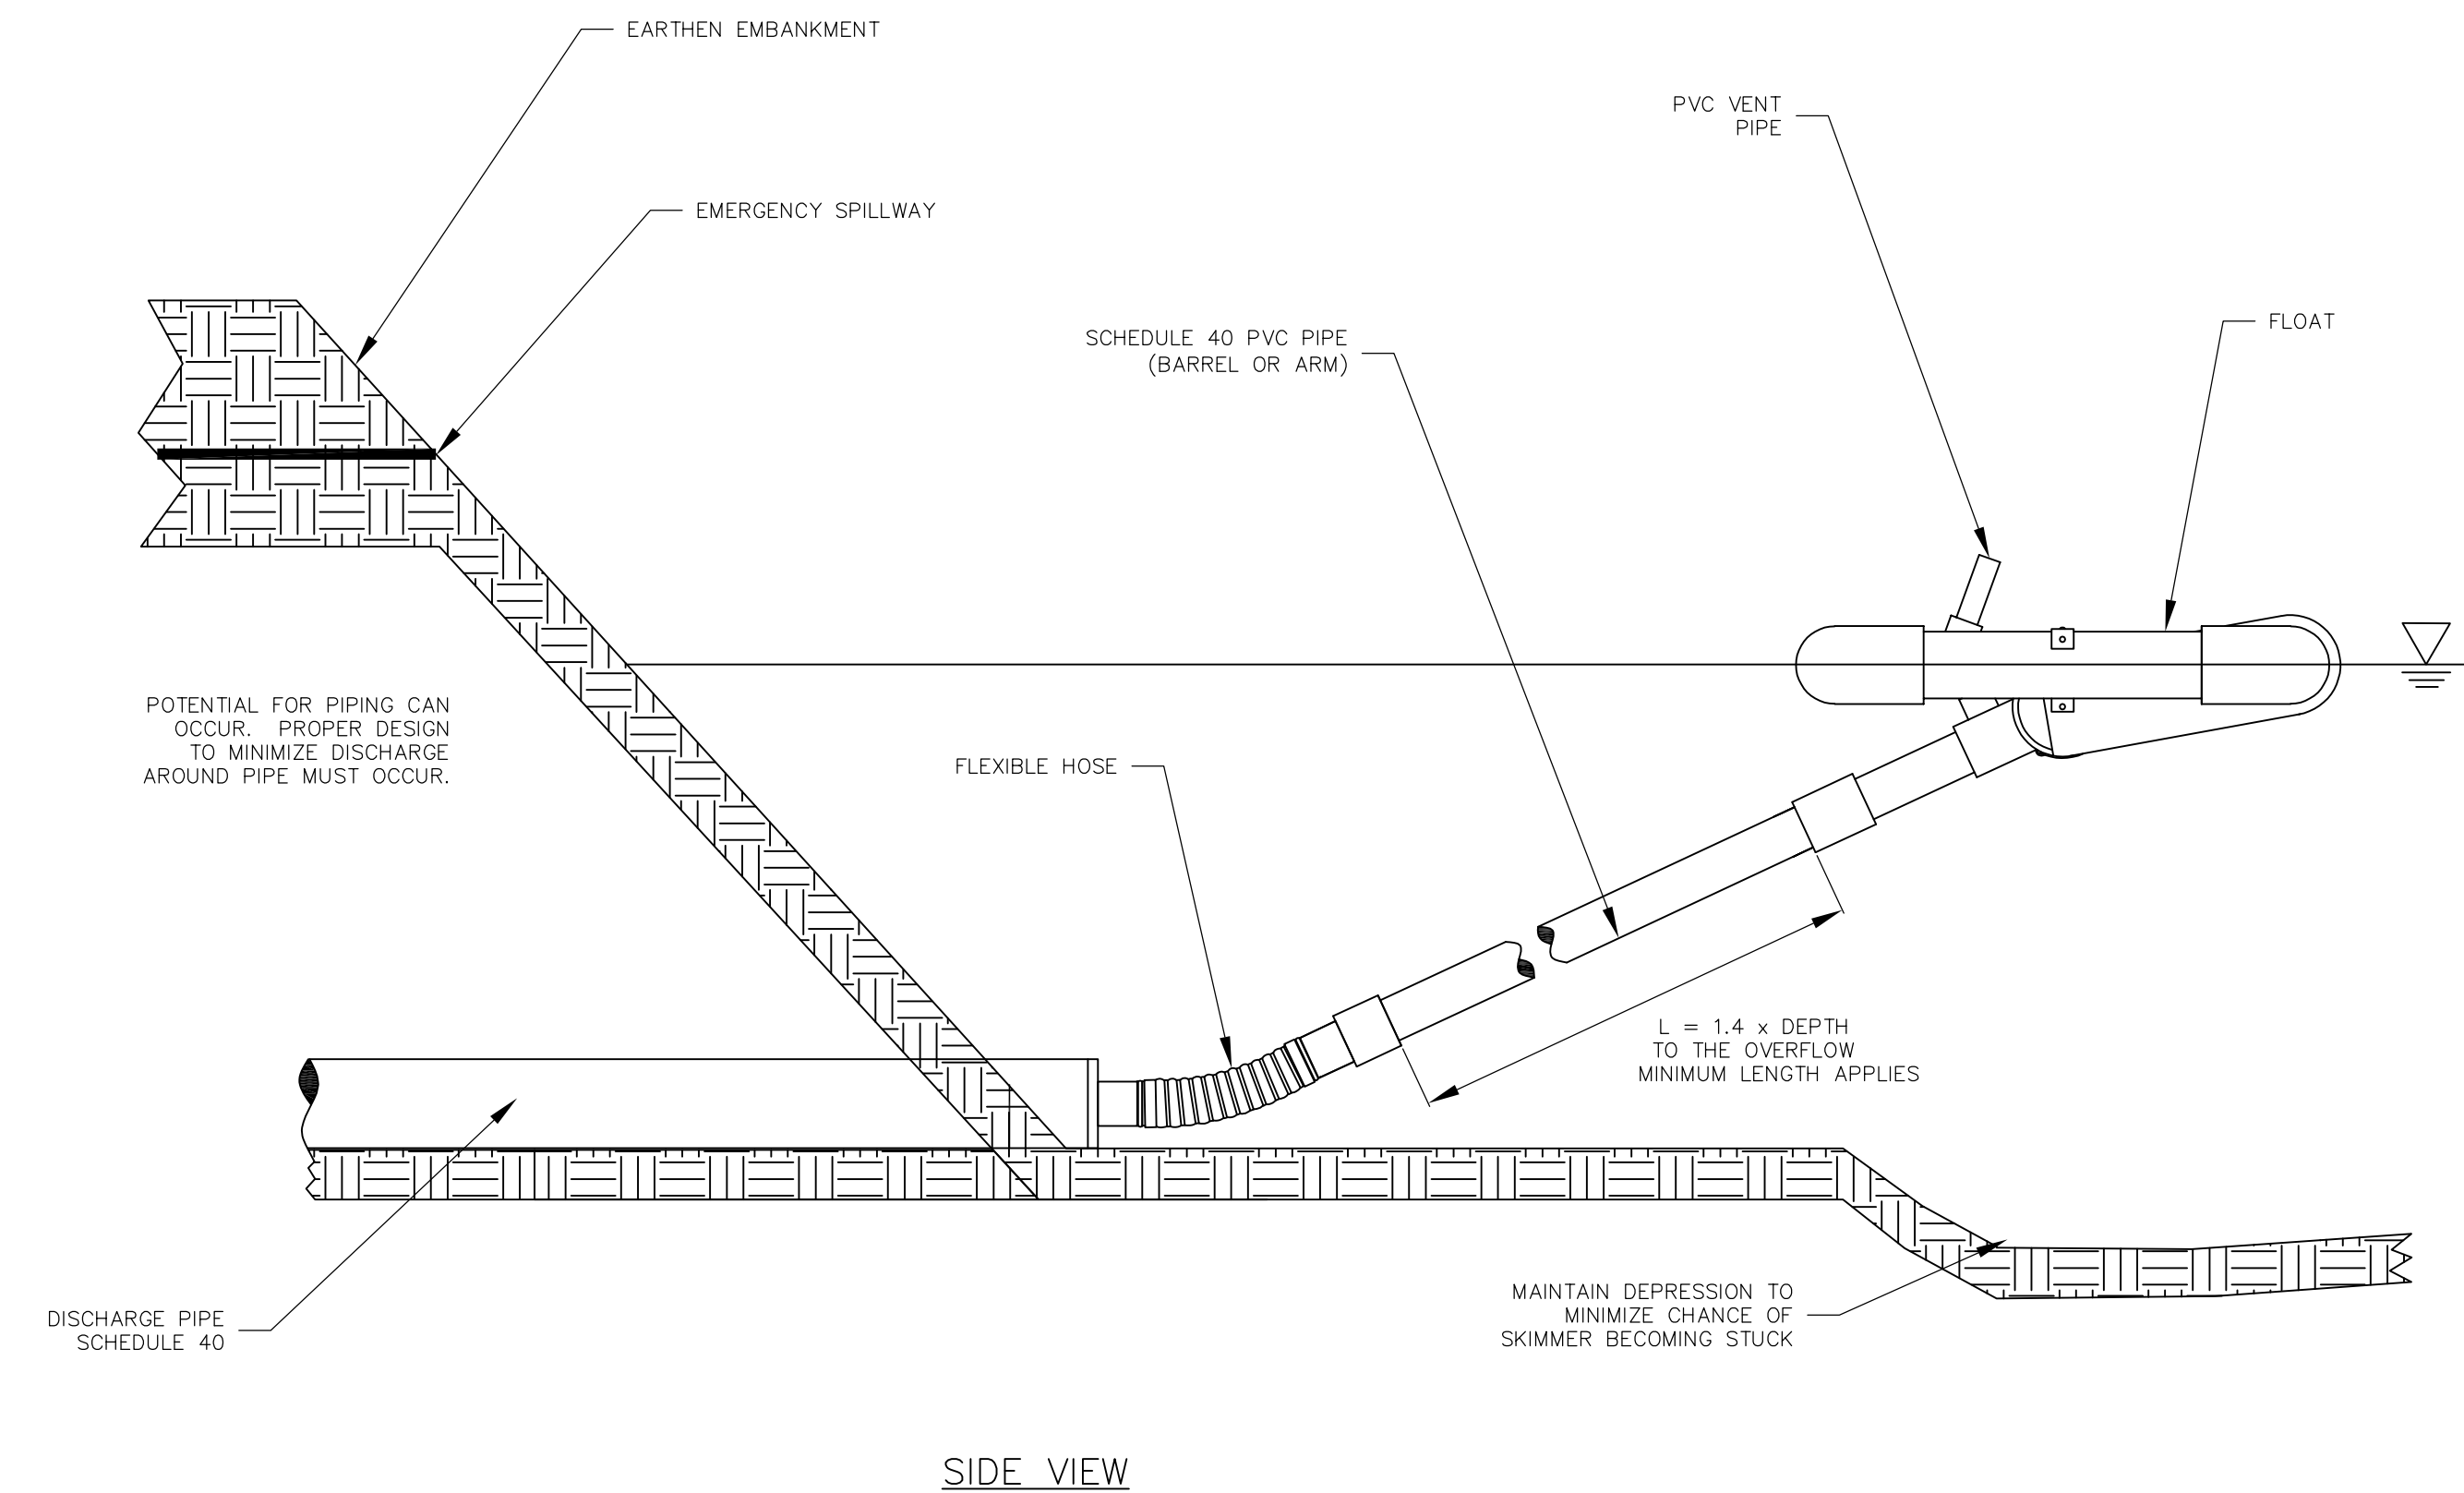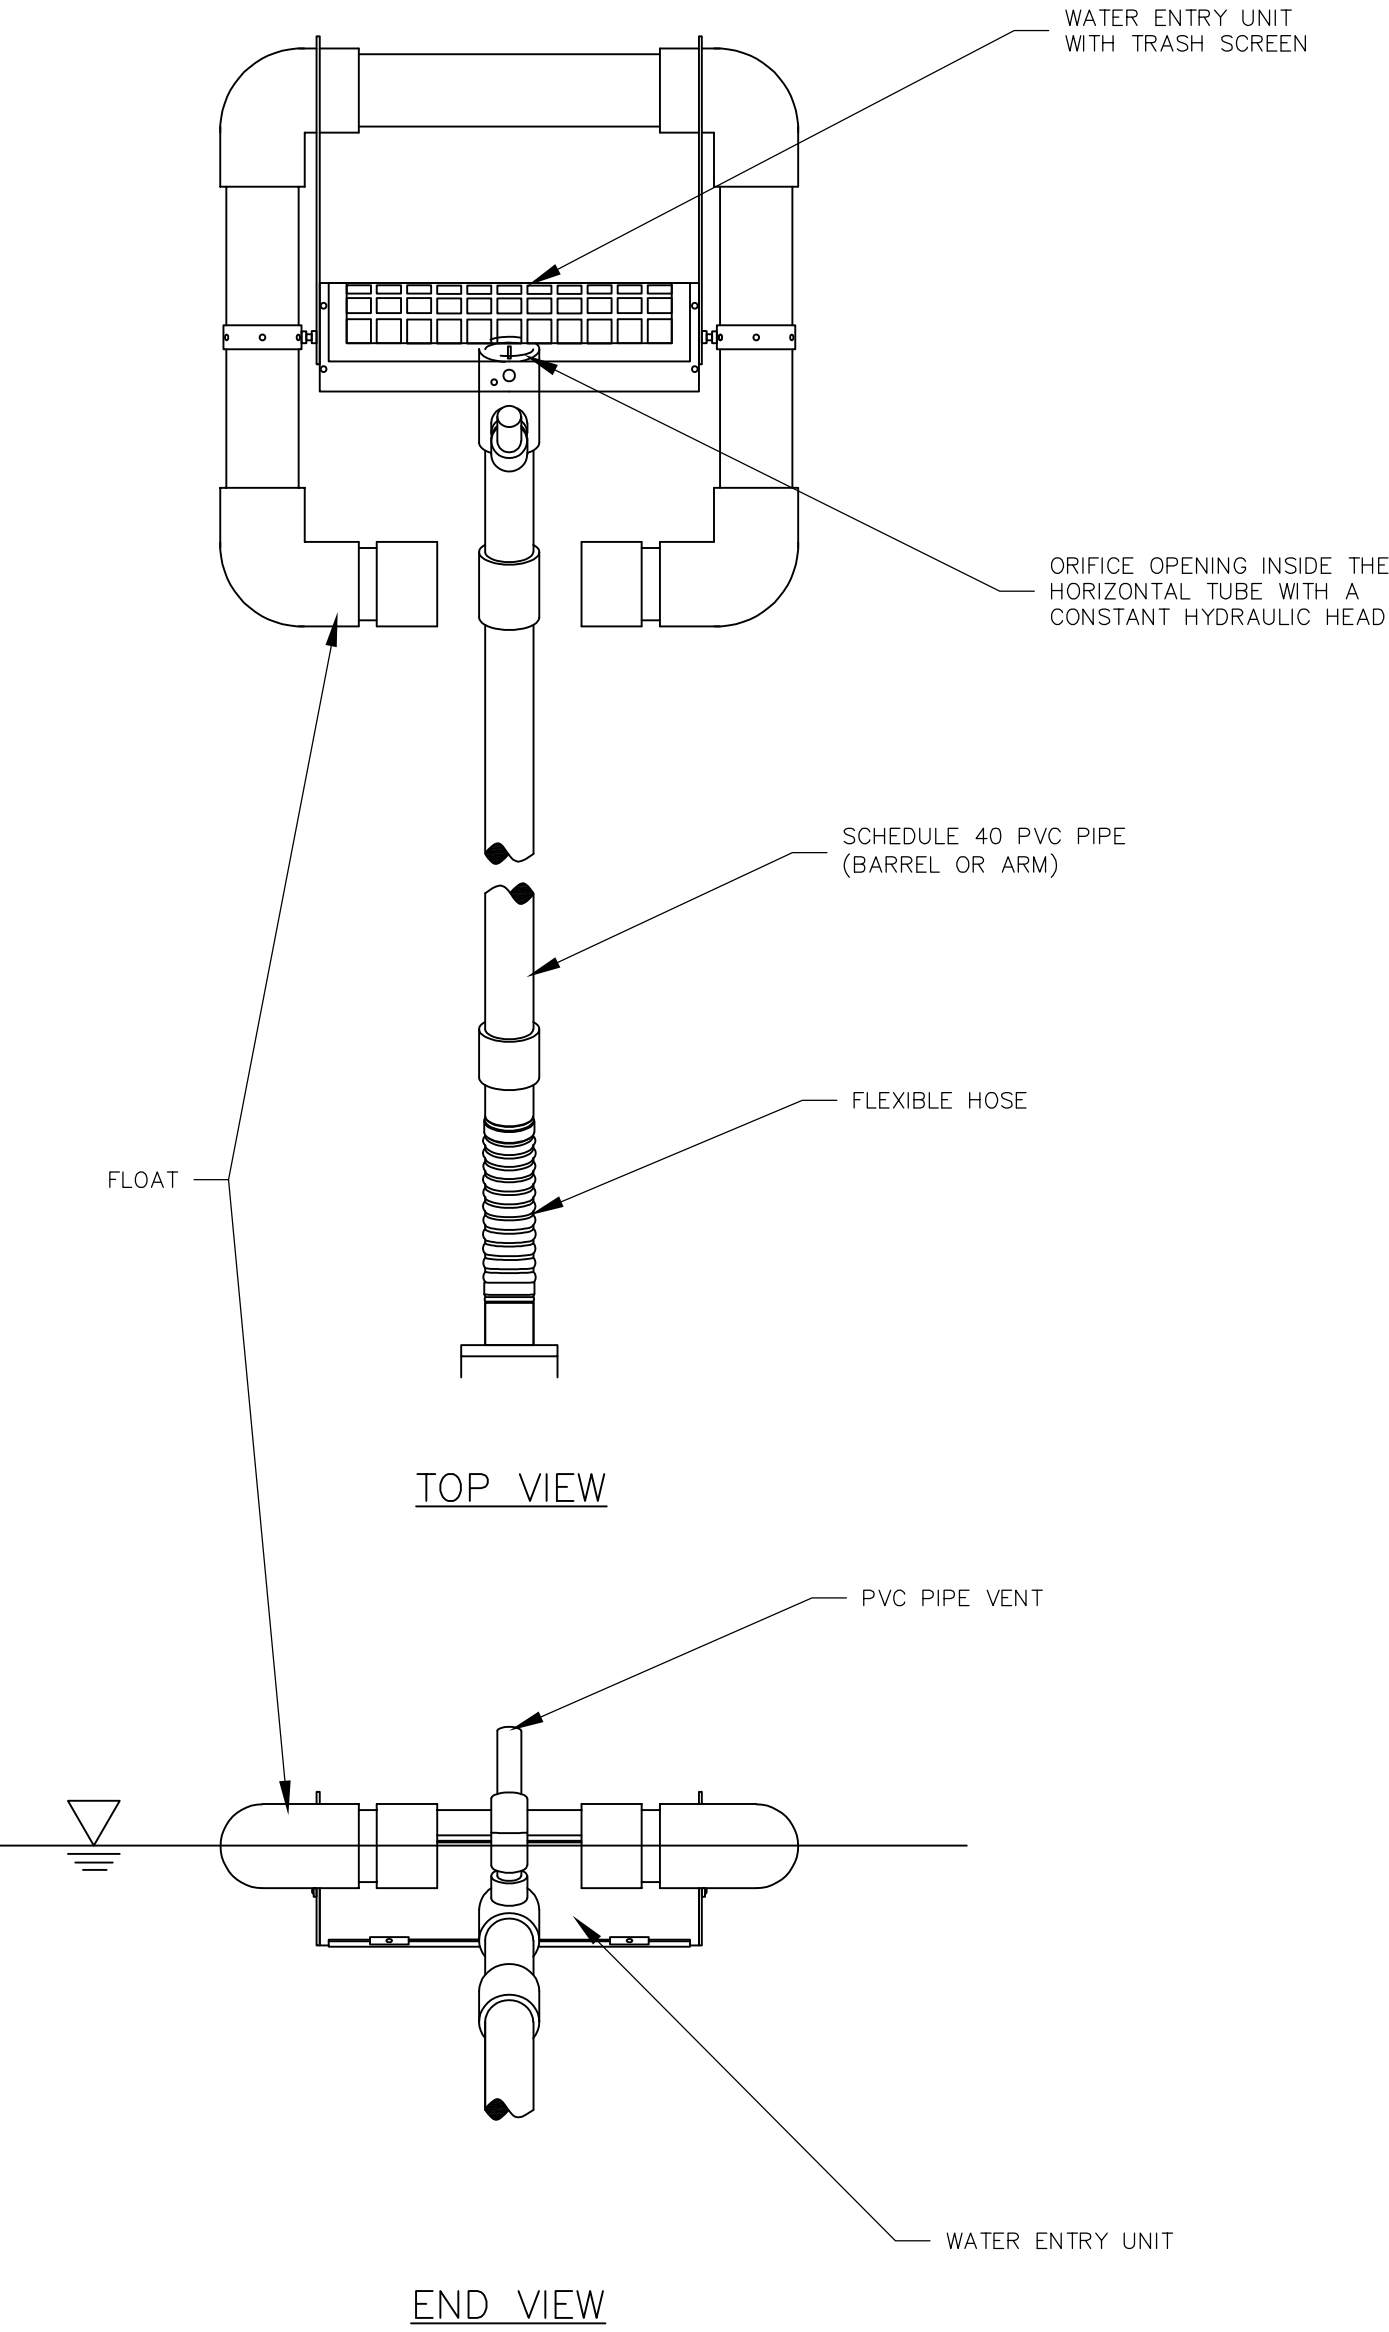

FAIRCLOTH SKIMMER® DISCHARGE SYSTEM WITH EMBANKMENT

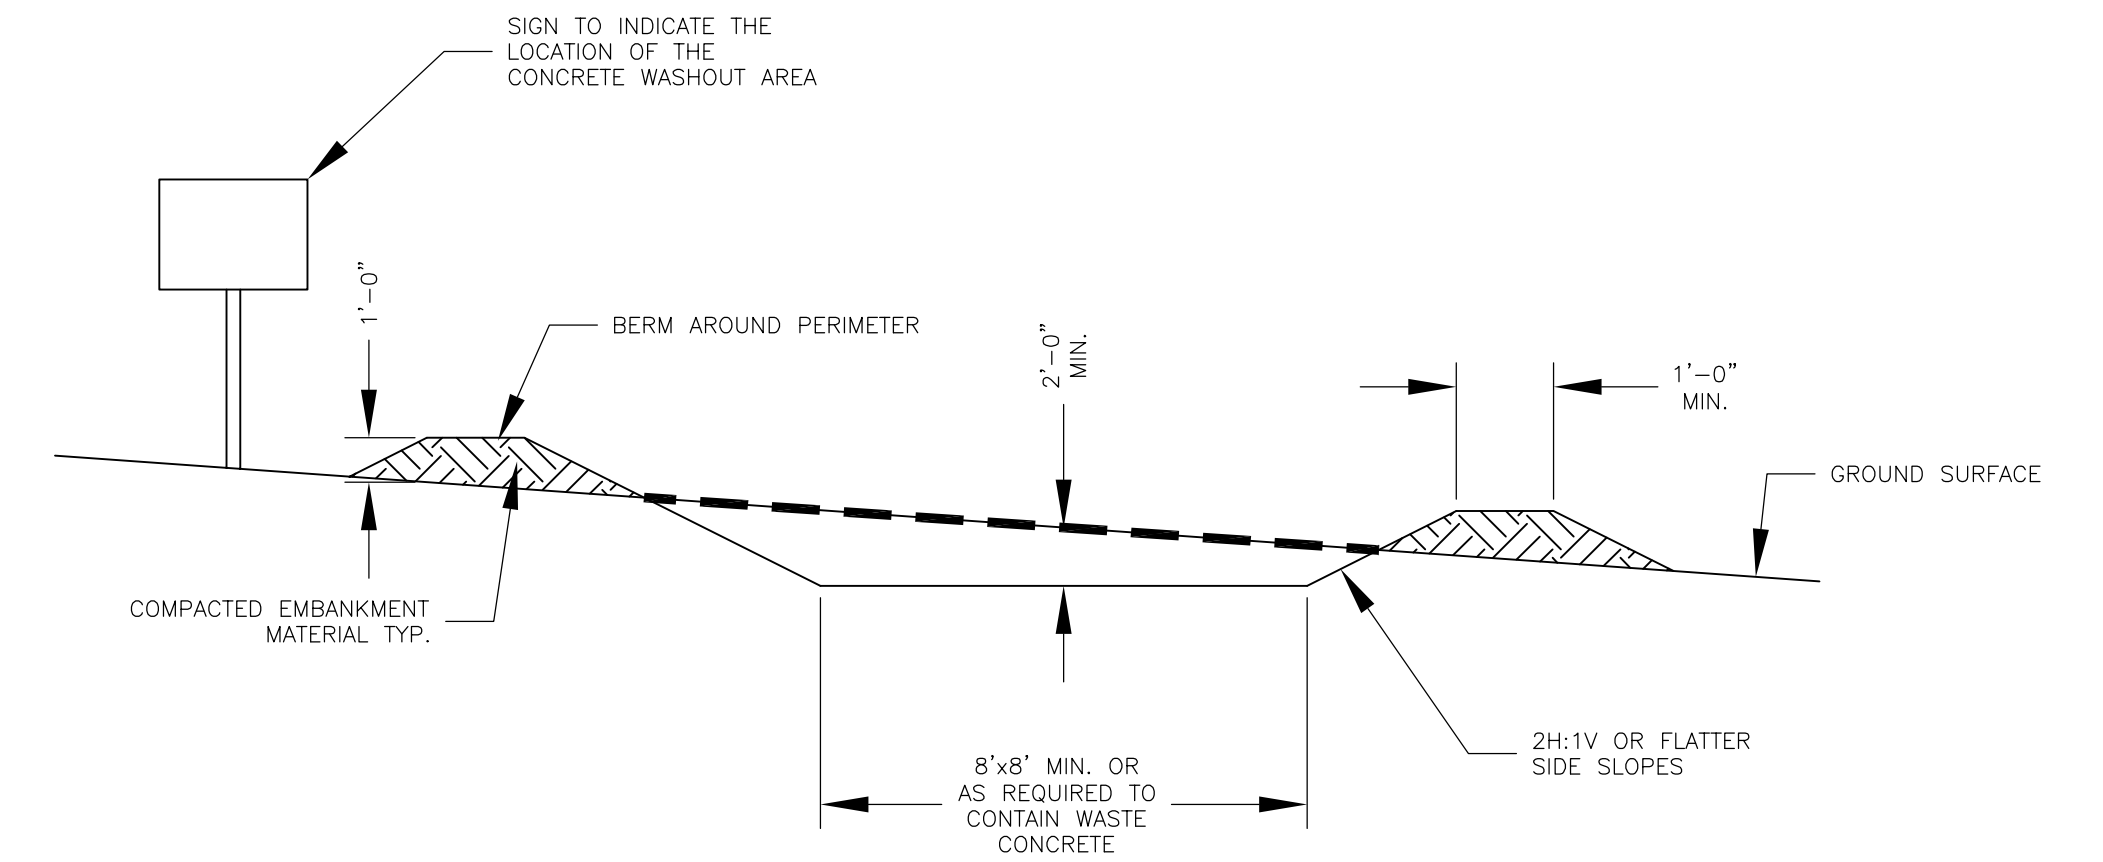

- NOTES:
1. CONCRETE WASHOUT AREA SHALL BE INSTALLED PRIOR TO ANY CONCRETE PLACEMENT ON SITE.
 2. SIGNS SHALL BE PLACED AT THE WASHOUT AREA AS NECESSARY TO CLEARLY INDICATE THE LOCATION OF THE CONCRETE WASHOUT AREA TO OPERATORS OF CONCRETE TRUCKS AND PUMP RIGS.
 3. THE CONCRETE WASHOUT AREA SHALL BE REPAIRED AND ENLARGED OR CLEANED OUT AS NECESSARY TO MAINTAIN CAPACITY FOR WASTED CONCRETE.
 4. AT THE END OF CONSTRUCTION, ALL CONCRETE SHALL BE REMOVED FROM THE SITE AND DISPOSED OF AT AN ACCEPTED WASTE SITE.
 5. WHEN THE CONCRETE WASHOUT AREA IS REMOVED, THE DISTURBED AREA SHALL BE SEEDED AND MULCHED OR OTHERWISE STABILIZED IN A MANNER ACCEPTED BY THE CITY.

CONCRETE WASHOUT AREA
NOT TO SCALE


2021 EDITION SHEET 37 OF 49



DATE	BY	REVISION
03-01-21	LJM	REPLACES ALL PREVIOUS VERSIONS OF EROSION AND SEDIMENT CONTROL DETAILS
03-01-20	LJM	REPLACES ALL PREVIOUS VERSIONS OF EROSION AND SEDIMENT CONTROL DETAILS



STANDARD DETAILS FOR
EROSION AND SEDIMENT CONTROL


DAVID P. CRONIN CITY ENGINEER
CRAIG S. OWENS CITY MANAGER

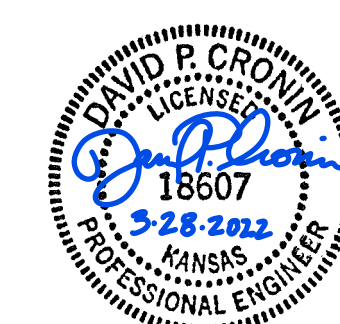

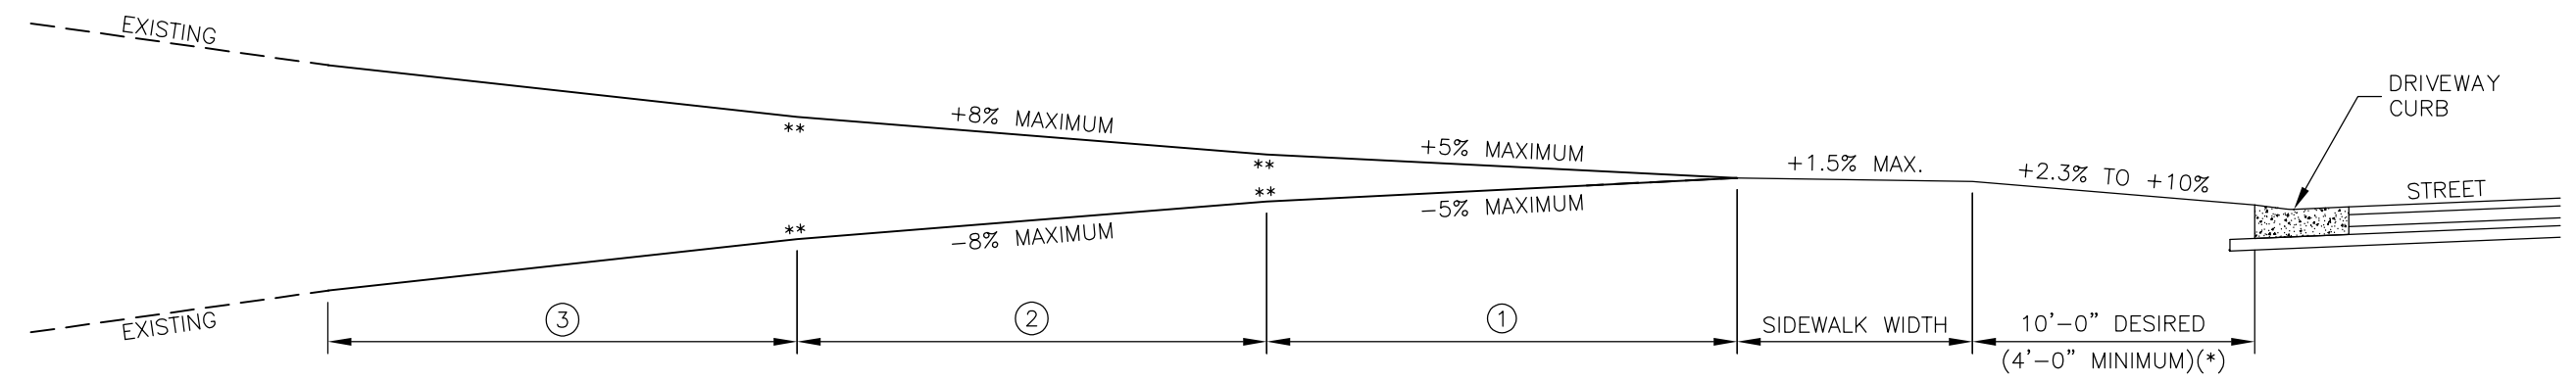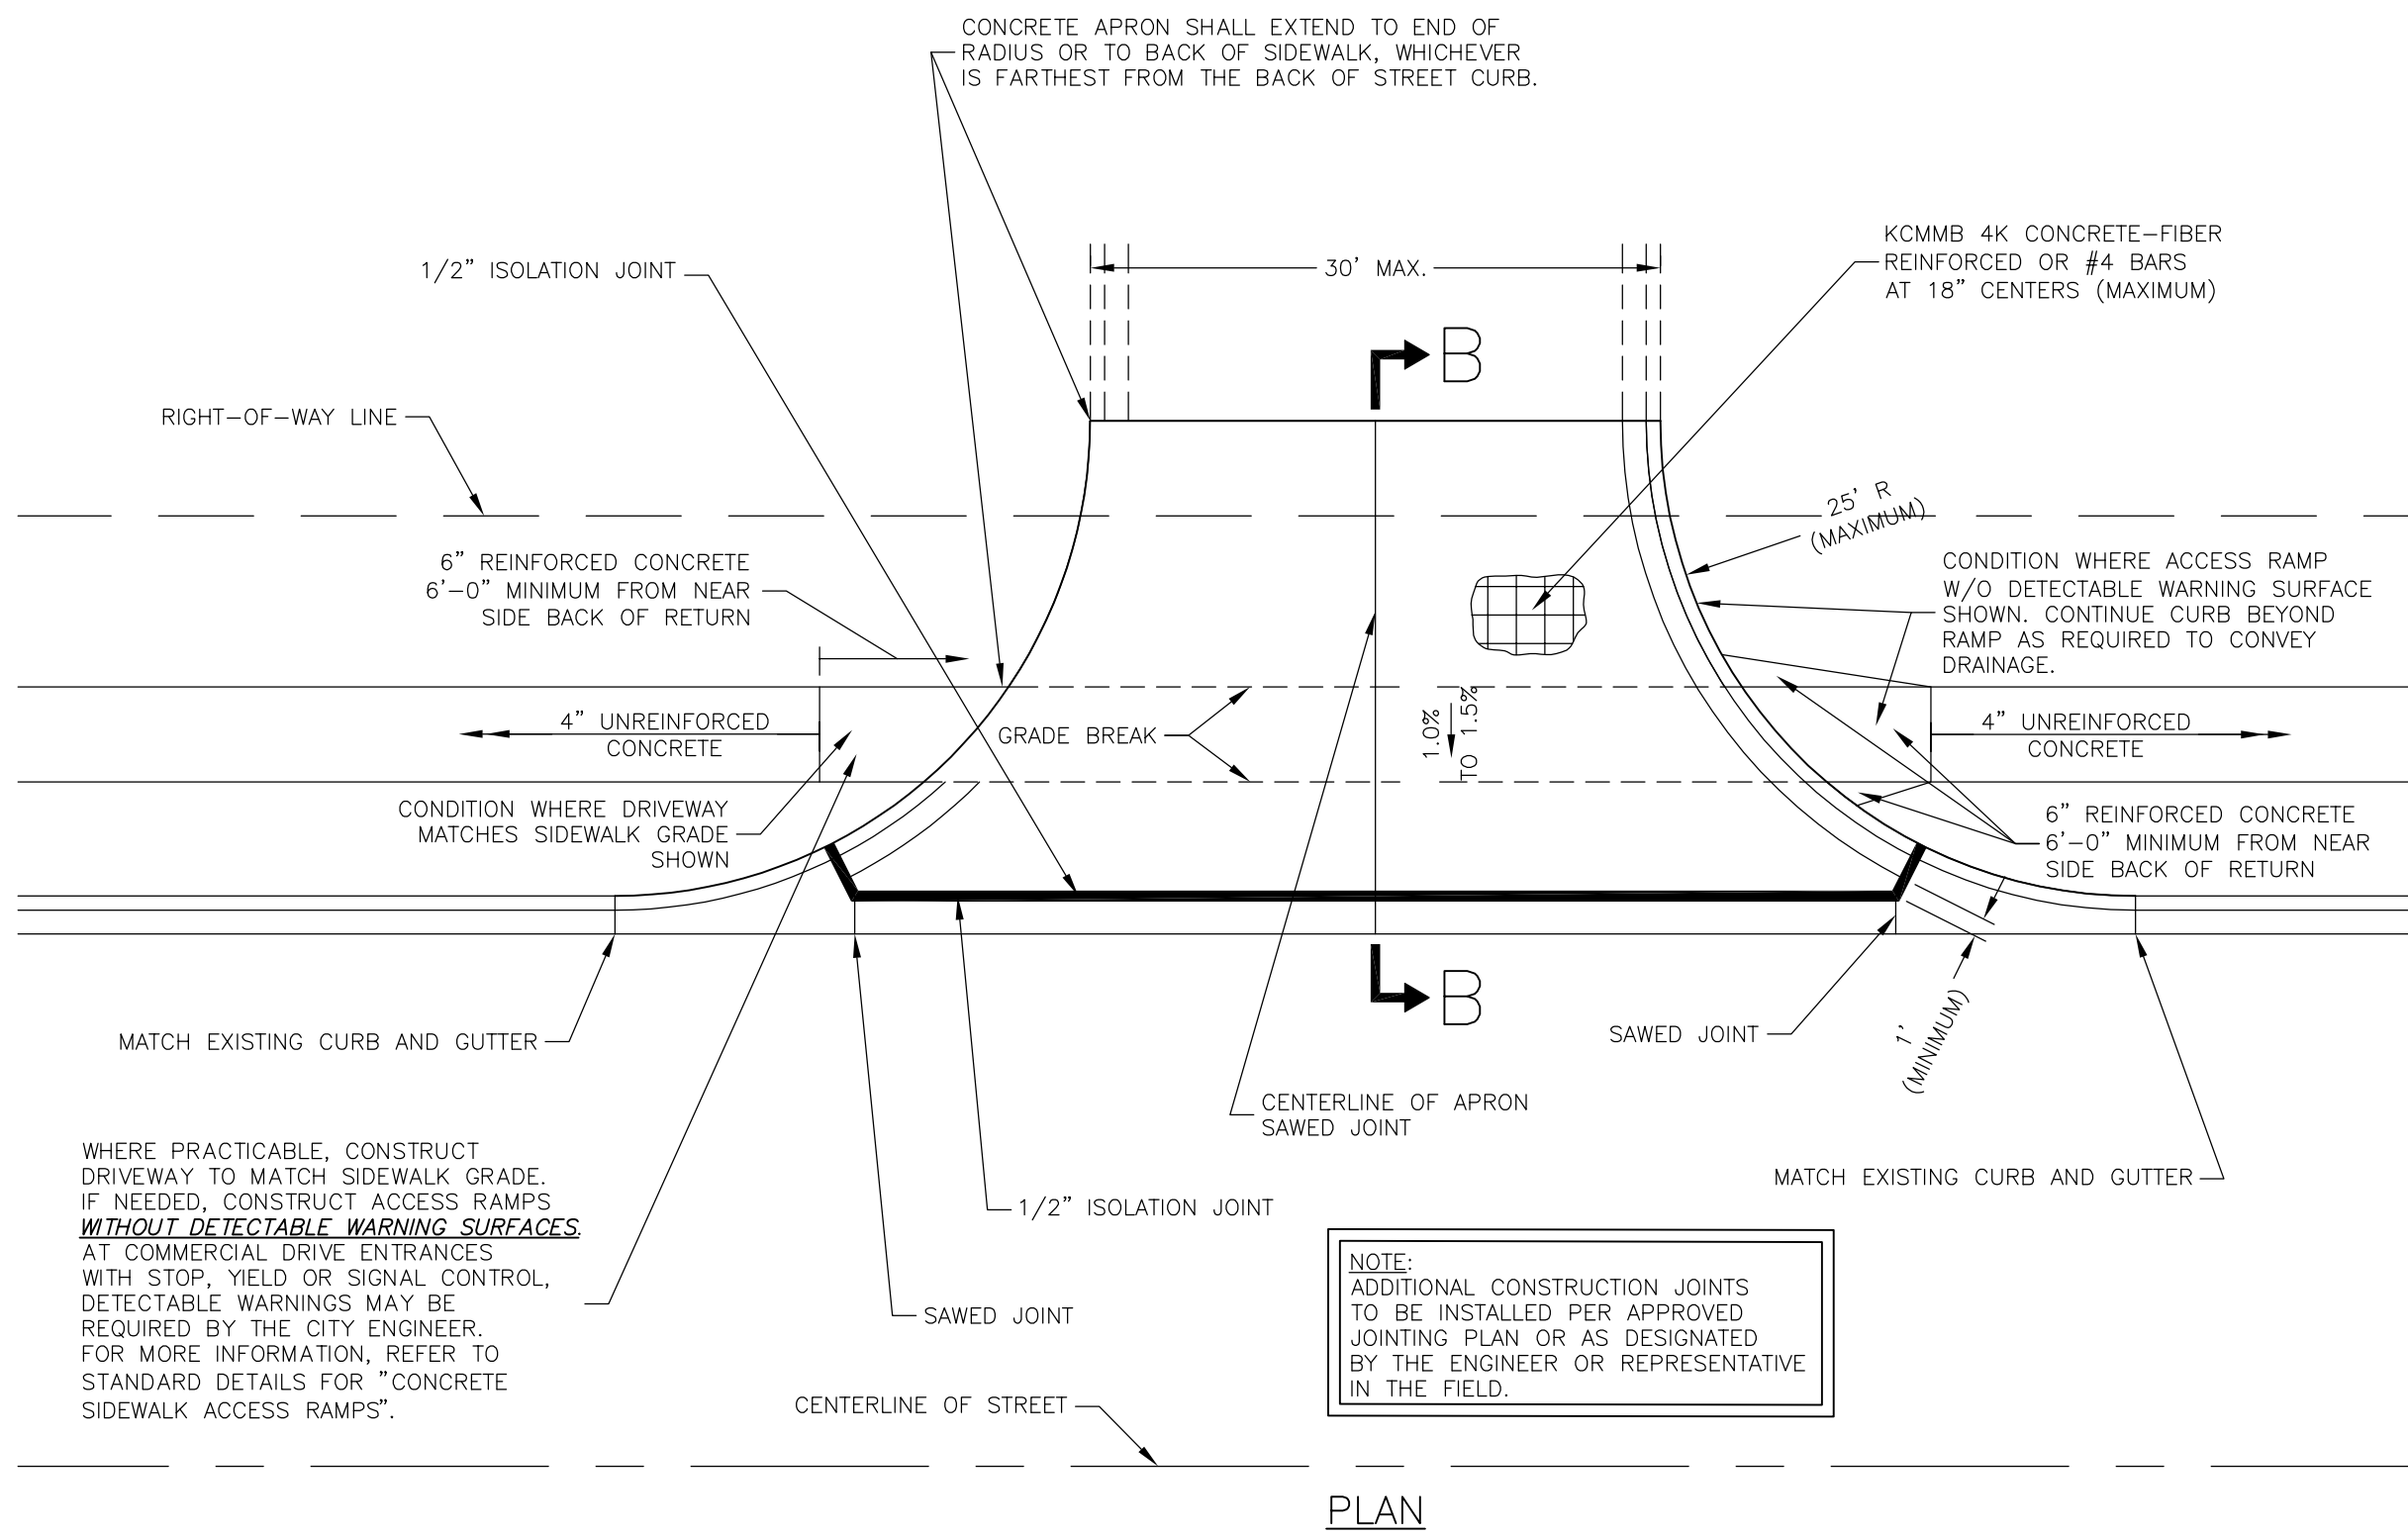

- ① 10'-0" MINIMUM IS REQUIRED WHEN THE EXISTING GRADE IS GREATER THAN ±8%.
 ② 10'-0" MINIMUM IS REQUIRED WHEN THE EXISTING GRADE IS GREATER THAN ±15%.
 ③ 10'-0" MINIMUM IS REQUIRED WHEN THE EXISTING GRADE IS GREATER THAN ±22%.
- *0 FEET IS ALLOWED IN URBAN BUSINESS DISTRICTS WITH SIDEWALKS OF 6 FEET MINIMUM WIDTH.
 **10 FEET MINIMUM ROUNDING DESIRABLE AT GRADE CHANGES.

PROFILE WITH SIDEWALK (MAXIMUM PERCENT OF GRADE)

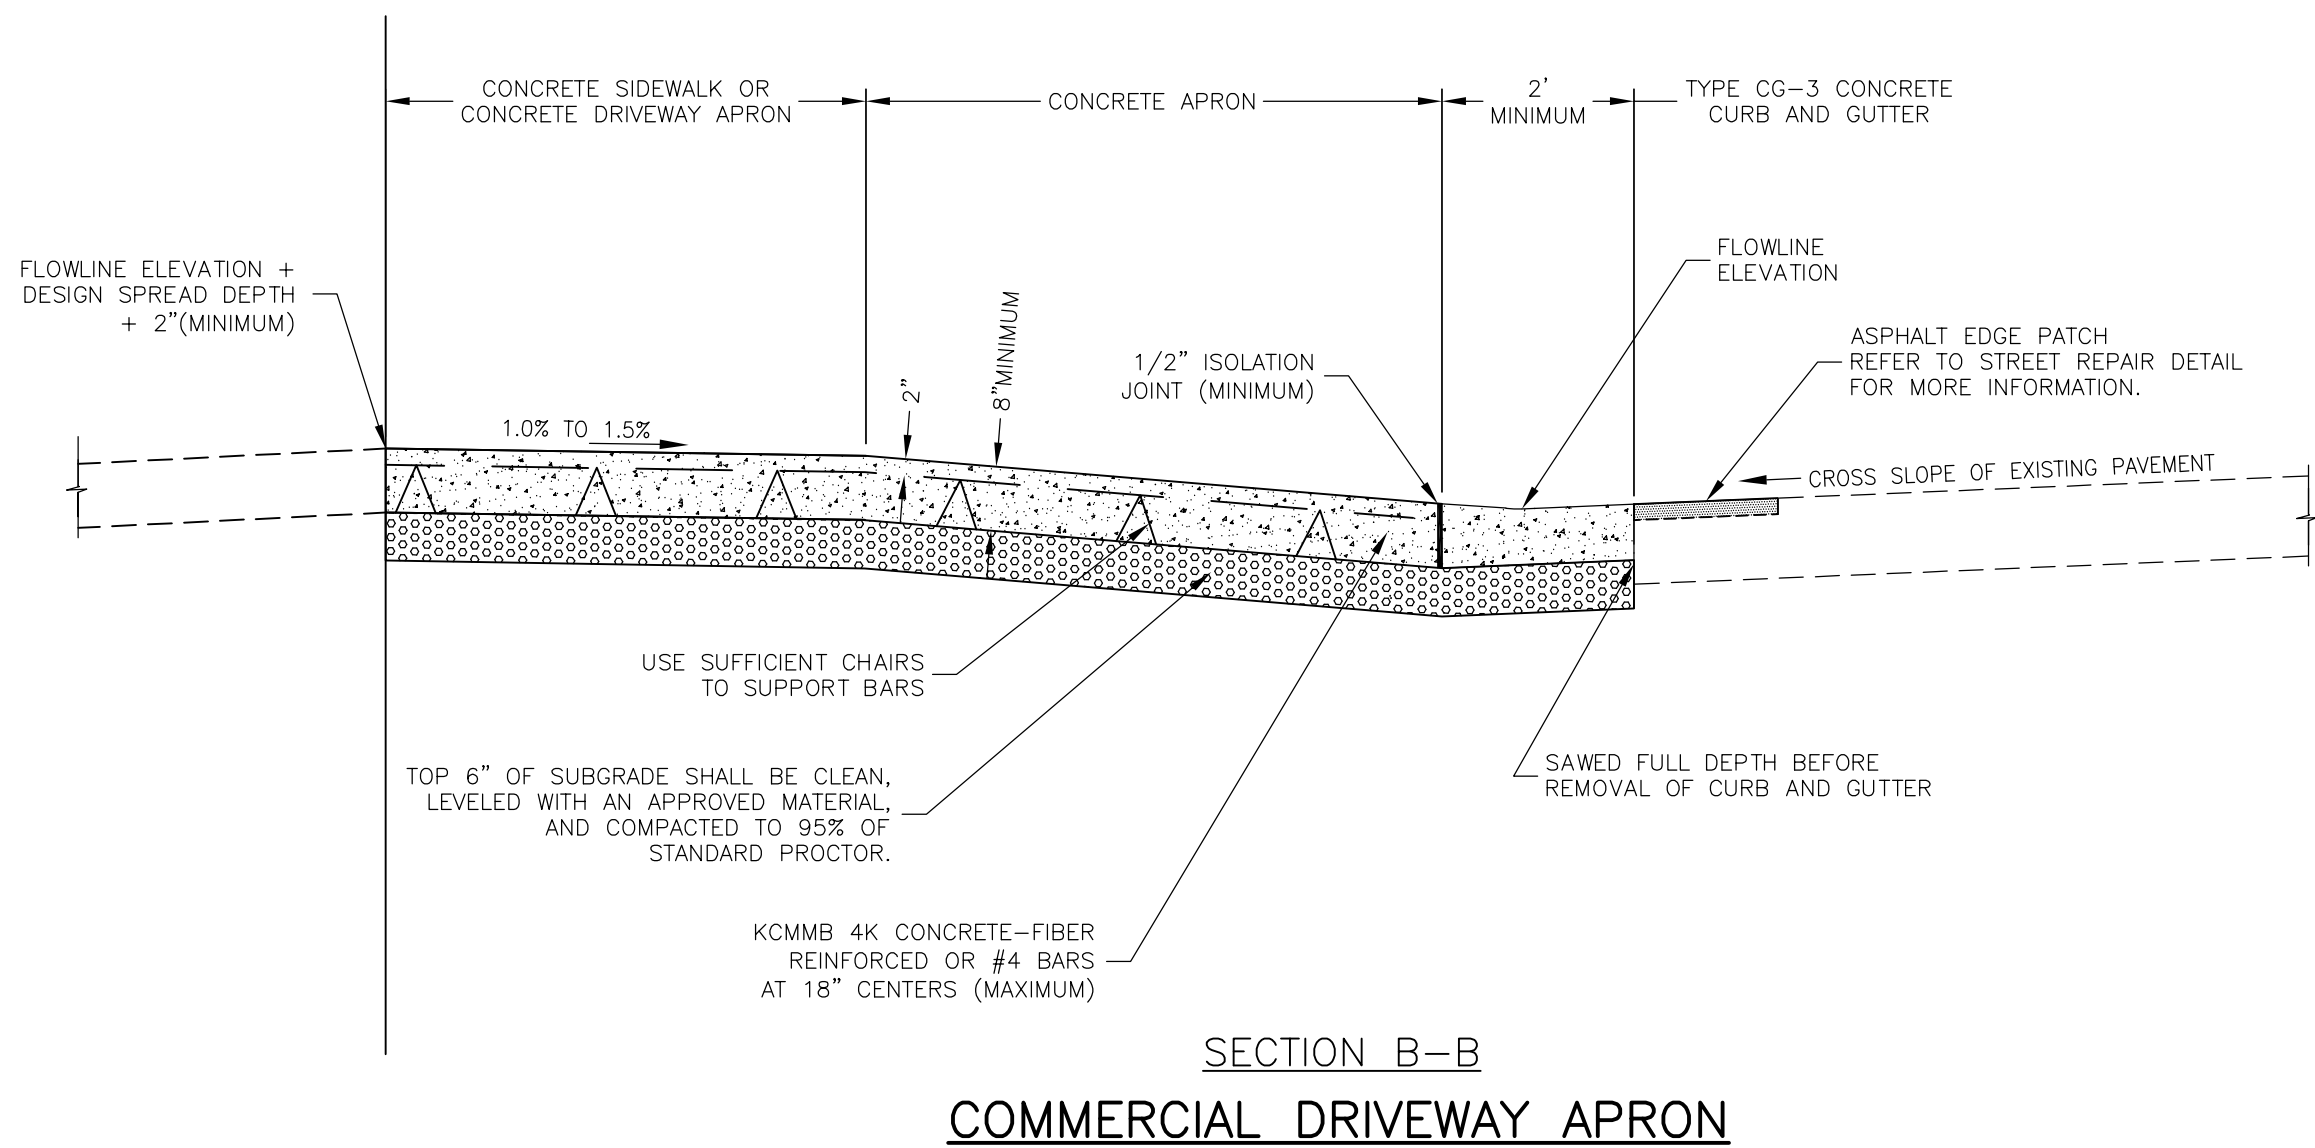

2021 EDITION

SHEET 38 OF 49

DATE	BY	REVISION
03-01-21	LJM	REPLACES ALL PREVIOUS VERSIONS OF CONCRETE DRIVEWAY DETAILS
03-01-20	LJM	REPLACES ALL PREVIOUS VERSIONS OF CONCRETE DRIVEWAY DETAILS




City of Lawrence
MUNICIPAL SERVICES & OPERATIONS

STANDARD DETAILS FOR
CONCRETE COMMERCIAL DRIVEWAYS


DAVID P. CRONIN
CITY ENGINEER

CRAIG S. OWENS
CITY MANAGER




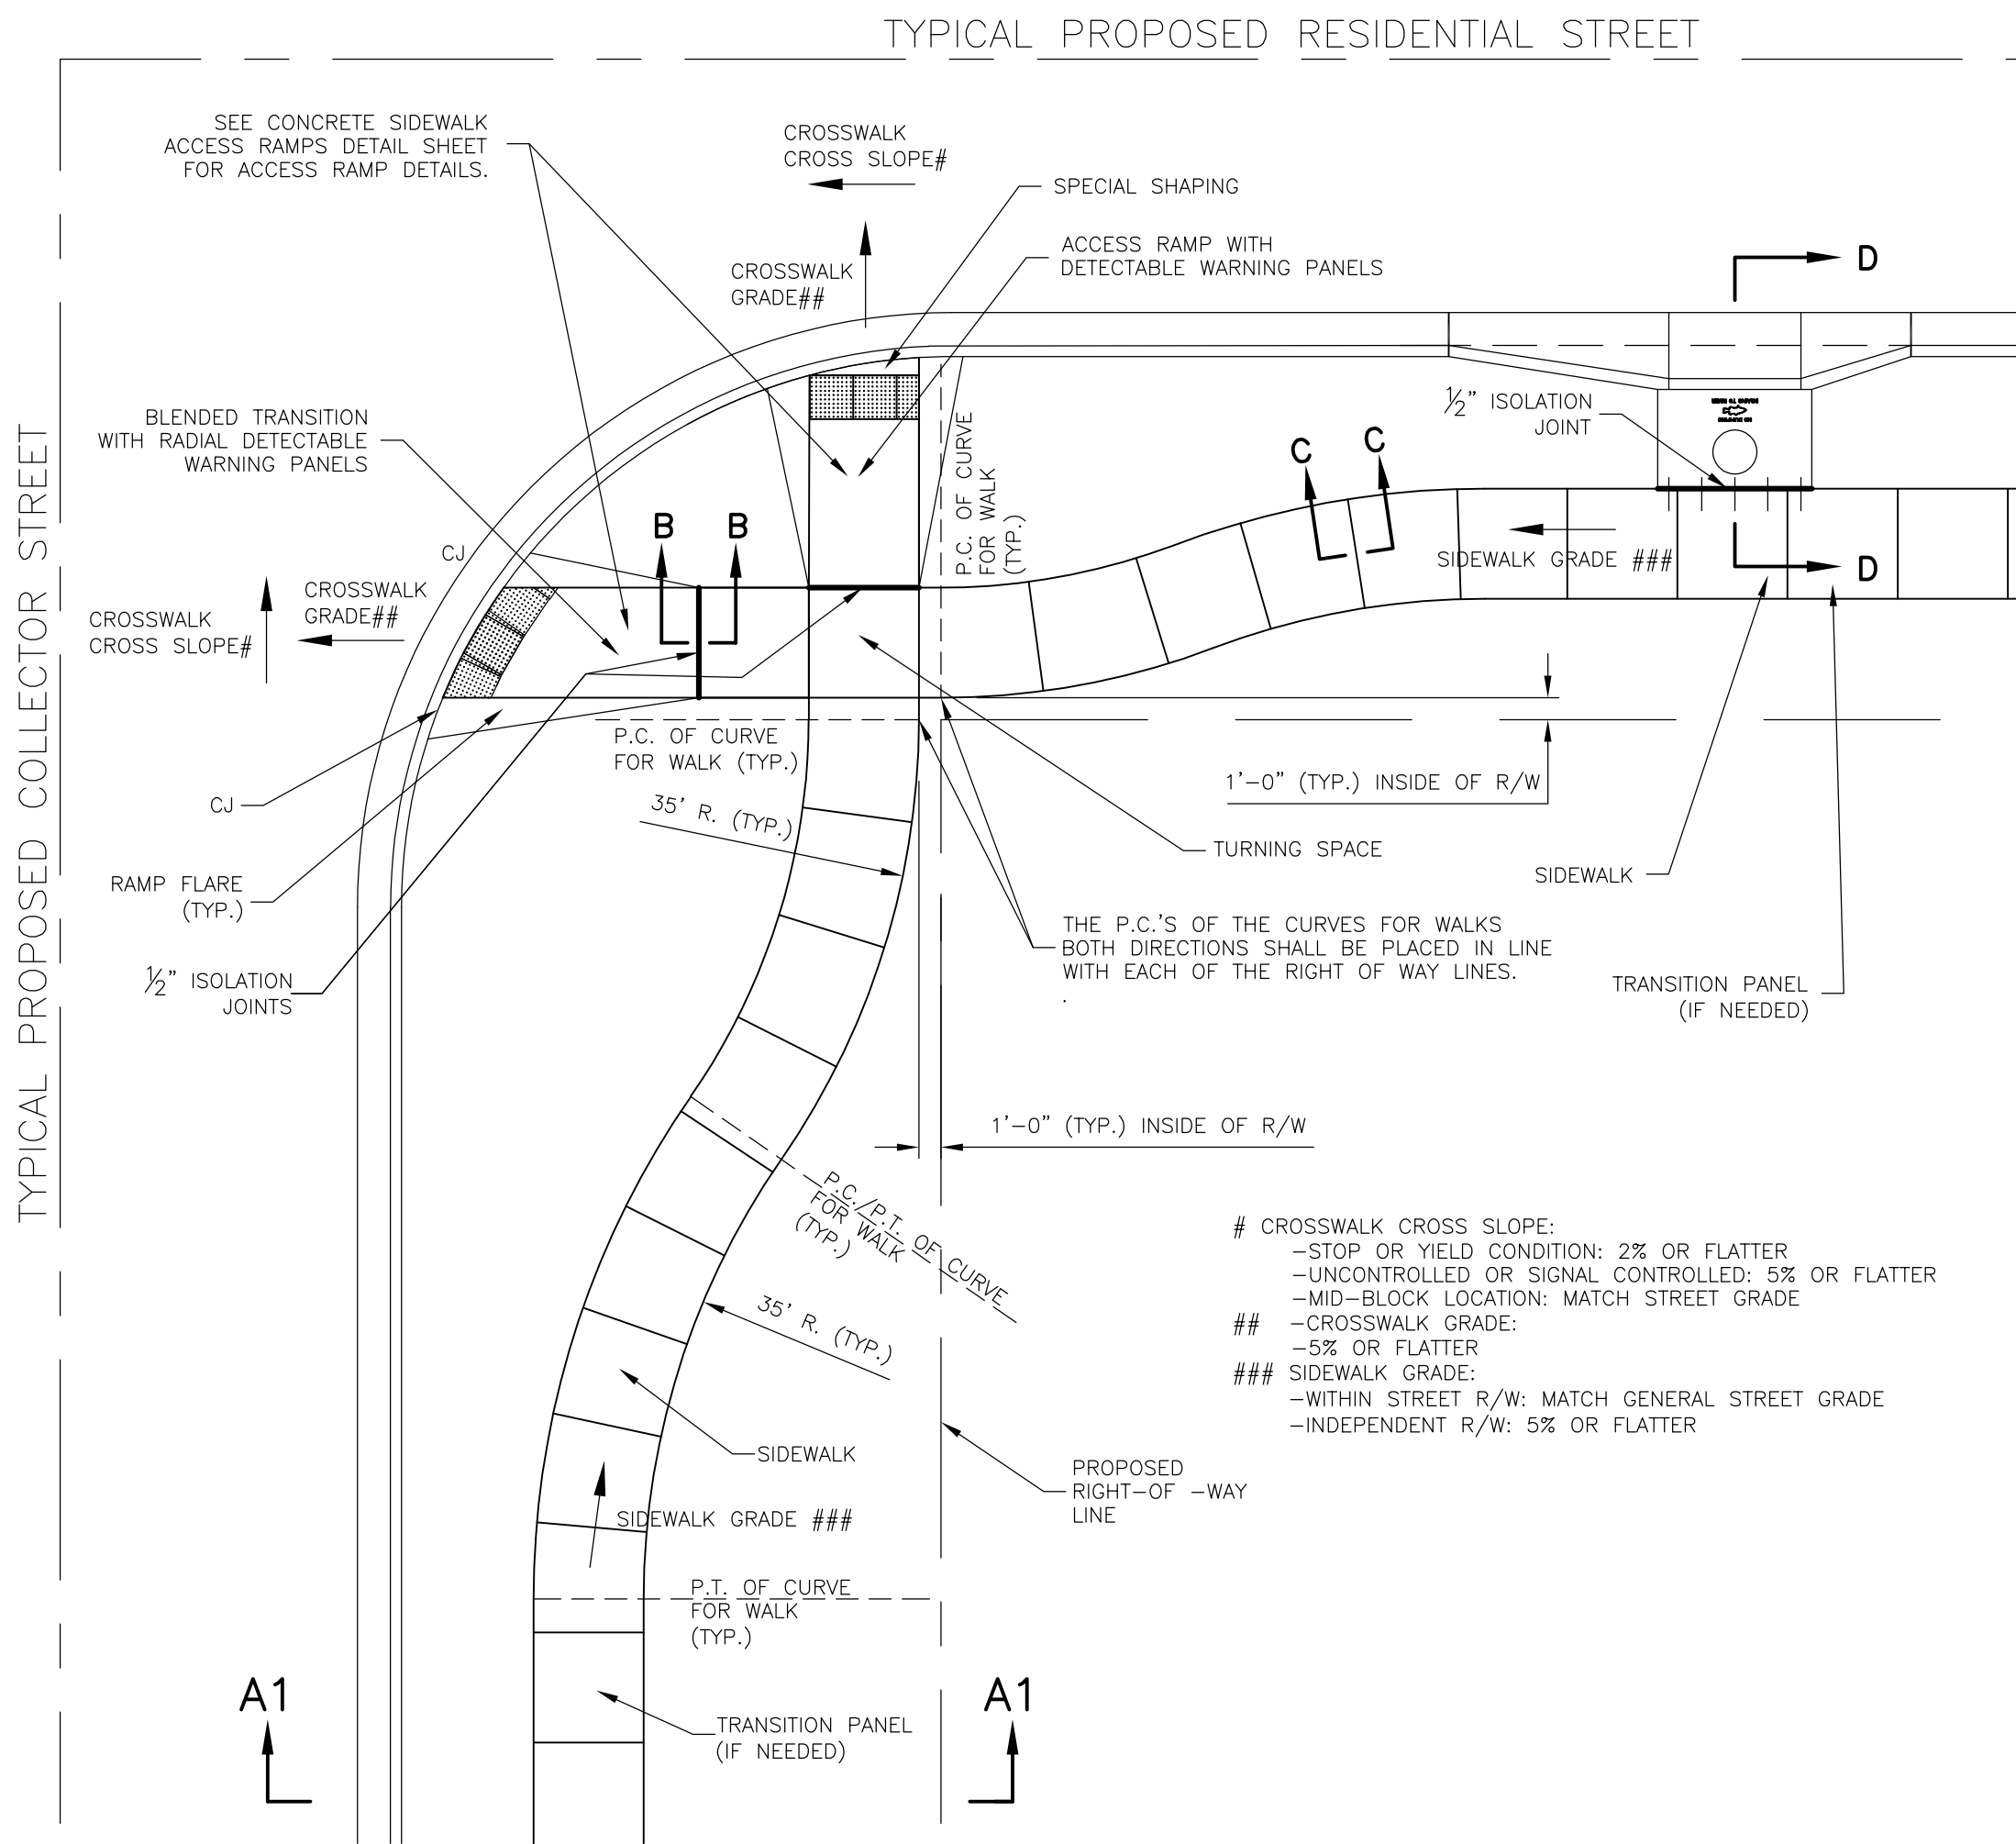

GENERAL SIDEWALK LAYOUT PLAN

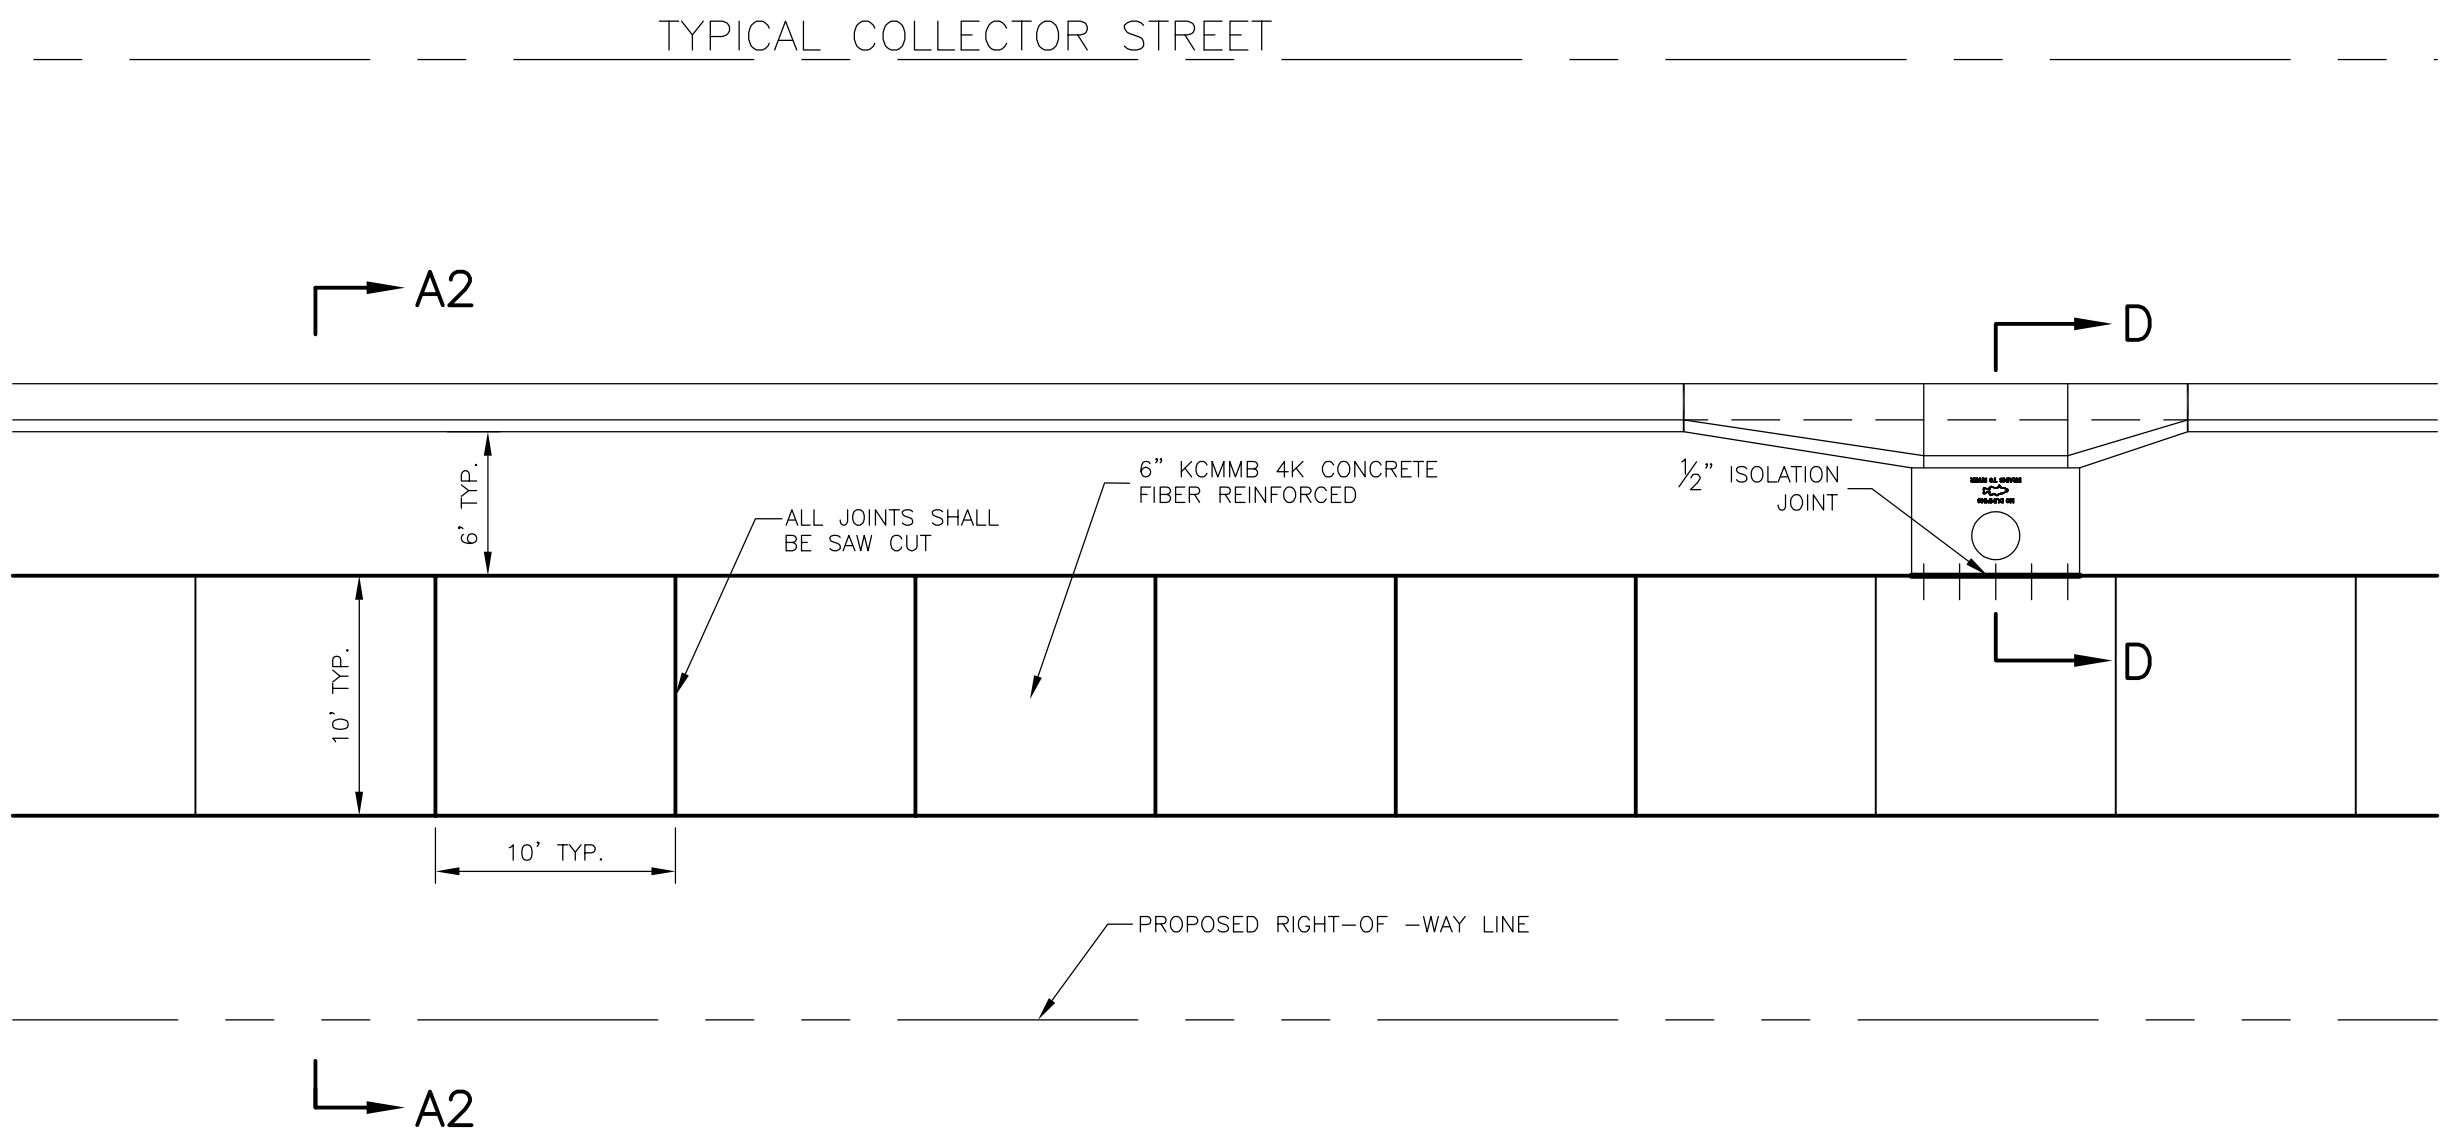


GENERAL SHARED USE PATH LAYOUT PLAN

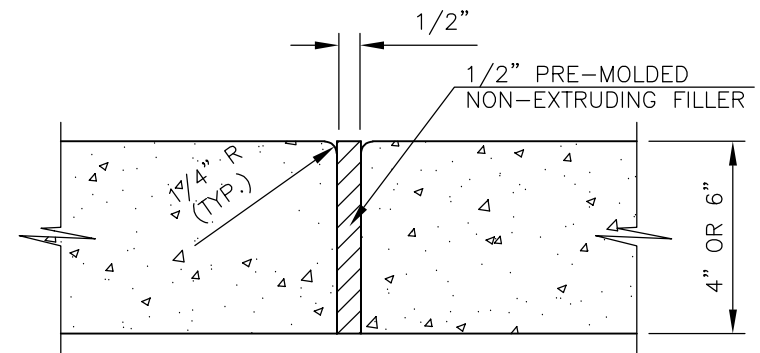


SECTION B-B
ISOLATION JOINT

NOTE: A GRADE BREAK SHOULD NOT BE PLACED BETWEEN THE TURNING SPACE AND BOTTOM OF RAMP, UNLESS A LANDING IS REQUIRED FOR SIGNAL PUSH BUTTONS, OR IN THE CASE OF LONG RAMP. GRADE SHOULD GENERALLY BE CONSTANT BETWEEN GRADE BREAK AT BOTTOM OF RAMP AND TURNING SPACE.

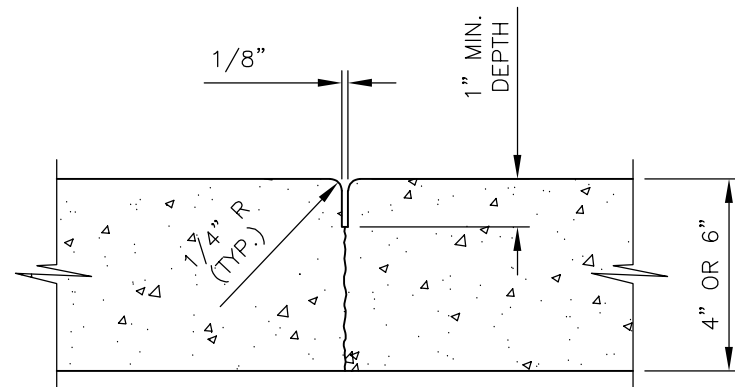


SECTION C-C
CONTRACTION JOINT
(SAWED OR FORMED)


WHERE SIDEWALKS ADJOIN STORM SEWER STRUCTURES, #4 DOWELS SHALL BE PLACED 18" ON CENTER. DOWELS SHALL BE 18" LONG WITH 6" IN THE STRUCTURE TOP, THROUGH ISOLATION JOINT.

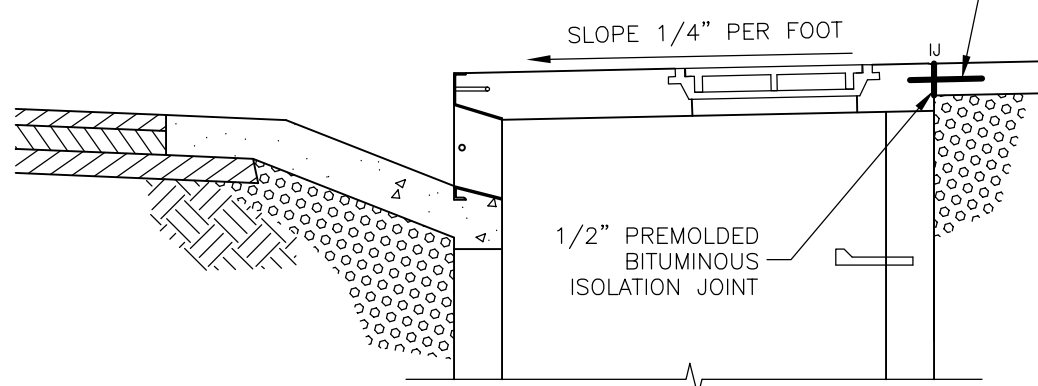


SECTION D-D
SIDEWALK TO INLET DOWELING DETAIL

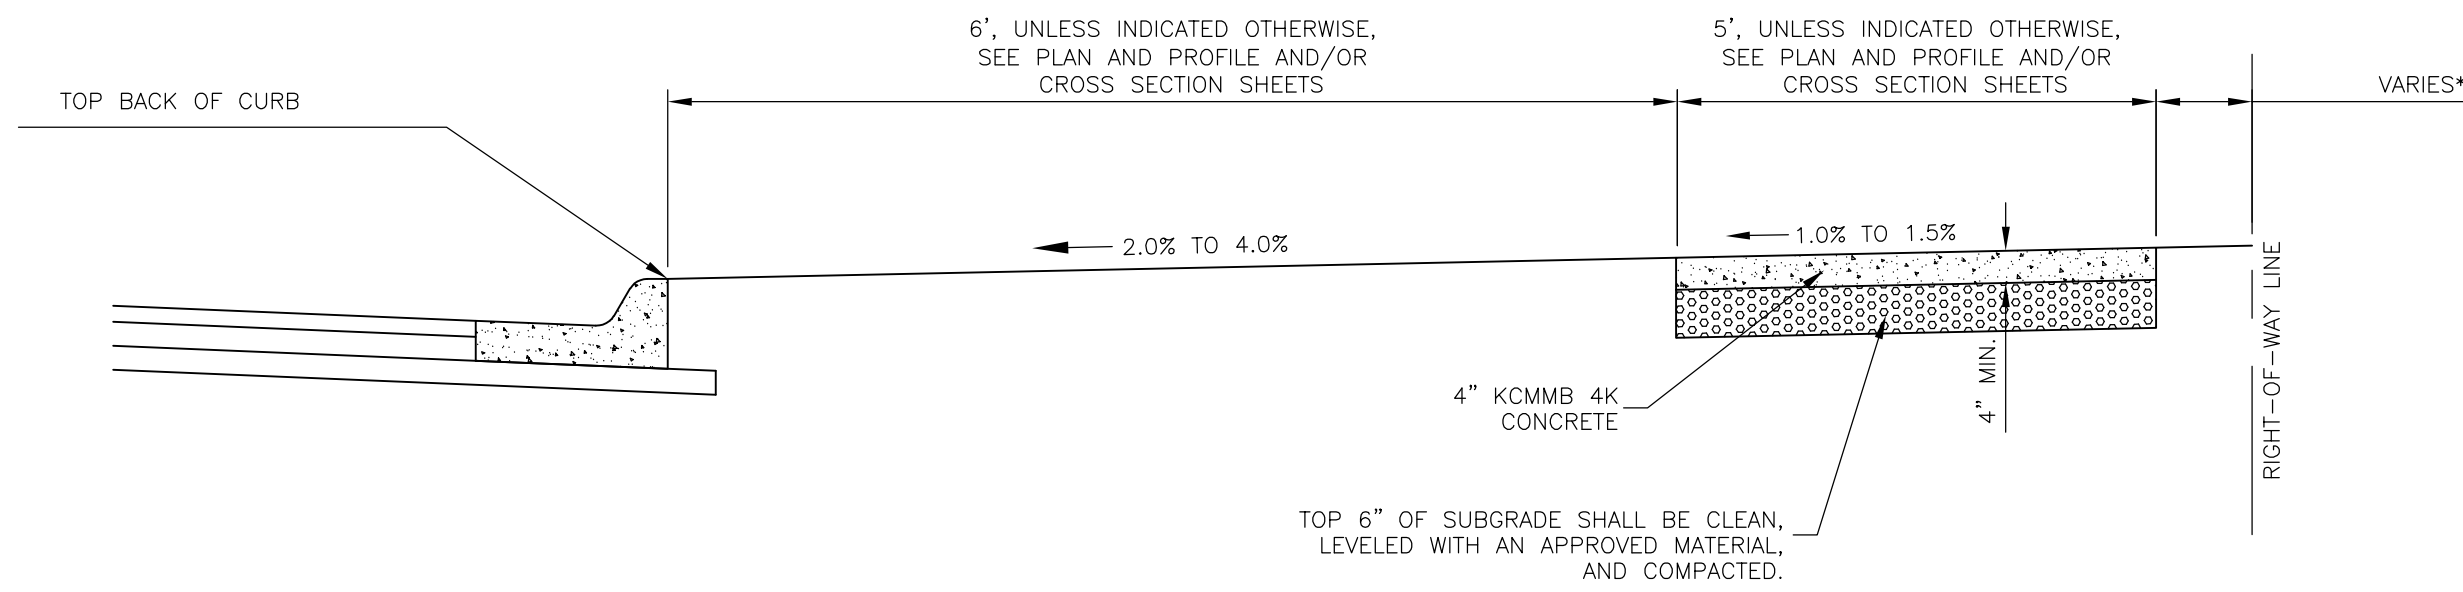


SECTION A1-A1

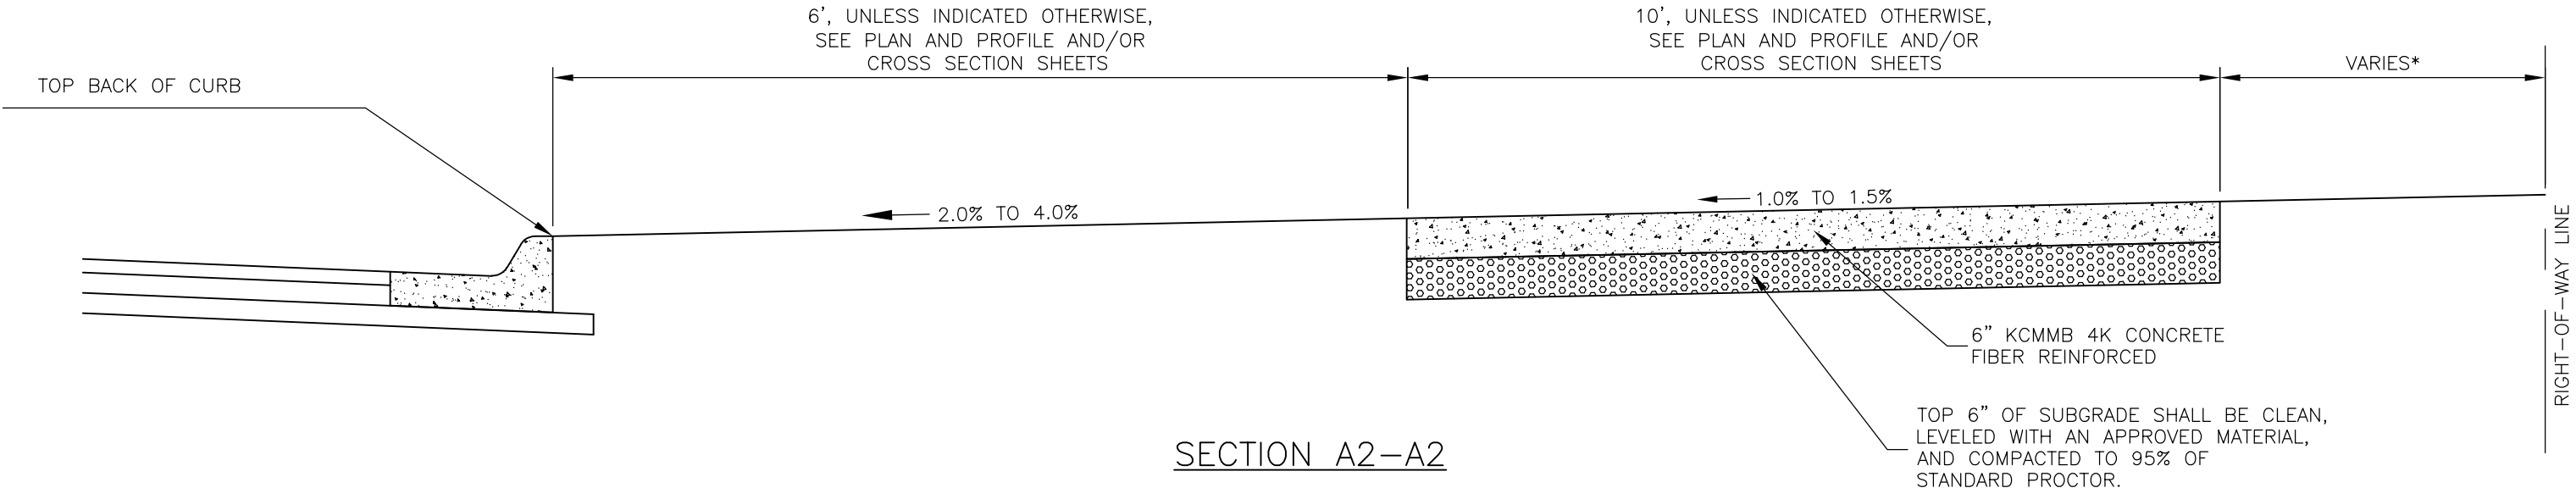

SECTION A2-A2

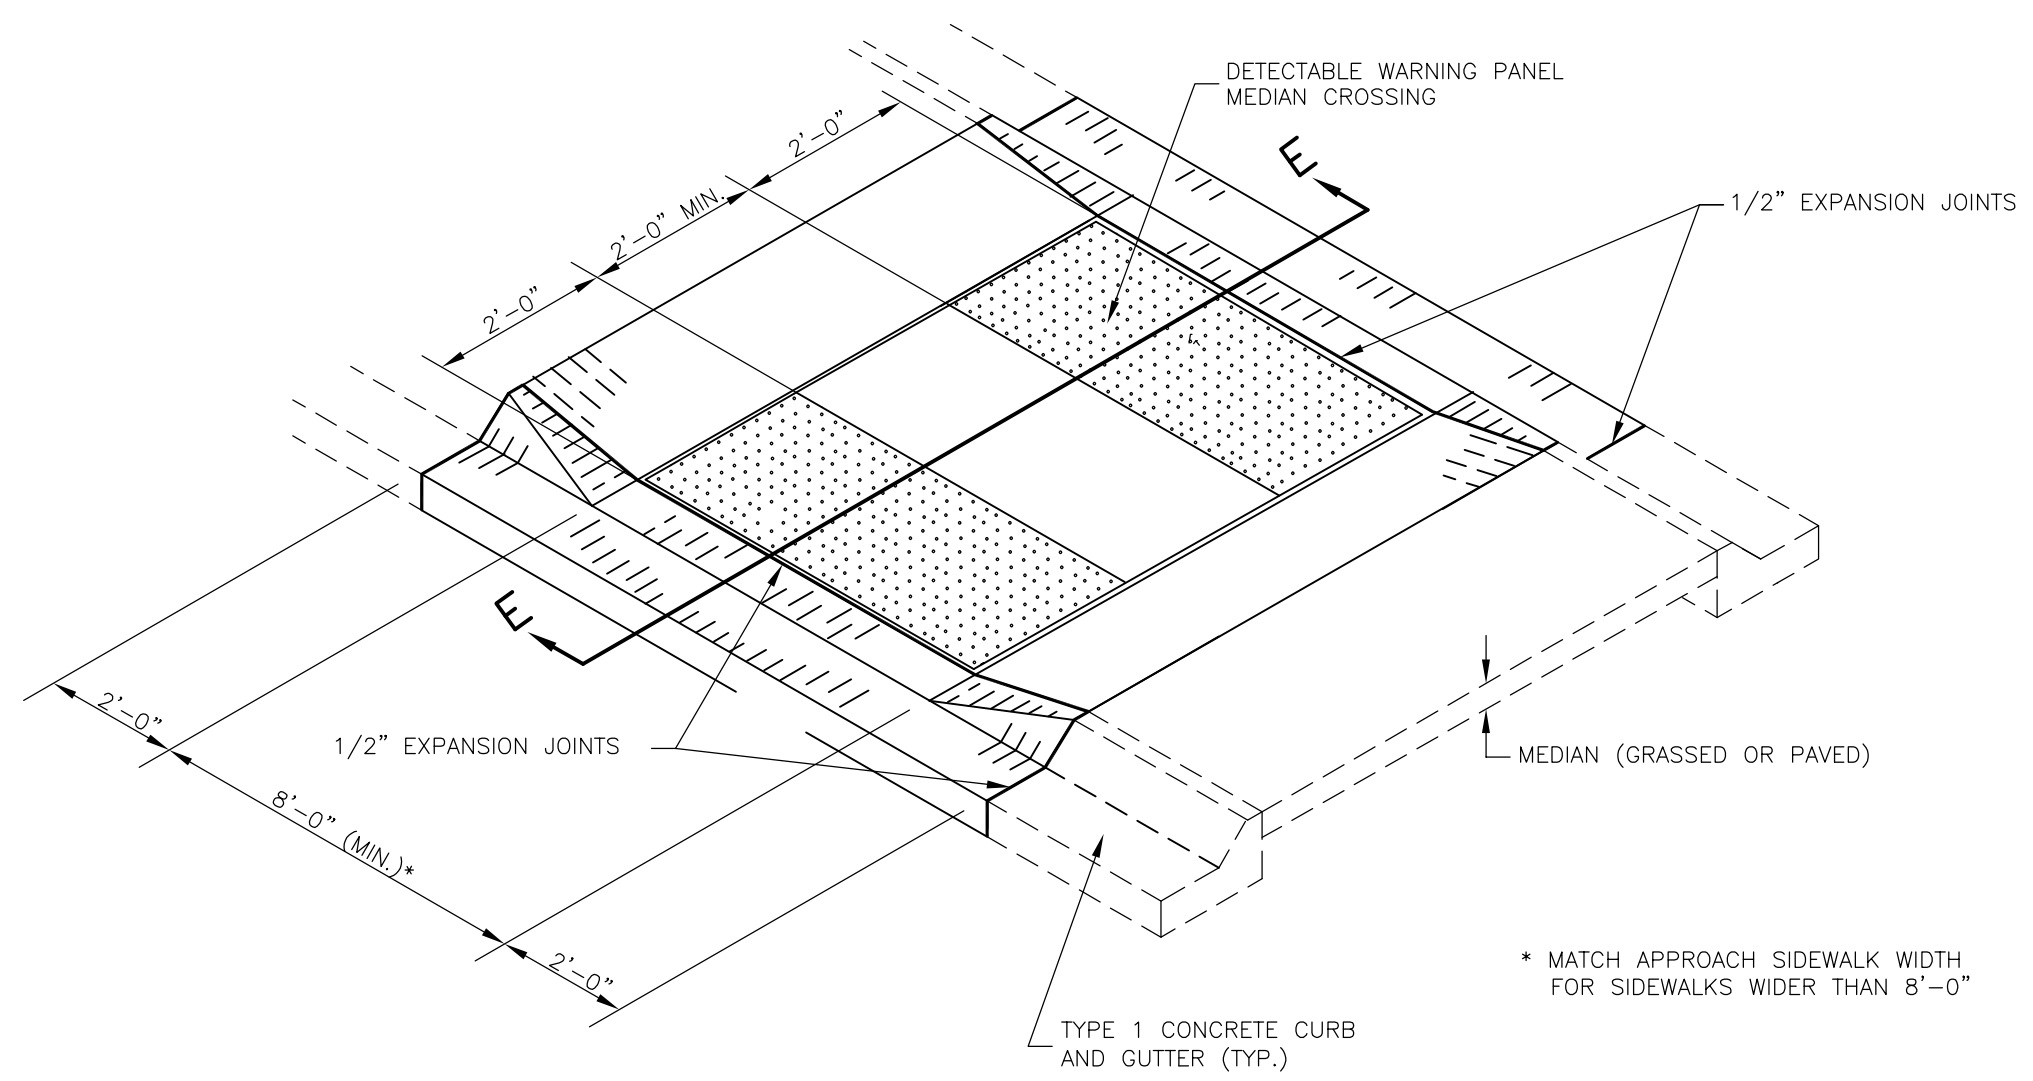

MEDIAN RAMP CROSSING PLAN

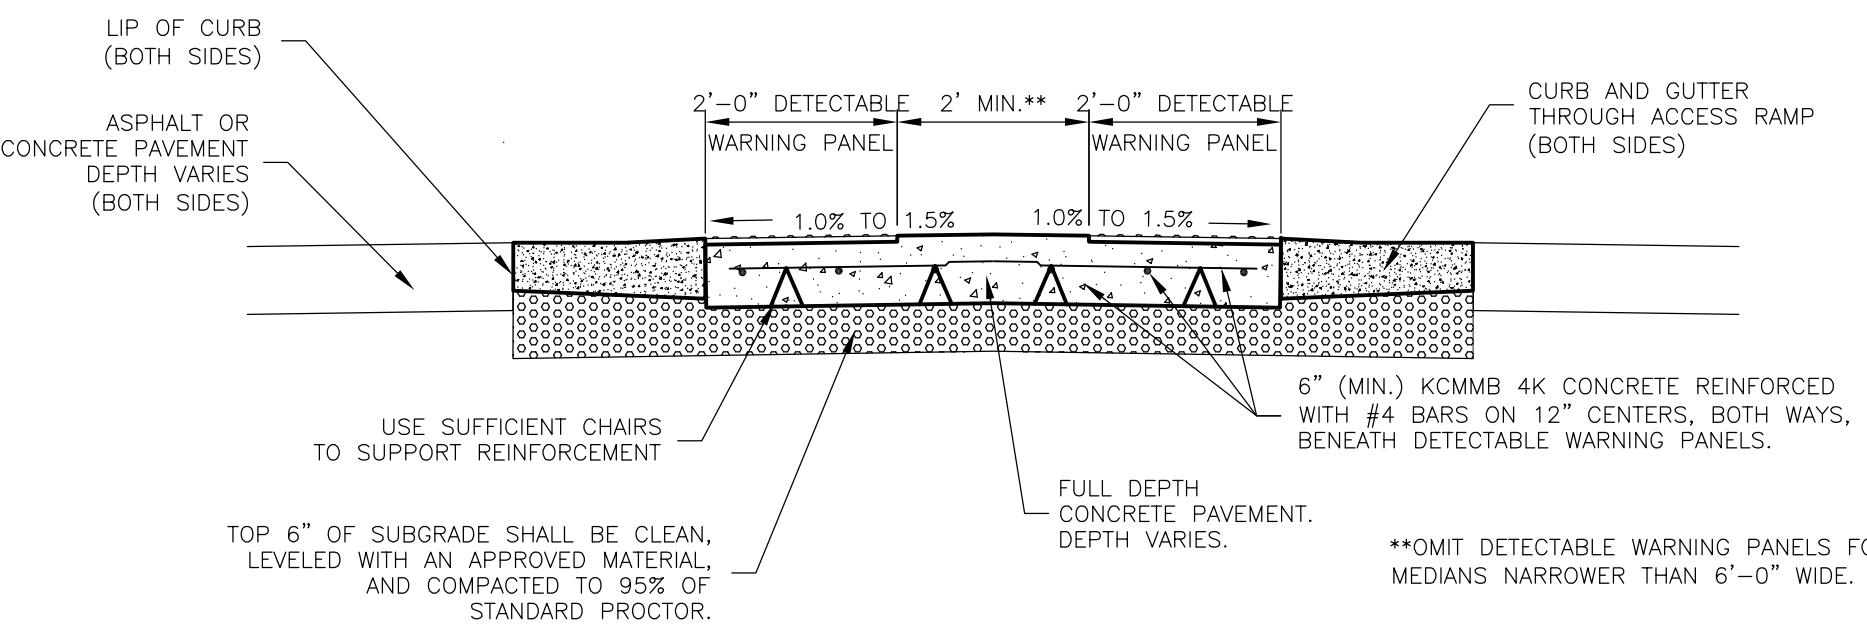

SECTION E-E

- SIDEWALK GENERAL NOTES**
1. CONSTRUCTION JOINTS SHALL BE PLACED IN 5'-0" WIDE SIDEWALKS AT A MINIMUM OF 5'-0" INTERVALS. WHEN OTHER WIDTHS OF SIDEWALK ARE USED, CONSTRUCTION JOINTS SHALL BE PLACED AS DIRECTED BY THE CITY ENGINEER OR AN AUTHORIZED REPRESENTATIVE.
 2. ISOLATION JOINTS SHALL BE PLACED AT ALL LOCATIONS WHERE SIDEWALK ABUTS EXISTING STRUCTURES AND AS DIRECTED BY THE CITY ENGINEER OR AN AUTHORIZED REPRESENTATIVE.
 3. ACCESS RAMP SHALL BE CONSTRUCTED AT ALL LOCATIONS WHERE SIDEWALKS INTERSECT NEW STREET CONSTRUCTION AND AS OTHERWISE SHOWN ON THE PLANS.
 4. ALL SHARED USE PATH JOINTS SHALL BE SAW CUT.
 5. ALL SIDEWALKS AND RAMP MUST BE CONSTRUCTED TO CURRENT PROWAG STANDARDS.
 6. THERE SHALL BE NO GRADE BREAKS ON THE RAMP. GRADE SHOULD BE CONSTANT BETWEEN GRADE BREAK AT BOTTOM OF RAMP AND TURNING SPACE.
 7. SIDEWALK CURB FOR ADA COMPLIANCE IS SUBSIDIARY TO THE RAMP.
 8. GRADING REQUIRED TO FACILITATE DRAINAGE BETWEEN THE SIDEWALK AND CURB IS SUBSIDIARY TO THE RAMP.


DATE	BY	REVISION
03-01-21	LJM	REPLACES ALL PREVIOUS VERSIONS OF CONCRETE SIDEWALK AND SHARED USE PATH LAYOUTS DETAILS
03-01-20	LJM	REPLACES ALL PREVIOUS VERSIONS OF CONCRETE SIDEWALK AND SHARED USE PATH LAYOUTS DETAILS




STANDARD DETAILS FOR
CONCRETE SIDEWALK AND SHARED USE PATH LAYOUTS

DAVID P. CRONIN CITY ENGINEER CRAIG S. OWENS CITY MANAGER



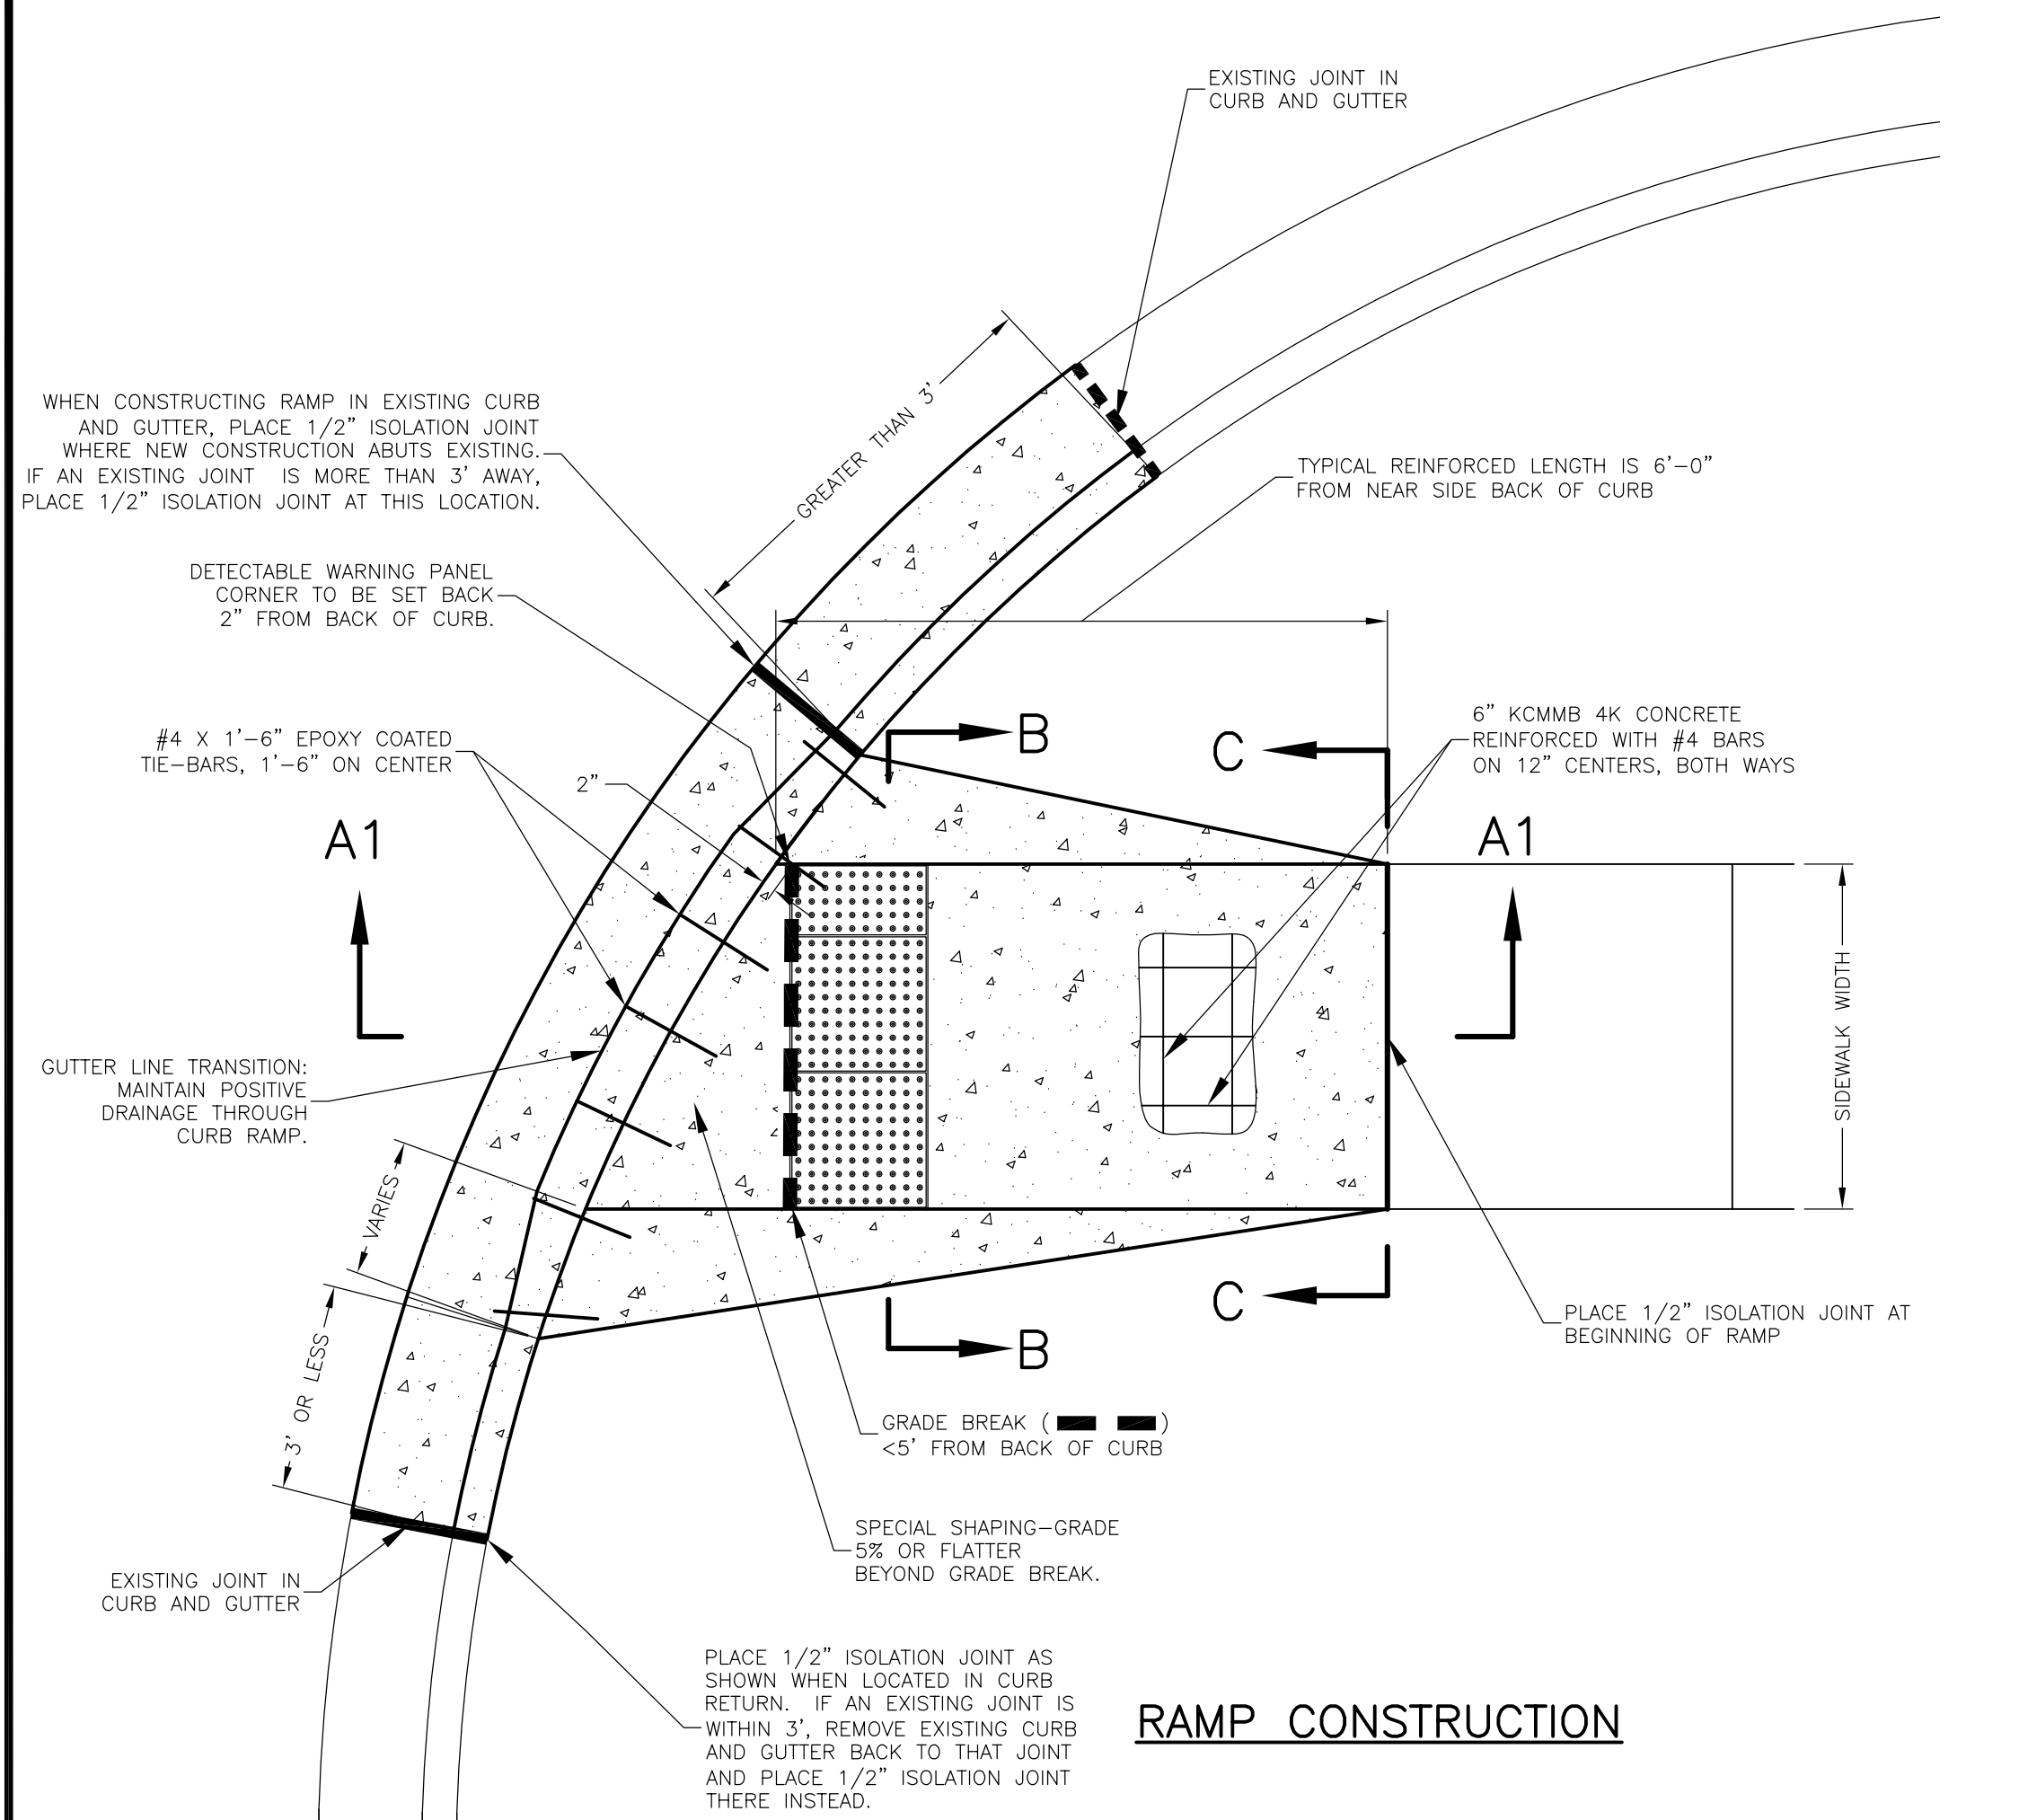


RAMP CONSTRUCTION

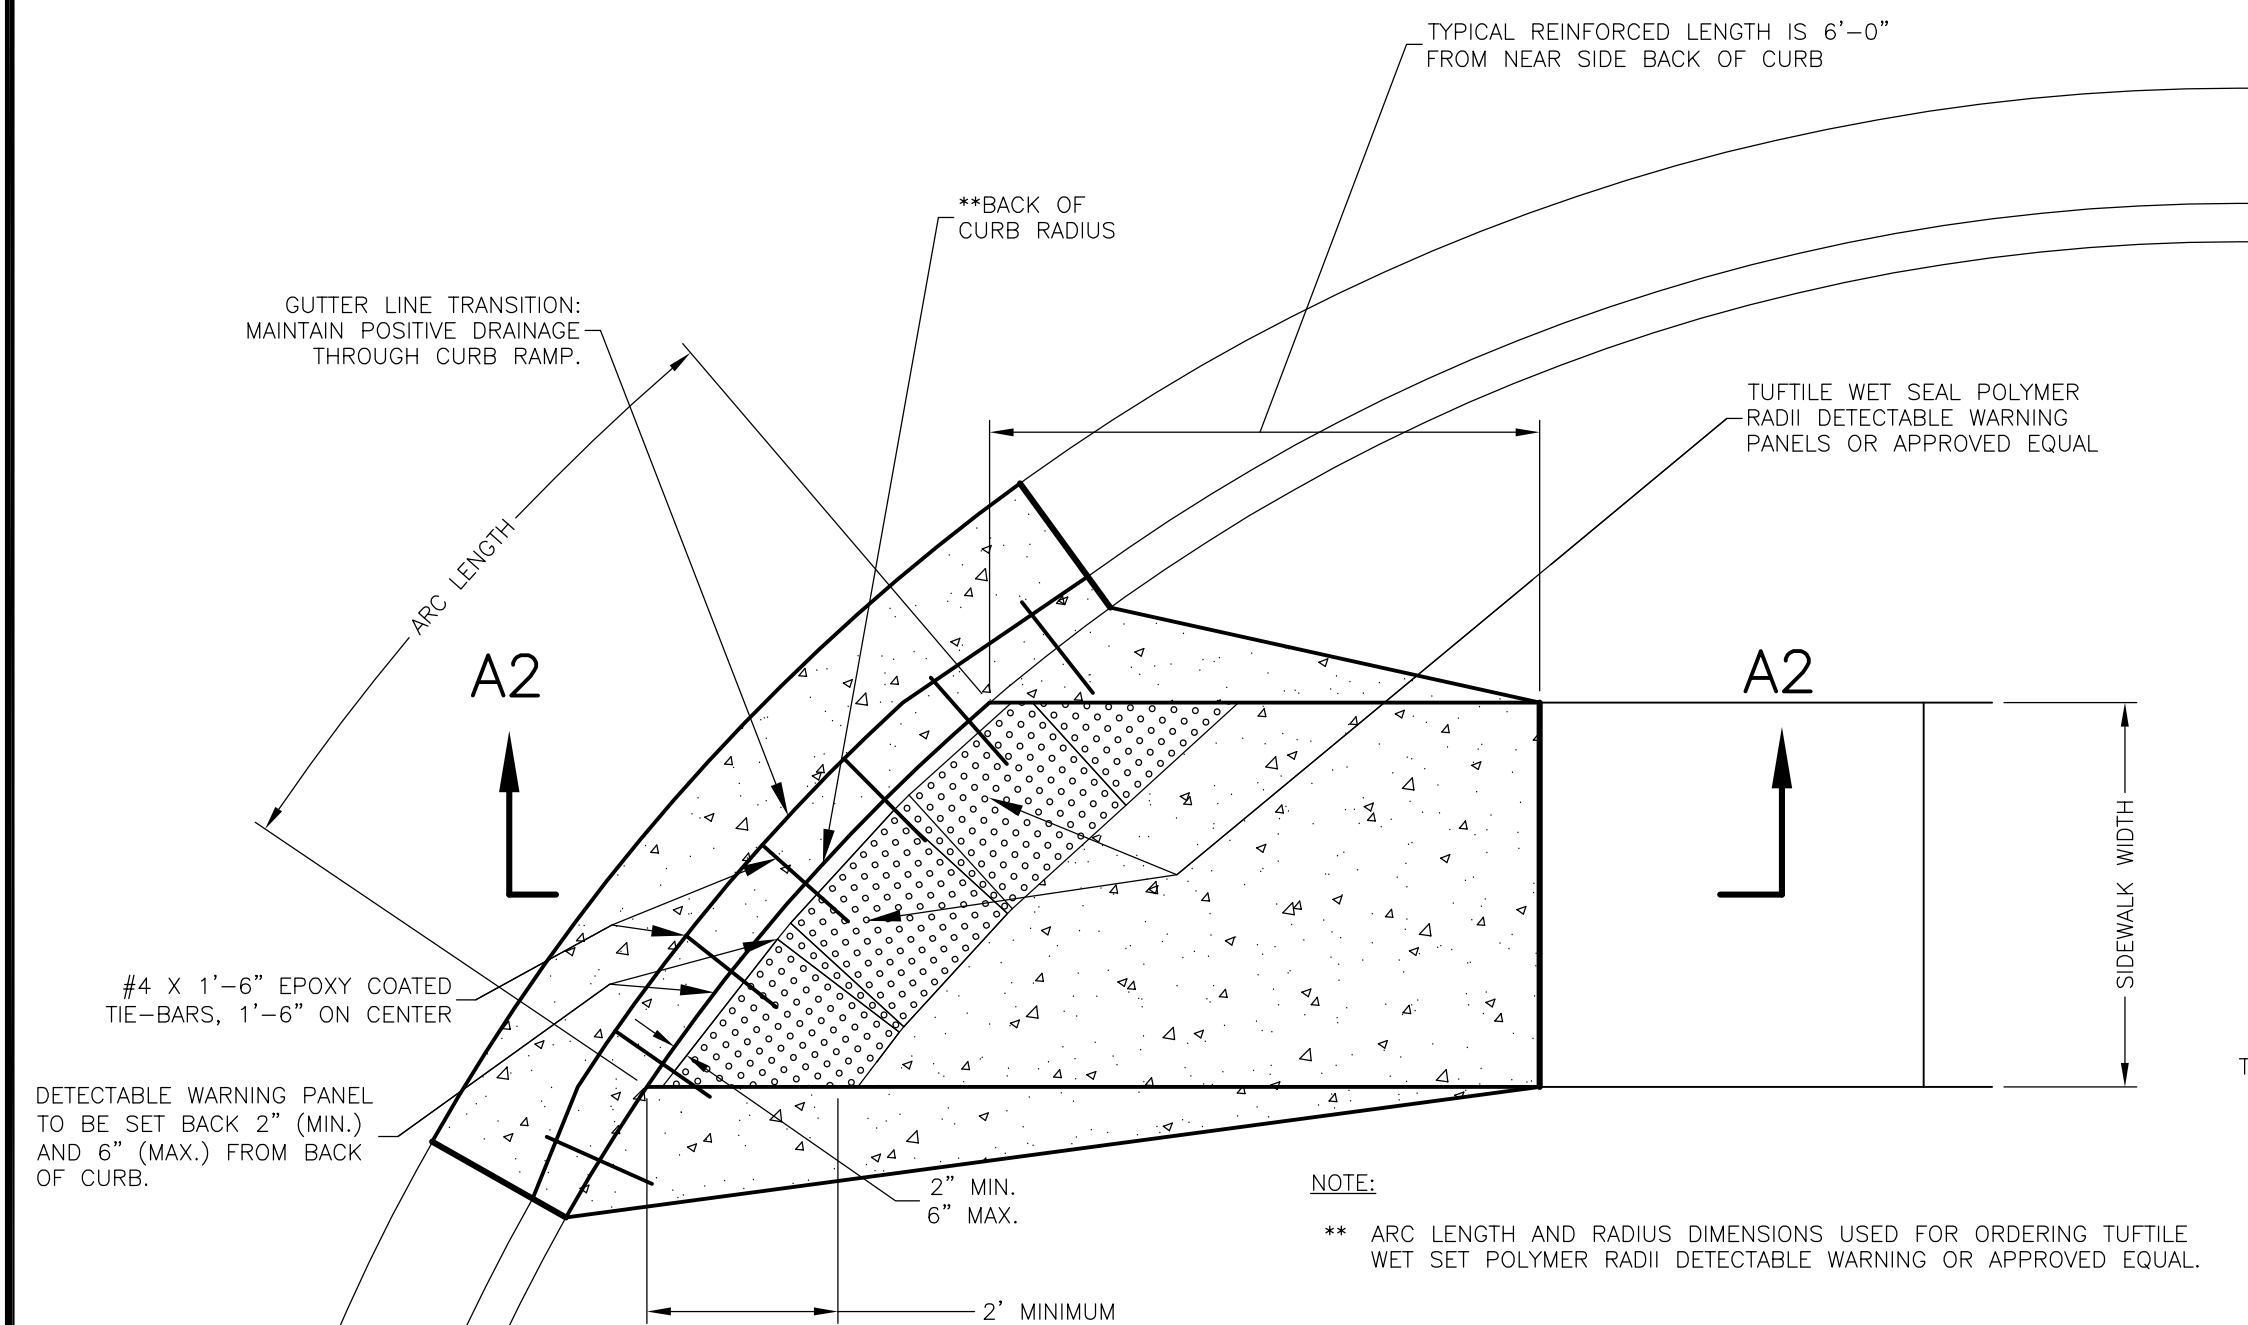


RAMP WITH RADIAL DETECTABLE WARNING


- NOTES
1. FLARED SIDES SHALL BE 10% OR FLATTER SLOPE, IF ADJACENT TO SIDEWALK, AND 25% OR FLATTER SLOPE, IF ADJACENT TO LANDSCAPED AREAS.
 2. IF THE SPECIAL SHAPING DISTANCE EXCEEDS 5' FROM THE BACK OF CURB, THEN REFER TO THE "BLENDED TRANSITION DETECTABLE WARNING SURFACE DETAIL". IF USING RADIAL DETECTABLE WARNINGS, BLENDED TRANSITION SHOULD HAVE A 4% OR FLATTER SLOPE.
 3. DETECTABLE WARNING DOMES SHALL BE ALIGNED PERPENDICULAR TO THE GRADE BREAK BETWEEN THE RAMP RUN AND STREET, UNLESS A BLENDED TRANSITION AND USING RADIAL DOMES.
 4. DETECTABLE WARNINGS SHALL CONTINUOUSLY EXTEND FOR A MINIMUM OF 24" IN THE PATH OF TRAVEL.
 5. DIMENSIONS SHOWN IN THIS DRAWING ARE TARGET DESIGN VALUES. ALL SIDEWALKS AND RAMPS MUST BE CONSTRUCTED TO CURRENT PROWAG STANDARDS.
 6. IF GRADES DO NOT ALLOW RAMP TO BE CONSTRUCTED BASED ON SLOPES SHOWN, OVERALL LENGTH MAY BE LIMITED TO 15'. EXACT LIMITS TO BE APPROVED BY THE ENGINEER.
 7. COMPACTED SUBGRADE SHALL BE CLEAN, LEVELED WITH AN APPROPRIATE MATERIAL, AND COMPACTED.
 8. THE TERMS "RAMP" AND "BLENDED TRANSITION" REFER TO THE GEOMETRIC REQUIREMENTS OF PROWAG, NOT PAY ITEMS. THE FIRST 6'-0" OF A RAMP OR BLENDED TRANSITION SHALL BE "REINFORCED CONCRETE SIDEWALK", BEYOND 6'-0", THE RAMP OR BLENDED TRANSITION, SHALL BE "CONCRETE SIDEWALK", DETECTABLE WARNINGS SHALL BE MEASURED SEPARATELY. TYPICAL BID ITEMS ARE:
 -CONCRETE SIDEWALK (4"), SY
 -CONCRETE RECREATIONAL PATH (6" FIBER REINFORCED), SY
 -INTEGRAL CONCRETE SIDEWALK AND RETAINING WALL, LF
 -REINFORCED CONCRETE SIDEWALK (ADJACENT TO CURB), SF
 -DETECTABLE WARNING PANELS, SF
 -DETECTABLE WARNING PANELS (RADIAL, XX FT. RADIUS), SF
 -CONCRETE MEDIAN REINFORCED SIDEWALK CROSSING, SF
 9. SIDEWALK CURB FOR ADA COMPLIANCE IS SUBSIDIARY TO THE RAMP.
 10. GRADING REQUIRED TO FACILITATE DRAINAGE BETWEEN THE SIDEWALK AND CURB IS SUBSIDIARY TO THE RAMP.

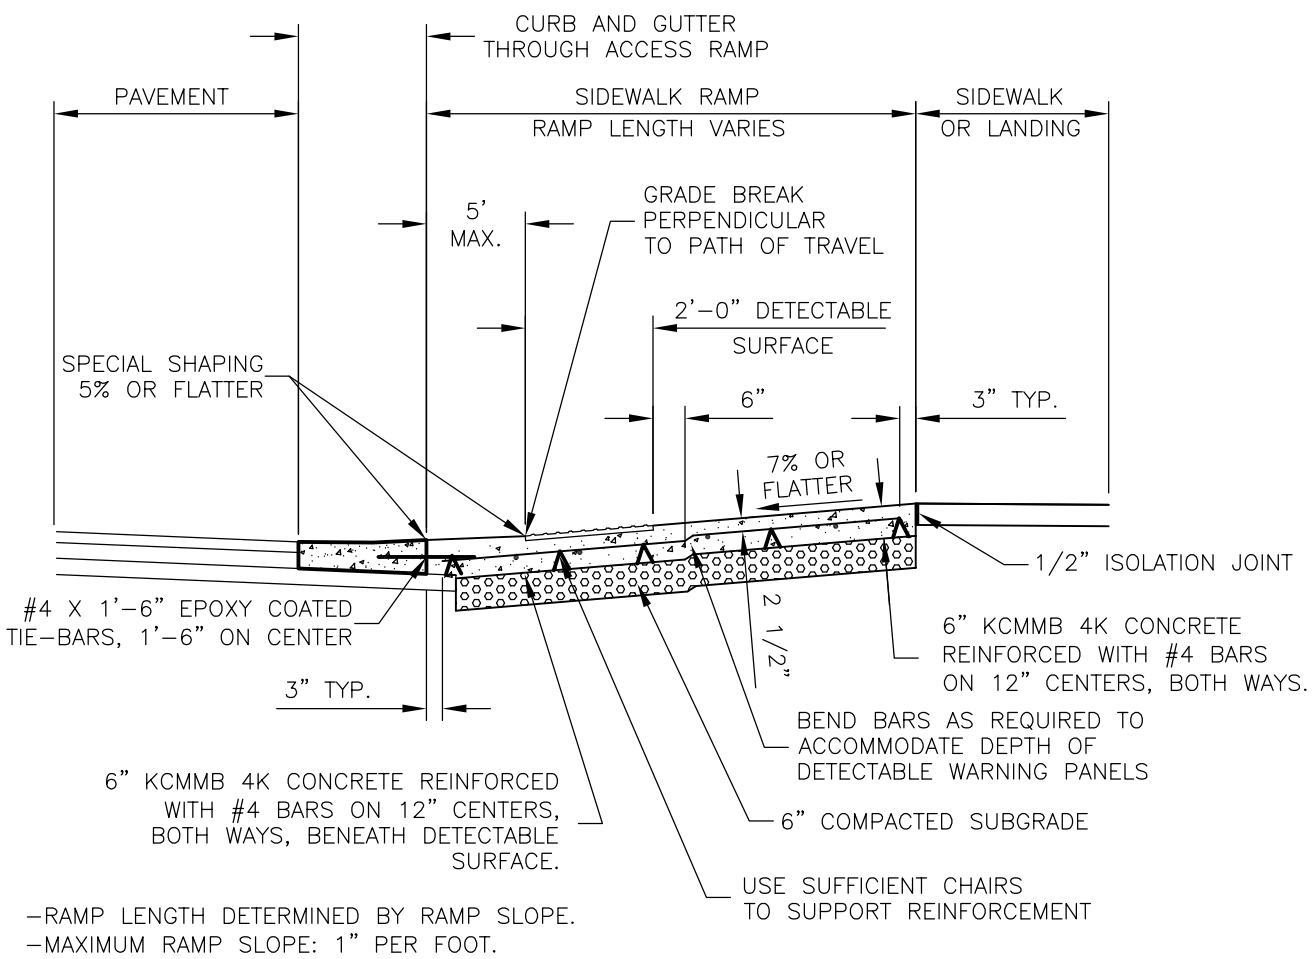


SECTION A1-A1

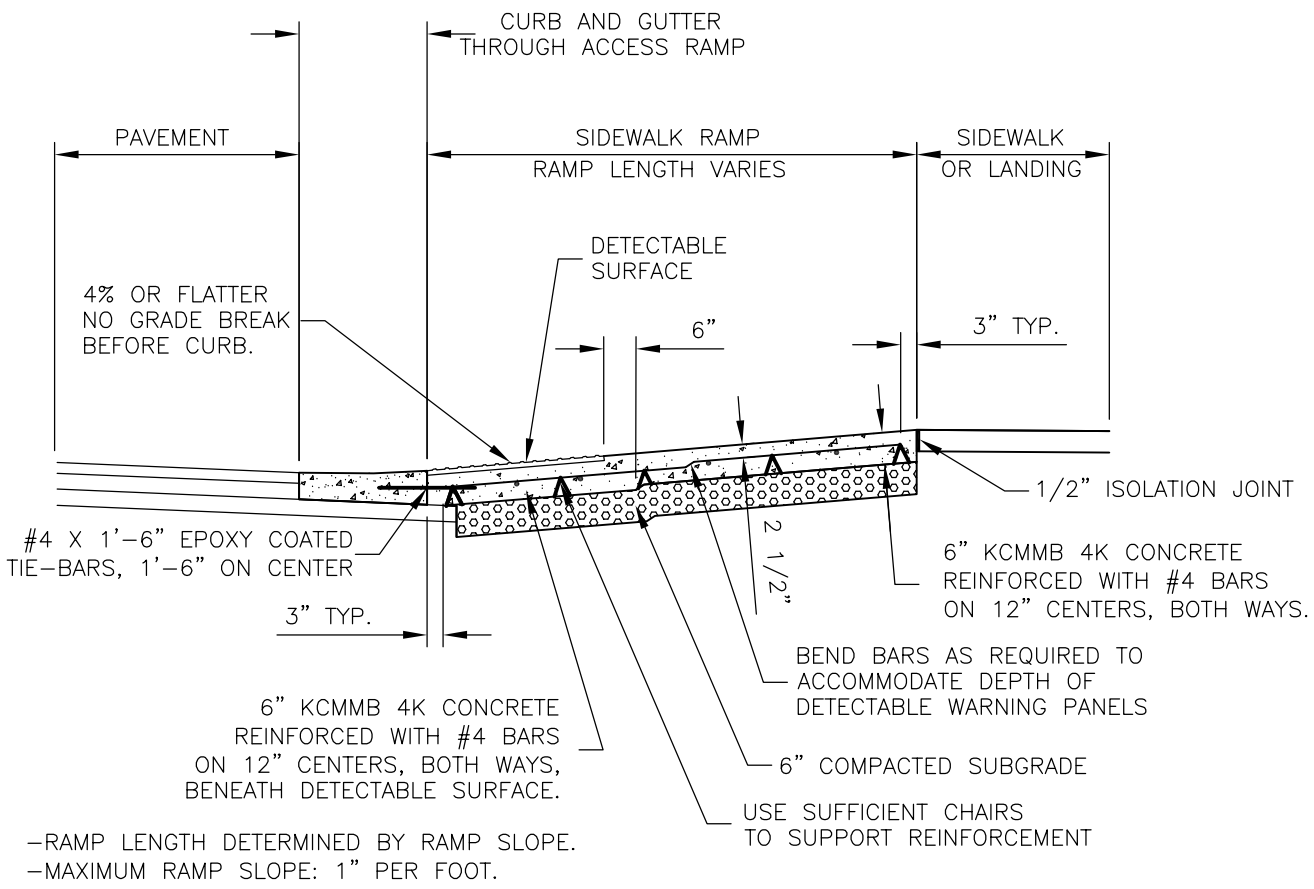


SECTION A2-A2

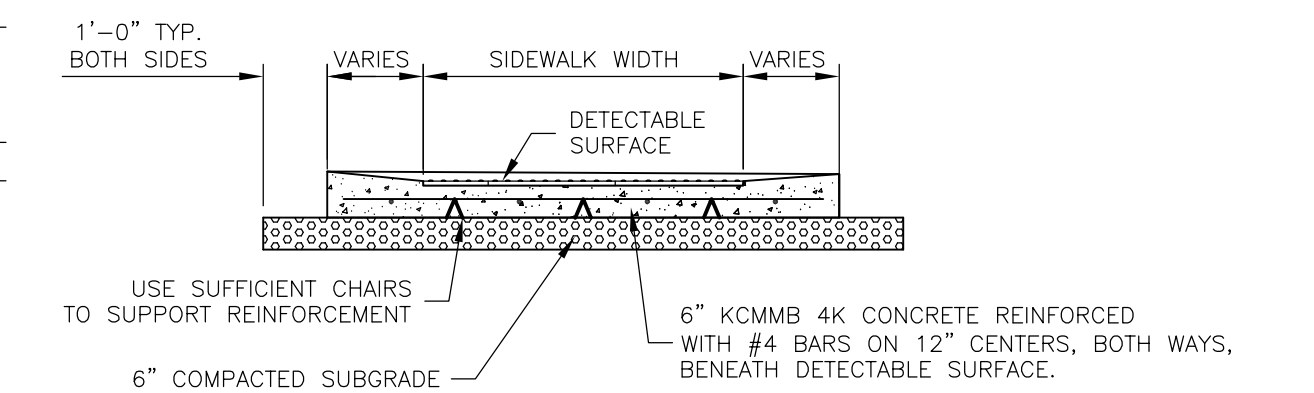

SECTION B-B

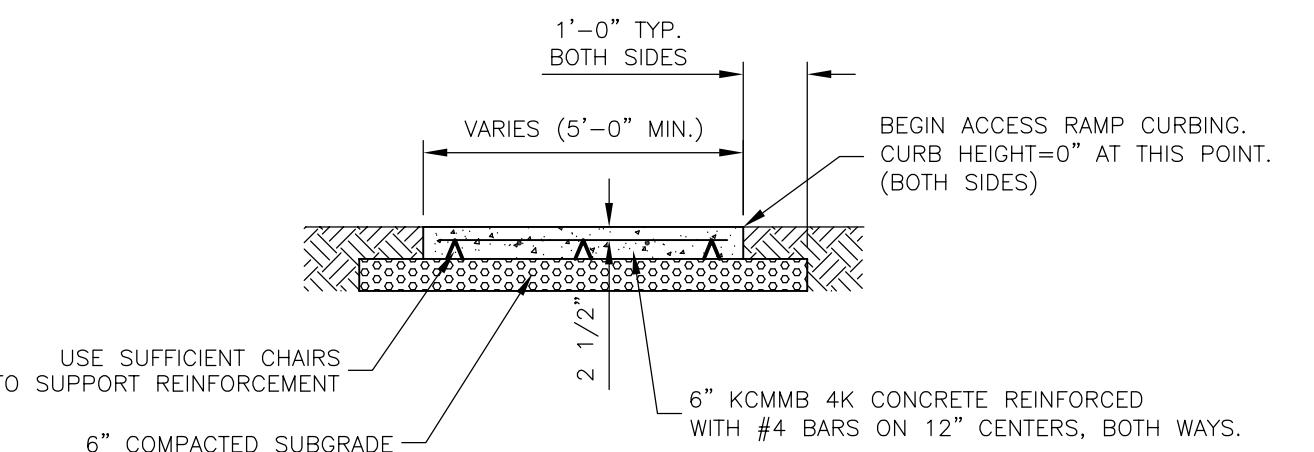


SECTION C-C

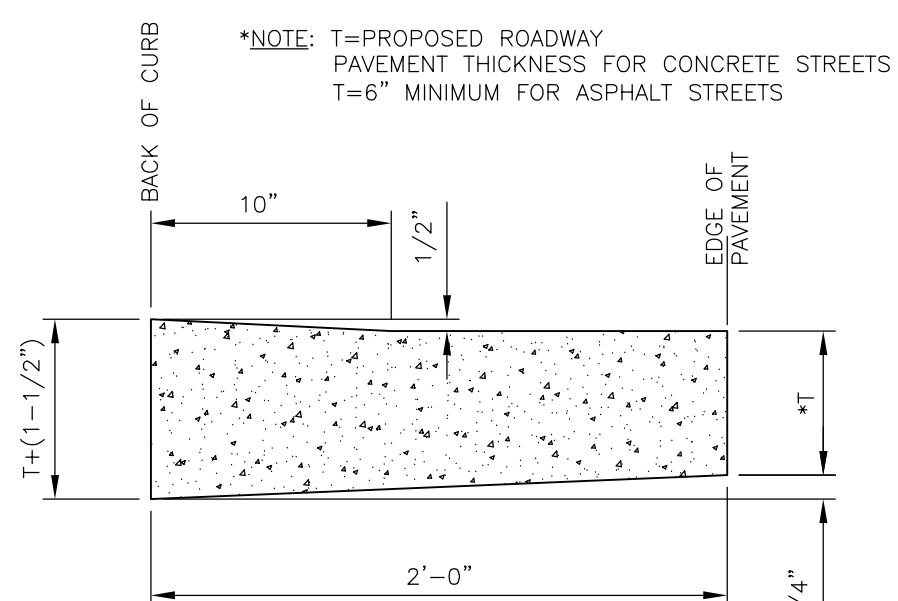


CURB AND GUTTER THROUGH ACCESS RAMP


PAID AS CURB TYPE ADJACENT TO CURB RAMP BY LINEAR FOOT

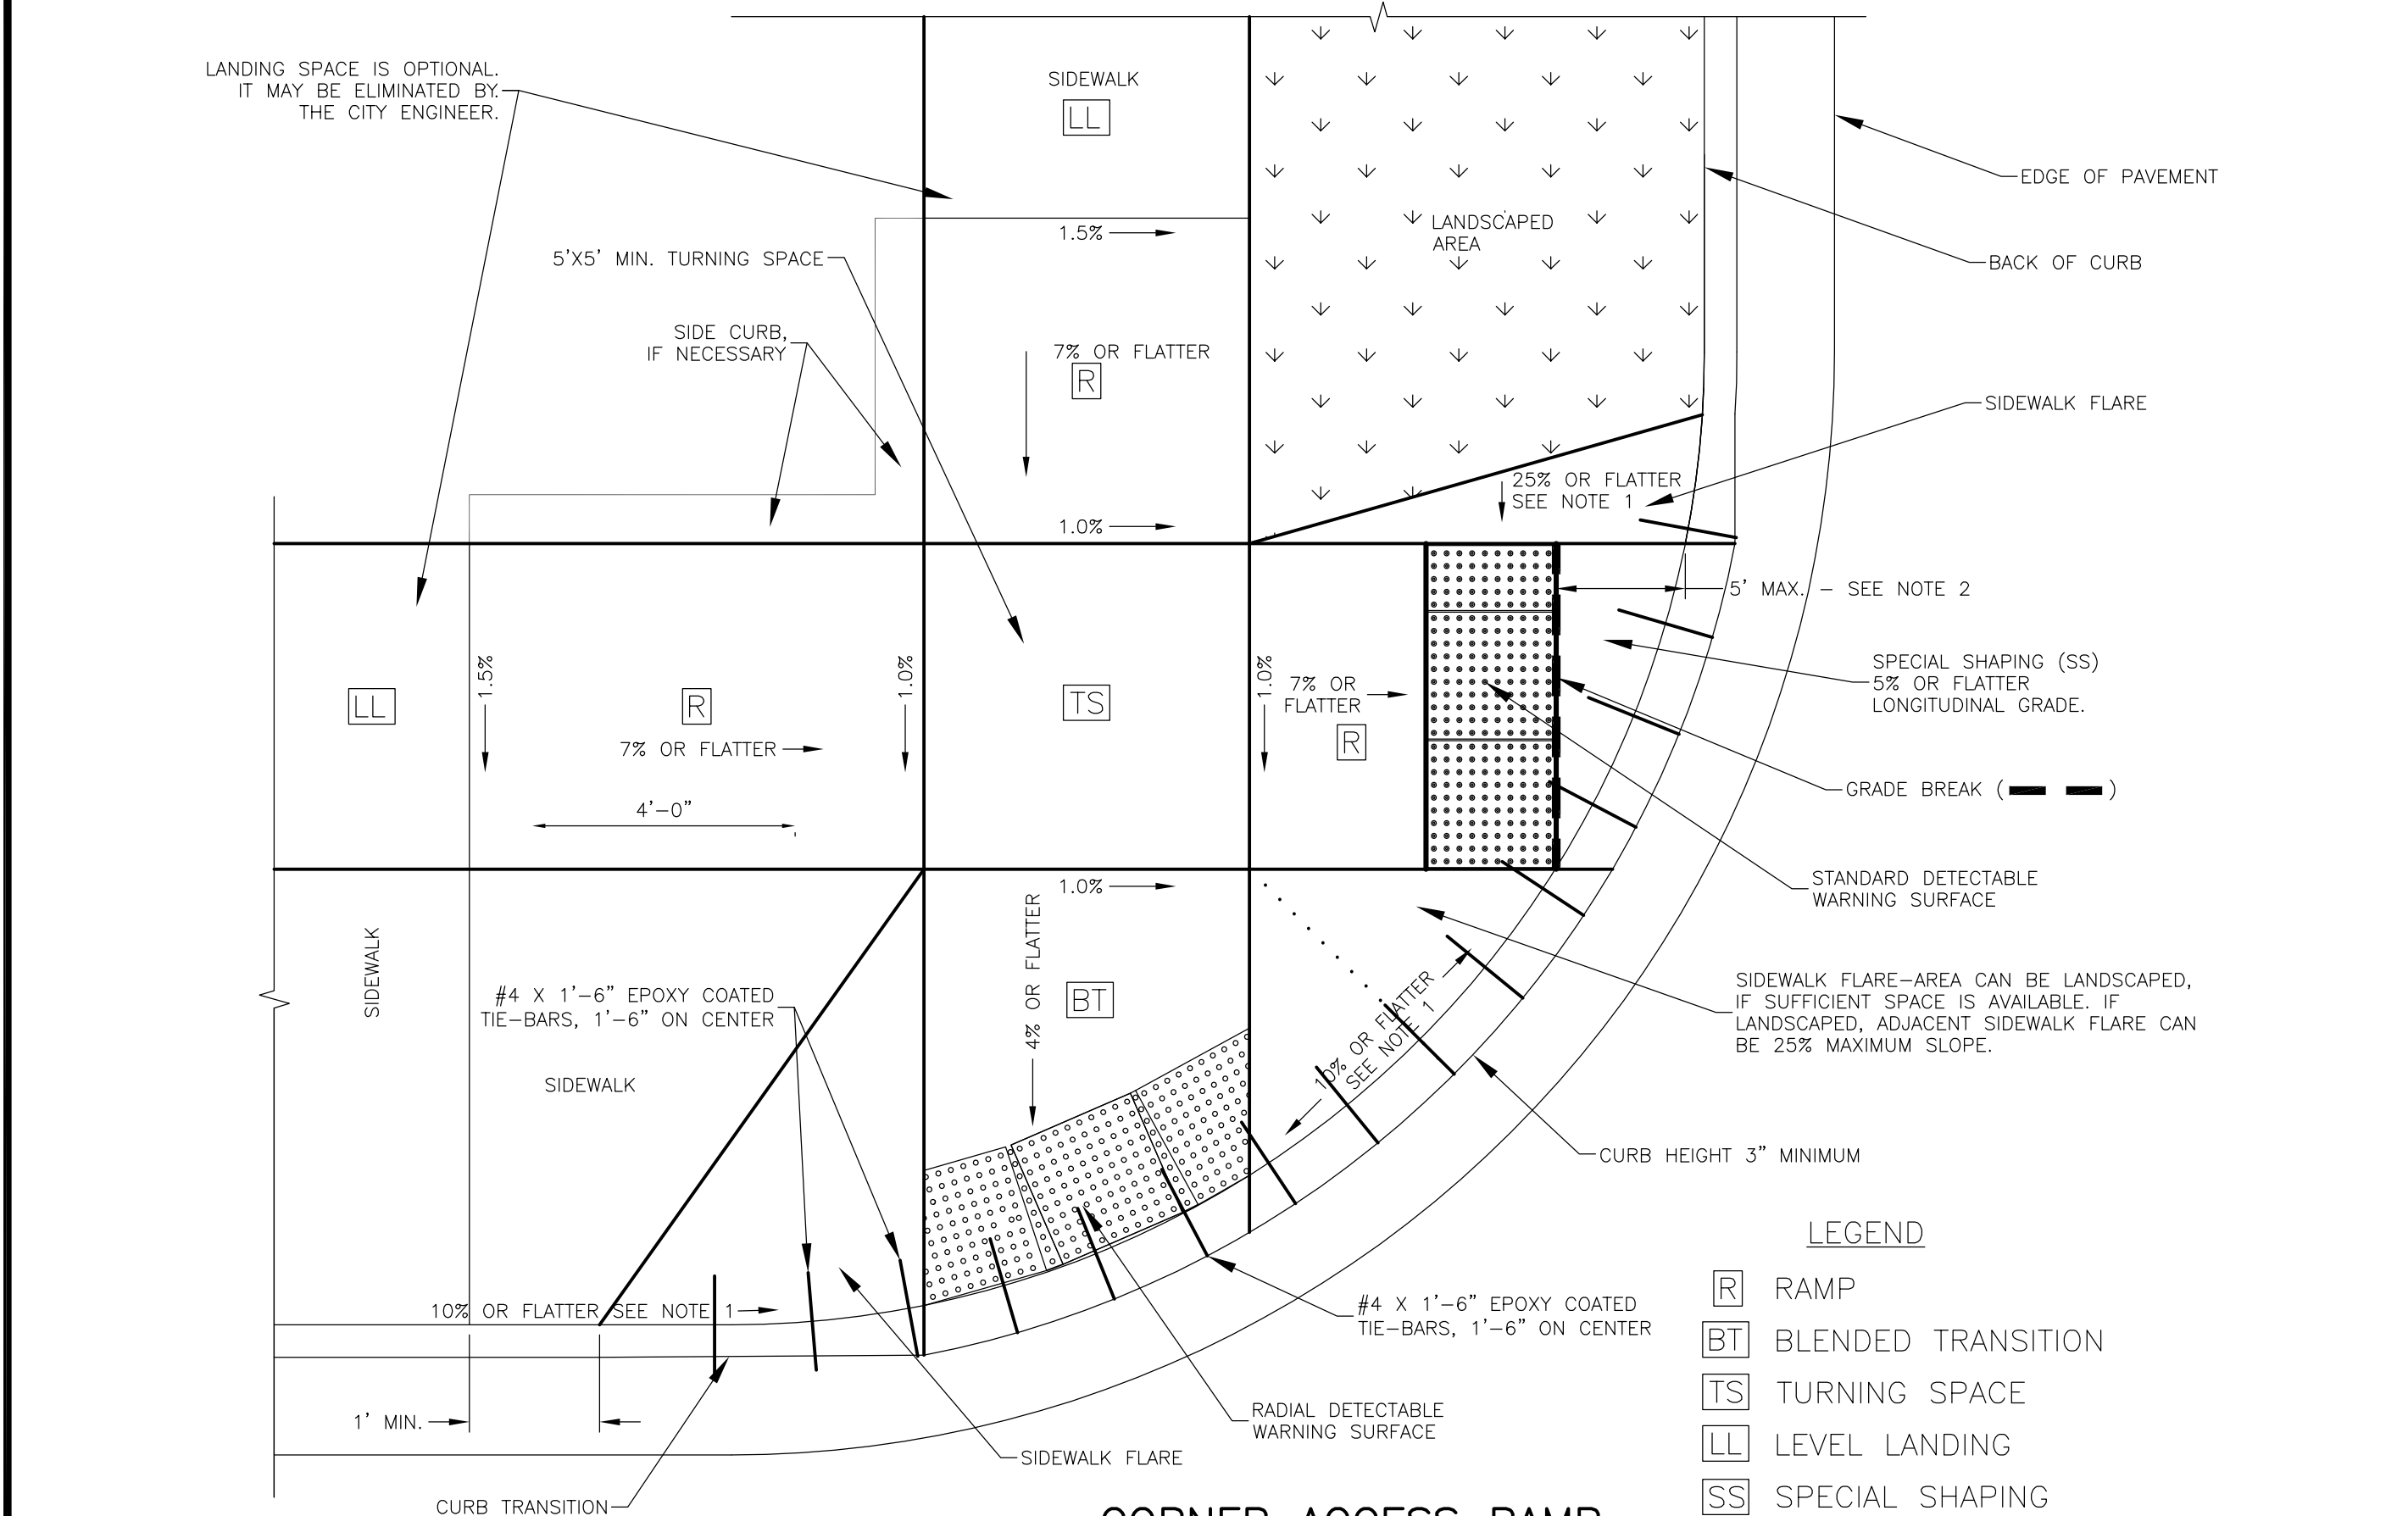


CORNER ACCESS RAMP

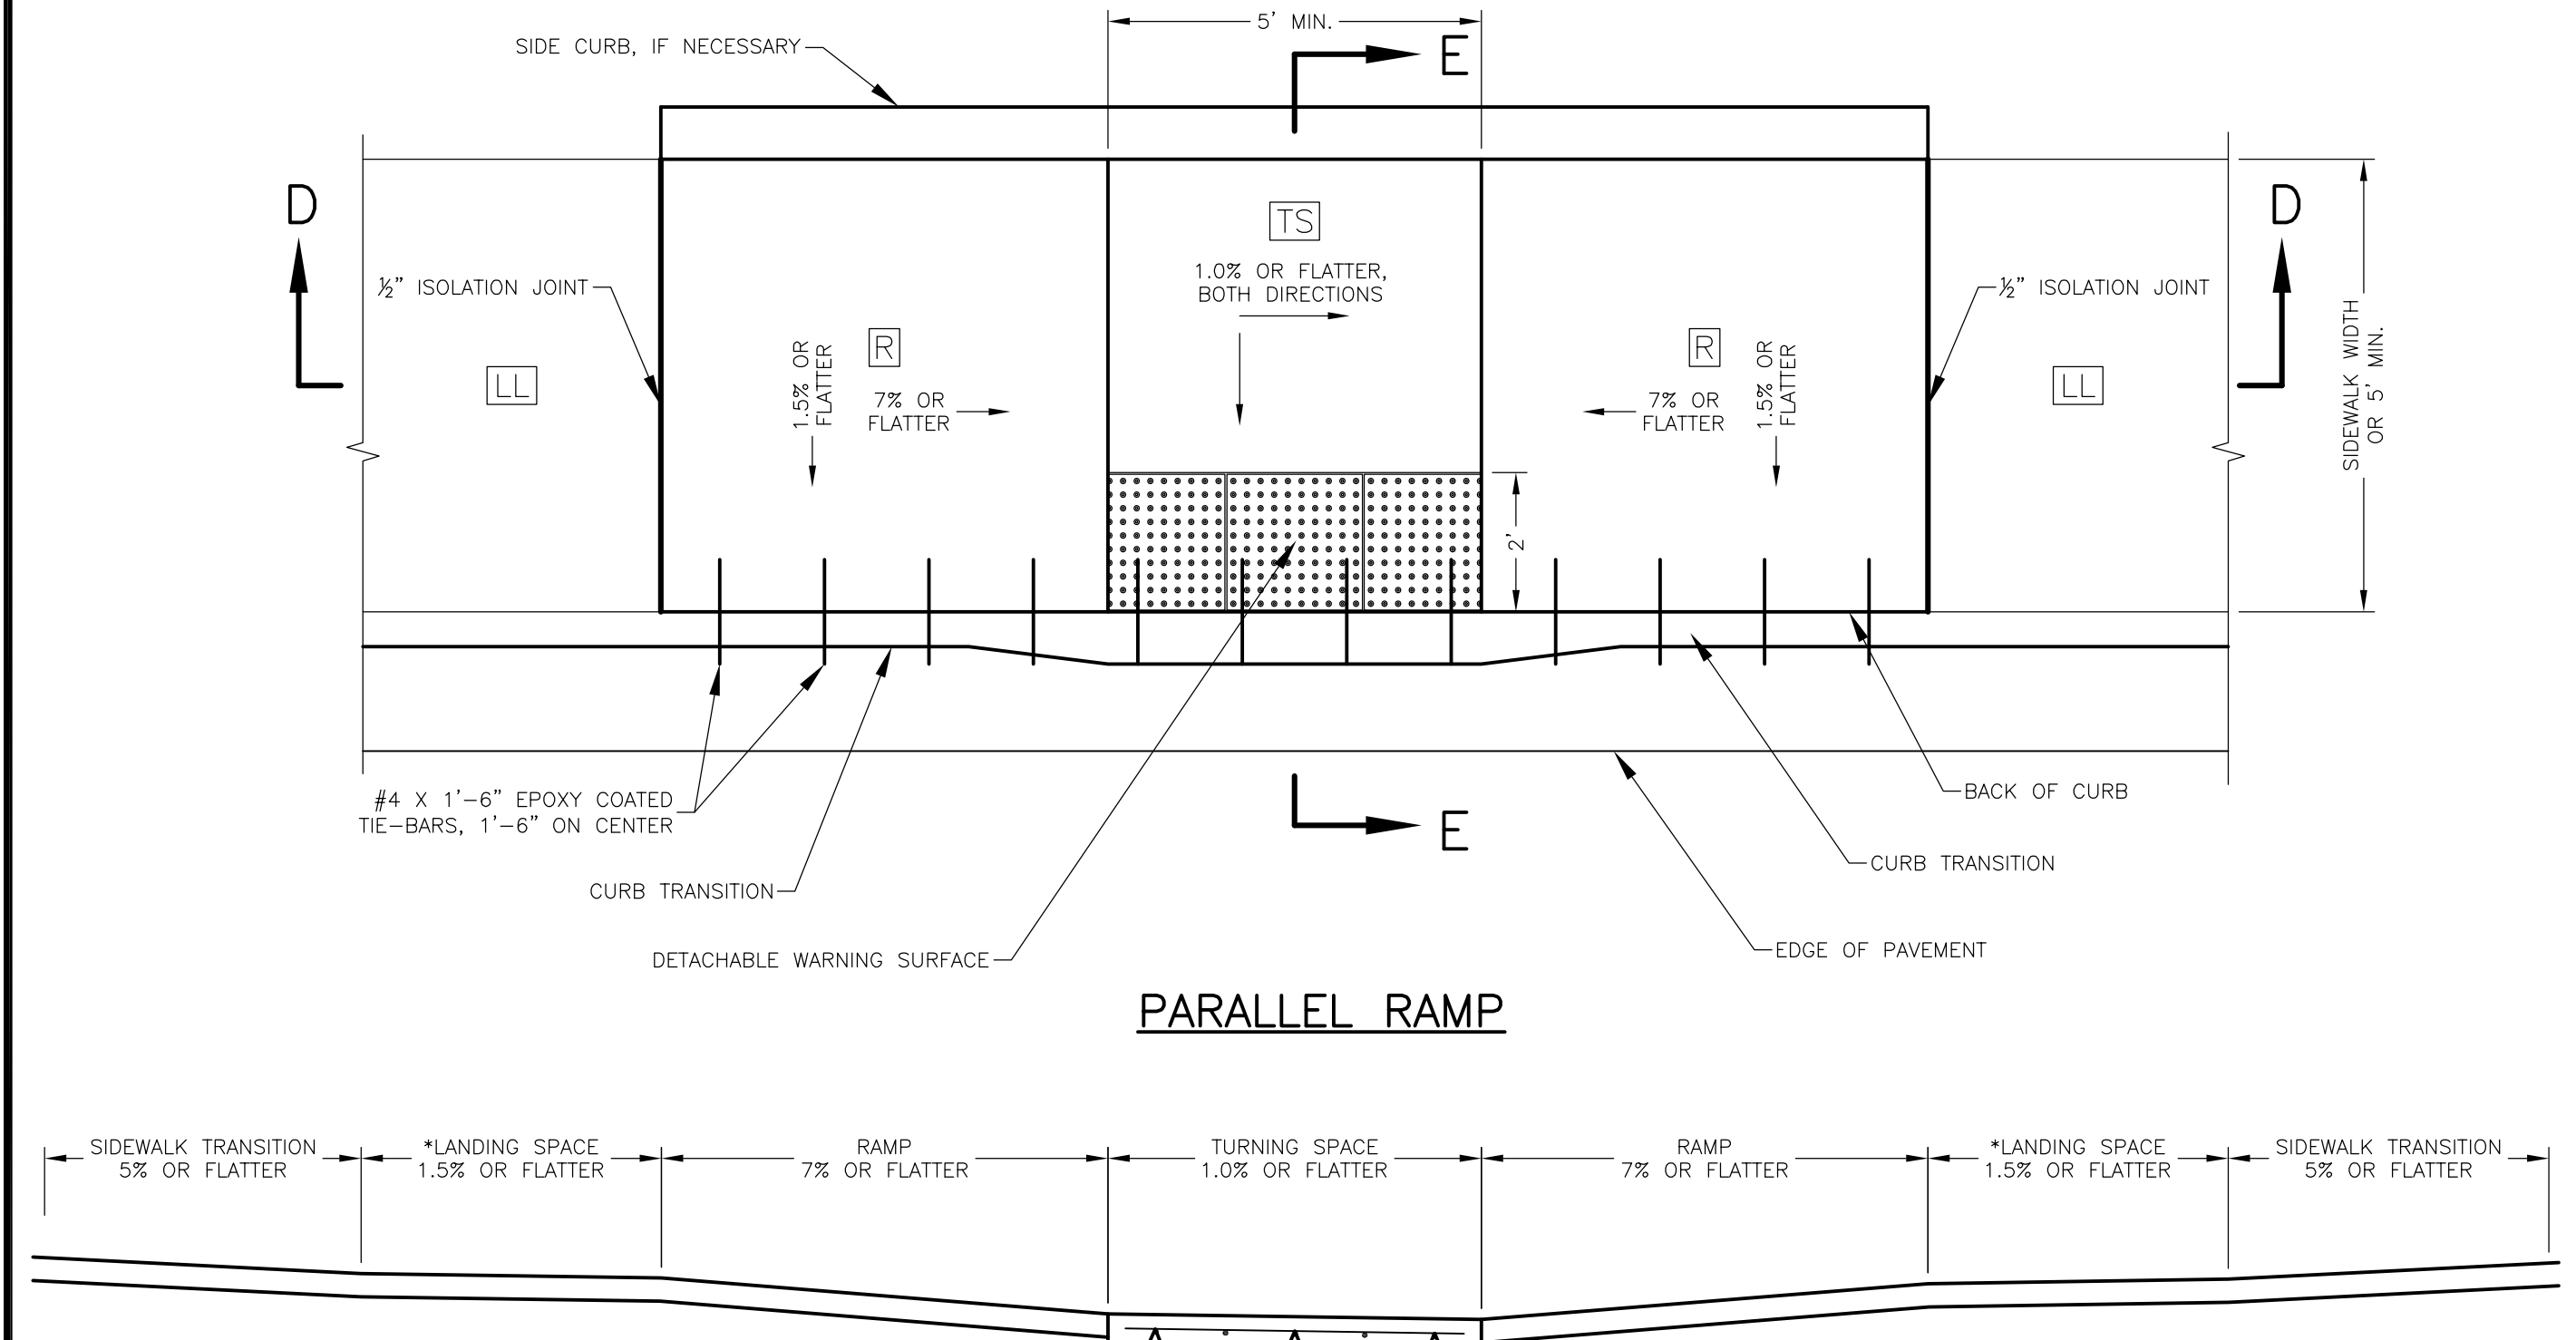

PARALLEL RAMP

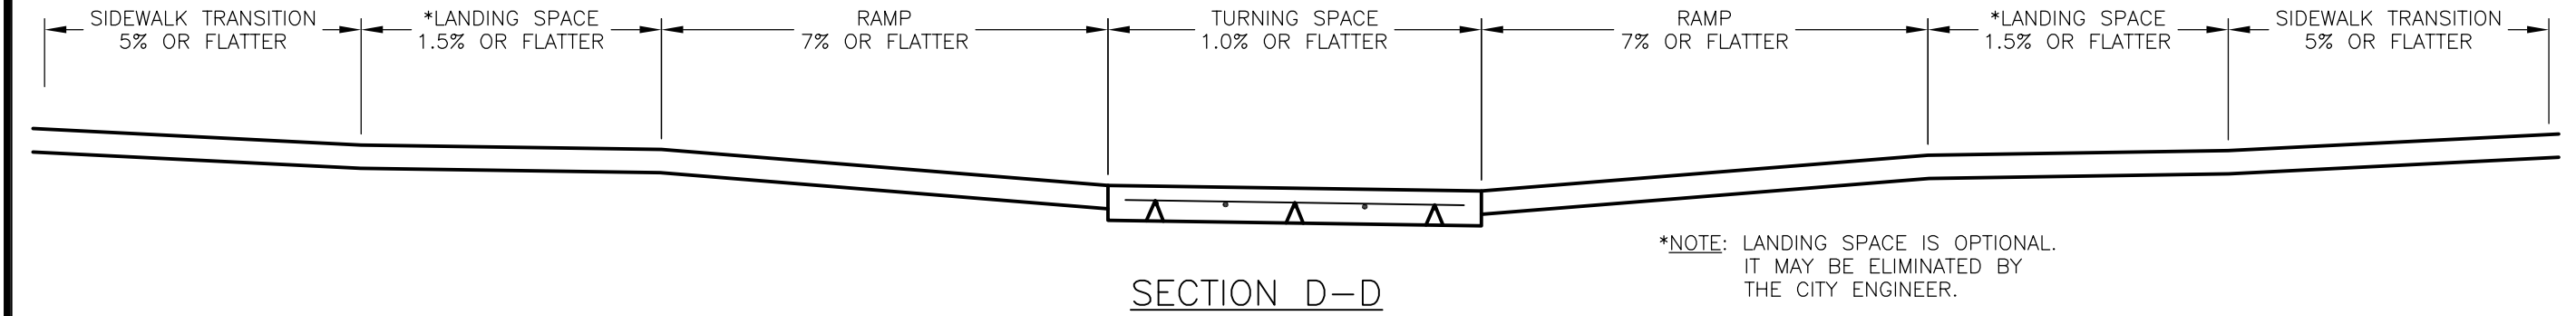

SECTION D-D

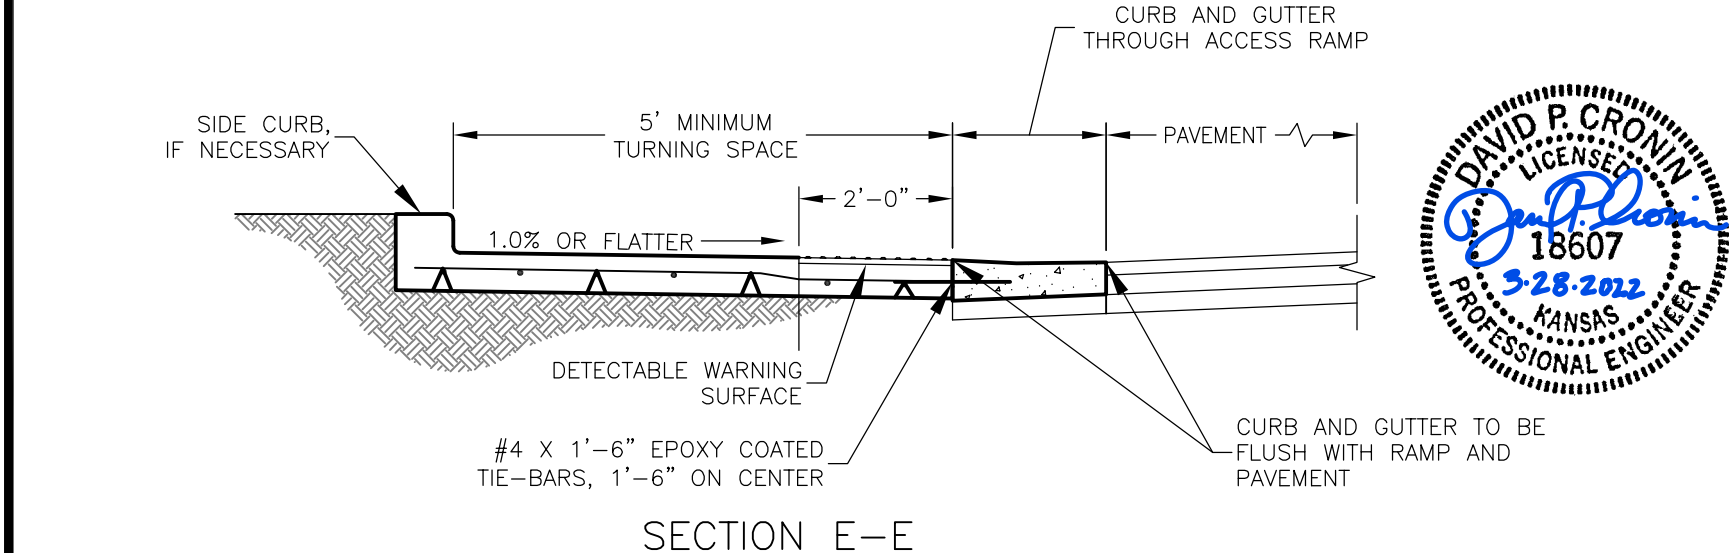

SECTION E-E

2021 EDITION

SHEET 40 OF 49

DATE	BY	REVISION
03-01-21	LJM	REPLACES ALL PREVIOUS VERSIONS OF CONCRETE SIDEWALK ACCESS RAMPS DETAILS
03-01-20	LJM	REPLACES ALL PREVIOUS VERSIONS OF CONCRETE SIDEWALK ACCESS RAMPS DETAILS




STANDARD DETAILS FOR
CONCRETE SIDEWALK ACCESS RAMPS


DAVID P. CRONIN
CITY ENGINEER

CRAIG S. OWENS
CITY MANAGER




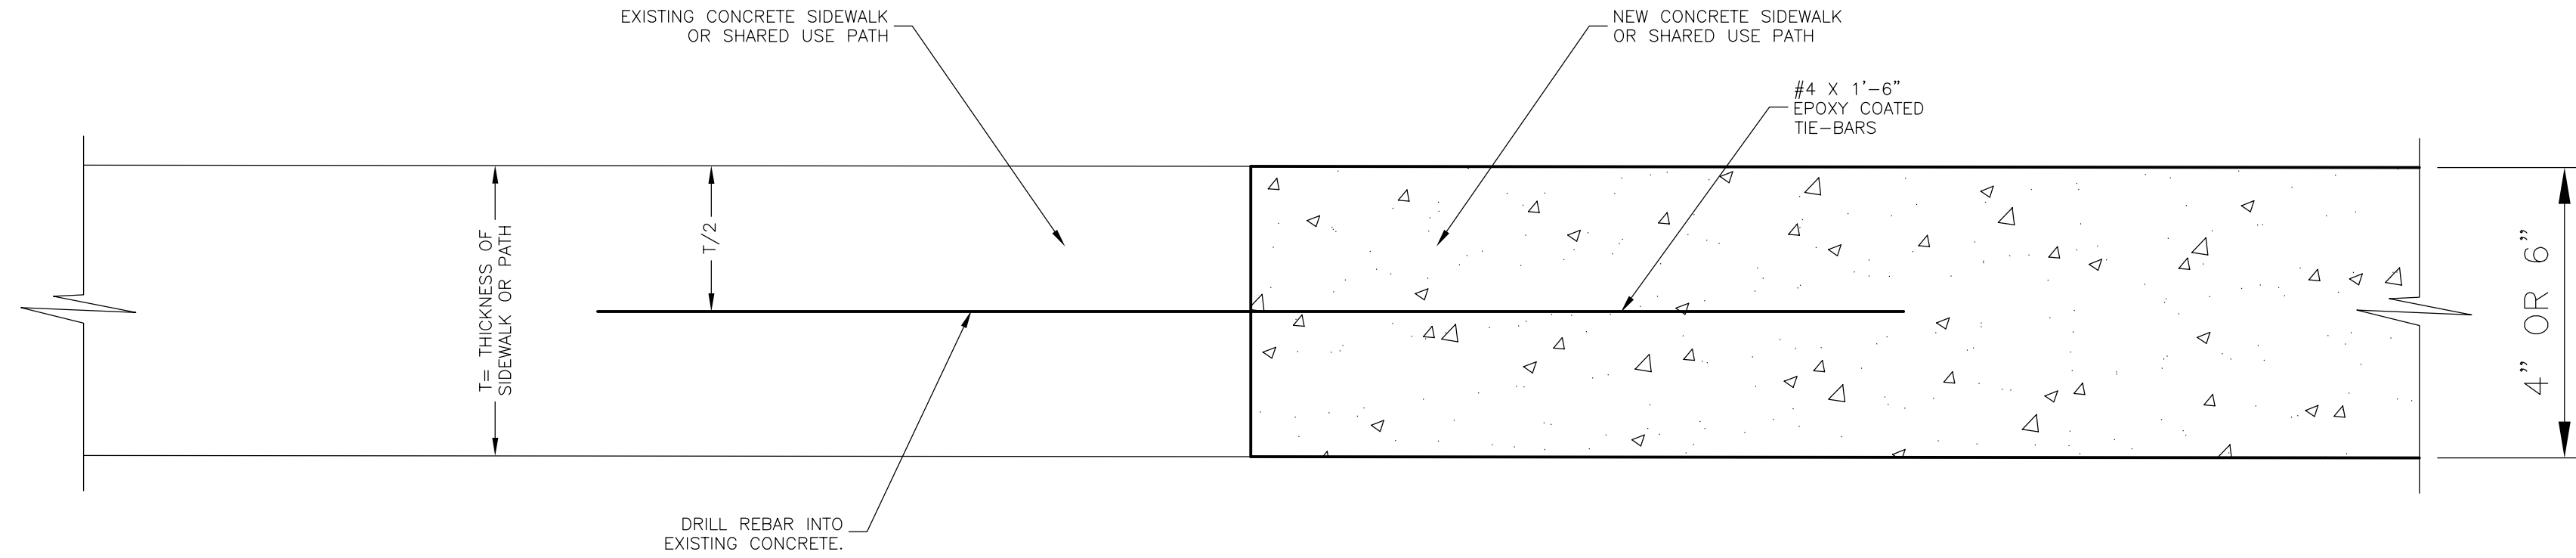

SECTION A-A

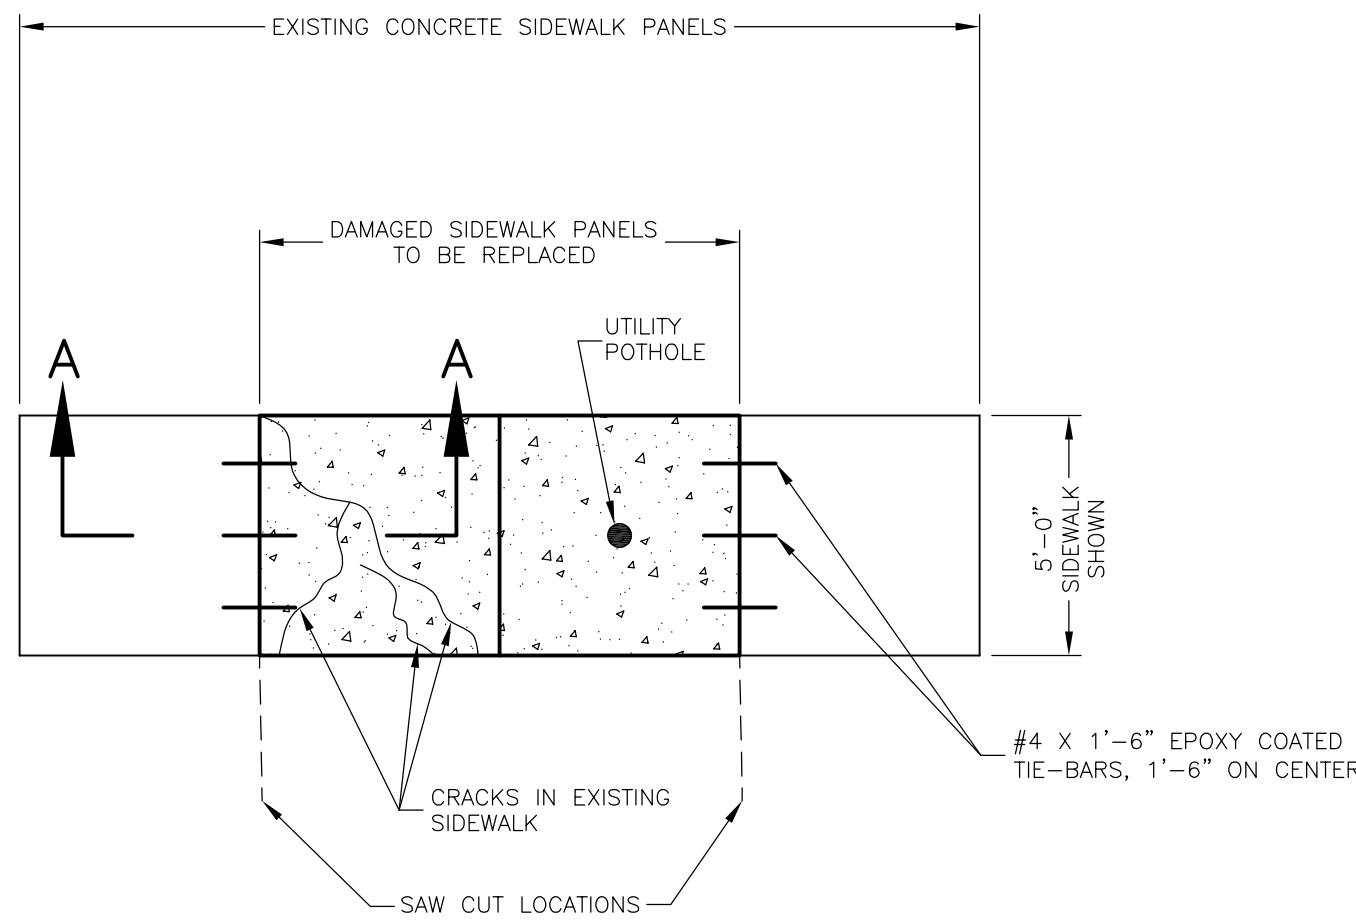

EXISTING SIDEWALK PLAN

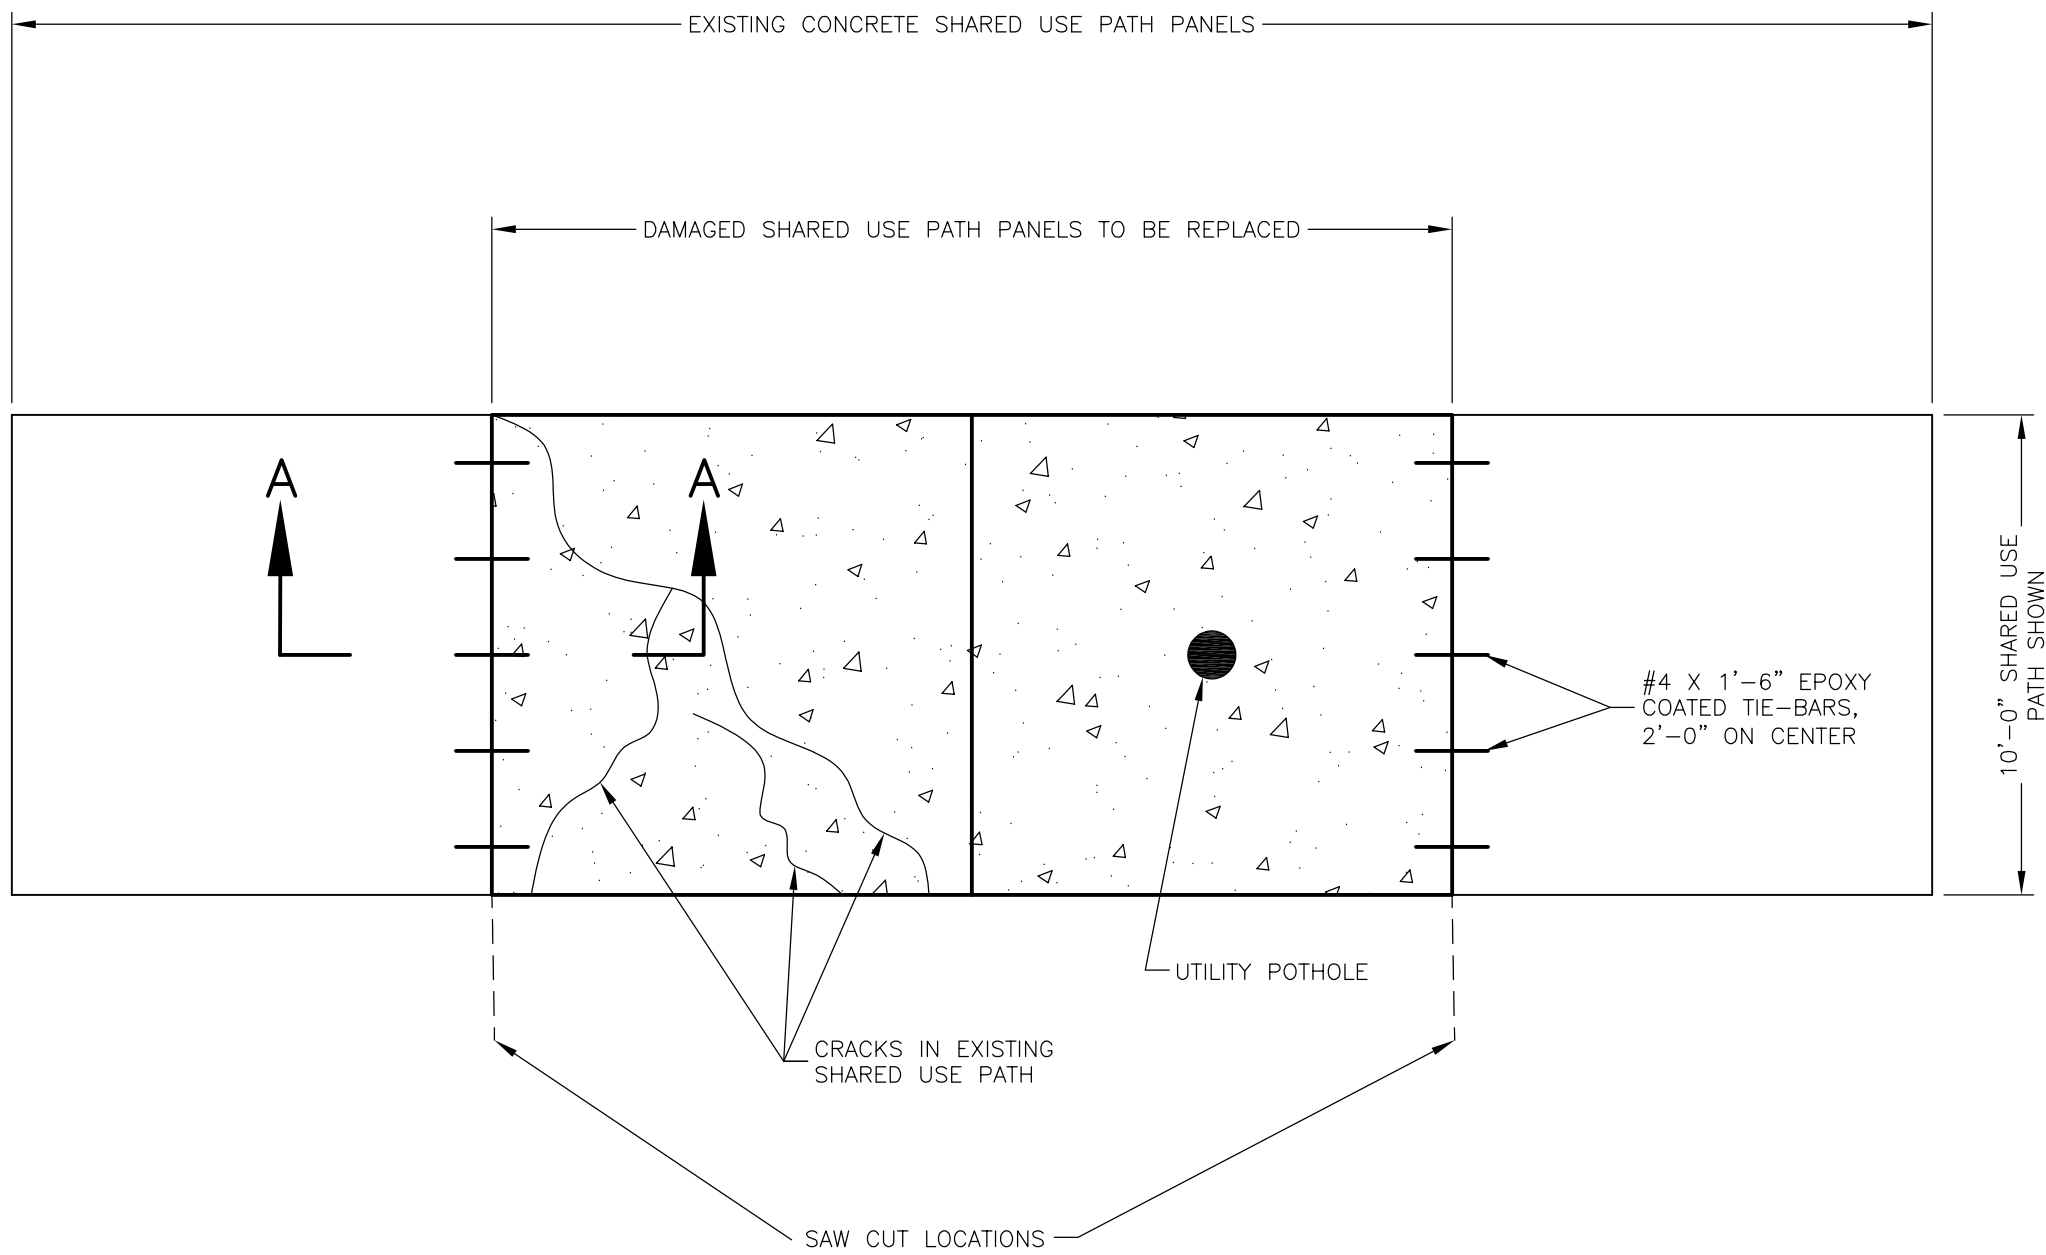

EXISTING SHARED USE PATH PLAN

SAW CUT AND JOINT DETAILS

CONCRETE SIDEWALK AND SHARED USE PATH REPAIR GENERAL NOTES

1. REPAIRS SHALL BE PERFORMED FROM EXISTING JOINT TO EXISTING JOINT. ISOLATED REPAIRS WITHIN AN EXISTING PANEL SUCH AS FILLING CRACKS OR GROUTING UTILITY POTHOLES SHALL NOT BE PERMITTED.
2. ACCESS RAMP REPAIRS SHALL INCLUDE THE FULL REMOVAL AND REPLACEMENT OF THE EXISTING RAMP INCLUSIVE OF ACCOMPANYING CURB AND GUTTER. ISOLATED REPAIRS WITHIN AN EXISTING ACCESS RAMP SUCH AS FILLING CRACKS OR GROUTING UTILITY POTHOLES SHALL NOT BE PERMITTED.
3. ADJACENT PANELS DAMAGED DURING CONSTRUCTION ACTIVITIES SHALL BE REMOVED AND REPLACED.
4. REPLACEMENT SIDEWALK, SHARED USE PATH AND ACCESS RAMPS SHALL BE CONSTRUCTED TO APPLICABLE CITY OF LAWRENCE CONSTRUCTION AND MATERIAL SPECIFICATIONS AND STANDARD DETAILS.
5. THE WIDTH AND LOCATION OF REPLACEMENT SIDEWALK AND SHARED USE PATH SHALL BE VARIED TO MATCH THE WIDTH AND LOCATION OF EXISTING SIDEWALKS AND SHARED USE PATHS IN THE VICINITY. HOWEVER, WIDTH SHALL NOT BE REDUCED TO LESS THAN 4 FEET.
6. SIDEWALK AND SHARED USE PATH CROSS SLOPE MAY BE VARIED THROUGH A GRADUAL TRANSITION TO MATCH EXISTING, ADJOINING PANELS.

2021 EDITION SHEET 41 OF 49

DATE	BY	REVISION
03-01-21	LJM	REPLACES ALL PREVIOUS VERSIONS OF CONCRETE SIDEWALK AND SHARED USE PATH REPAIR DETAILS
03-01-20	LJM	NEW DETAIL




STANDARD DETAILS FOR
CONCRETE SIDEWALK AND SHARED USE PATH REPAIR


DAVID P. CRONIN
CITY ENGINEER

CRAIG S. OWENS
CITY MANAGER




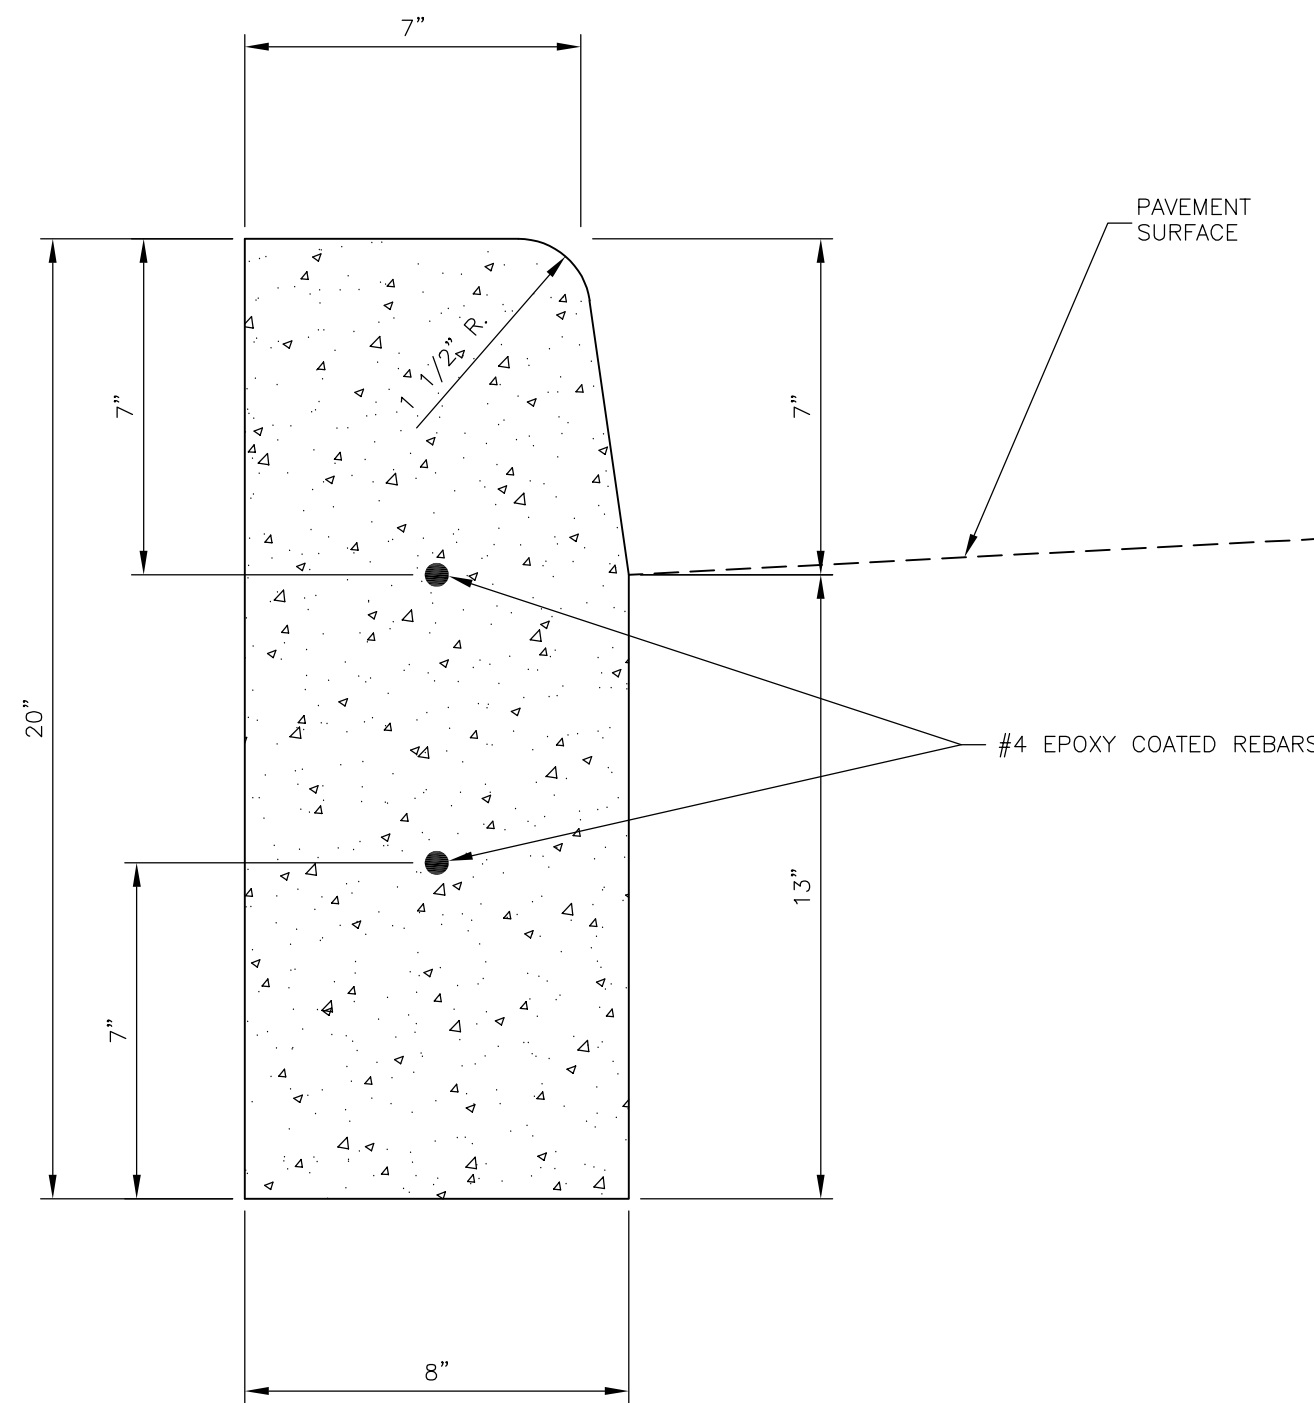

STRAIGHT CURB
(TYPE C-1)

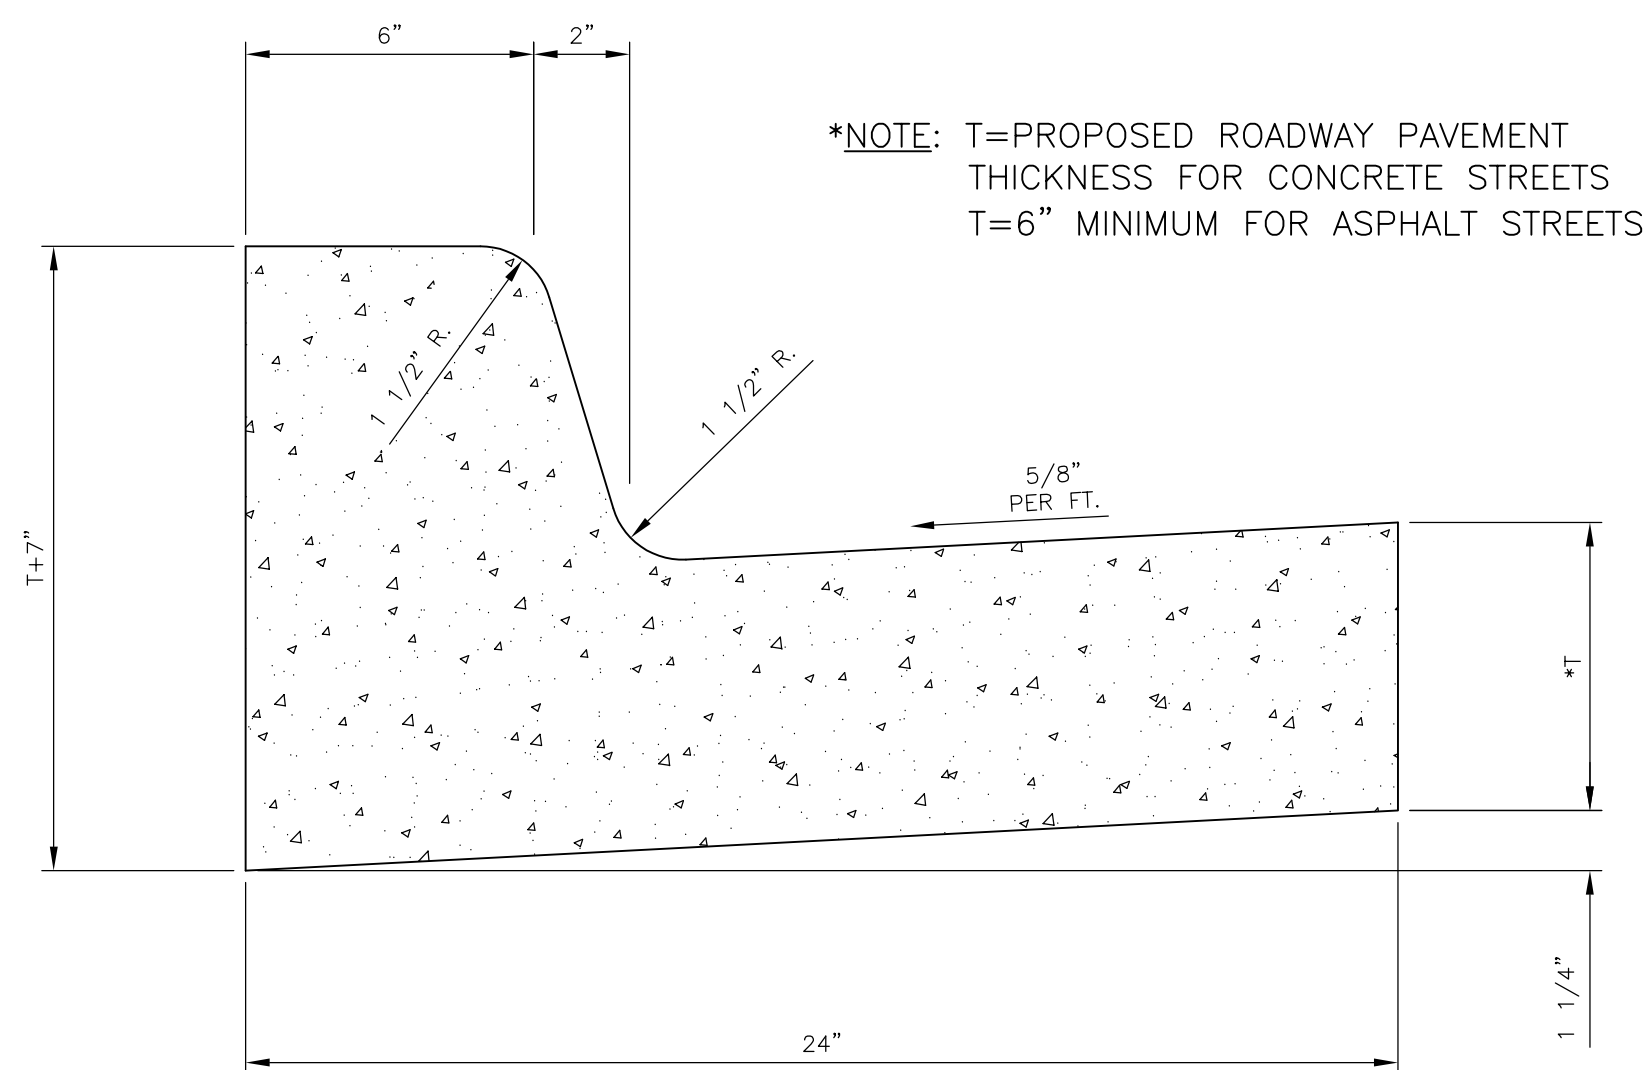


STRAIGHT BACK CURB AND GUTTER
(TYPE CG-1)

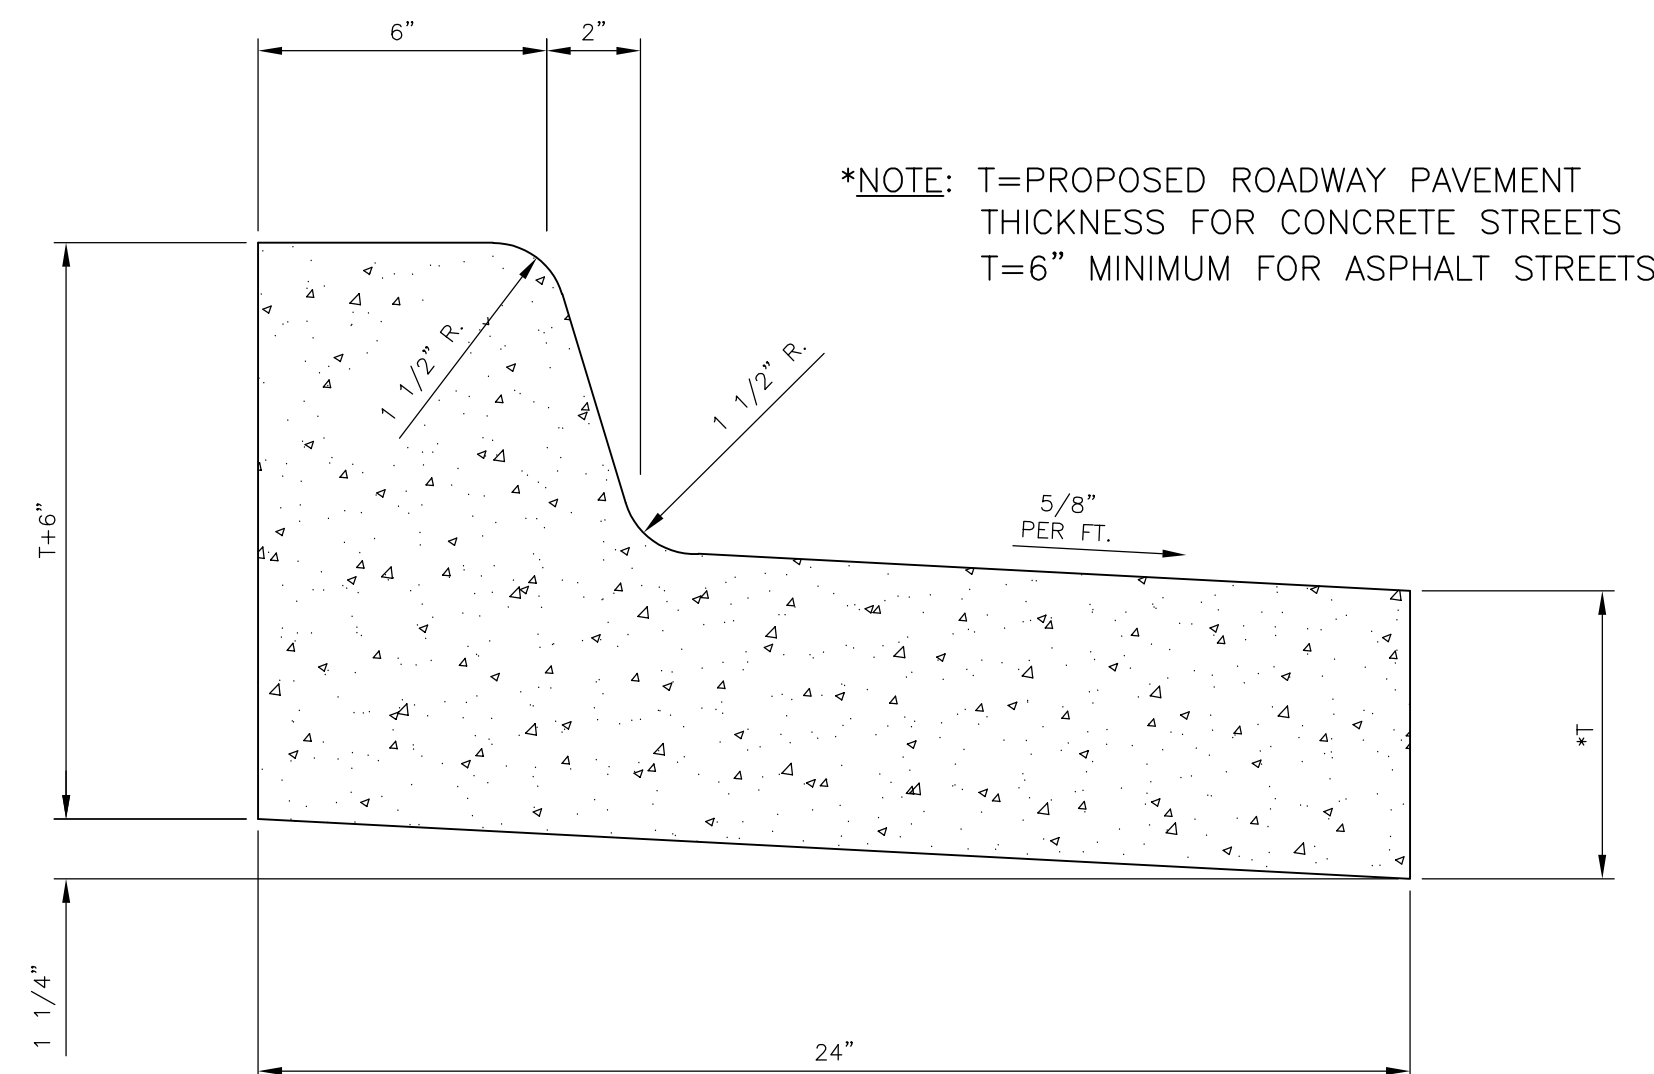


STRAIGHT BACK DRY CURB AND GUTTER
(TYPE CG-1, DRY)

*NOTE: T=PROPOSED ROADWAY PAVEMENT THICKNESS FOR CONCRETE STREETS
T=6" MINIMUM FOR ASPHALT STREETS

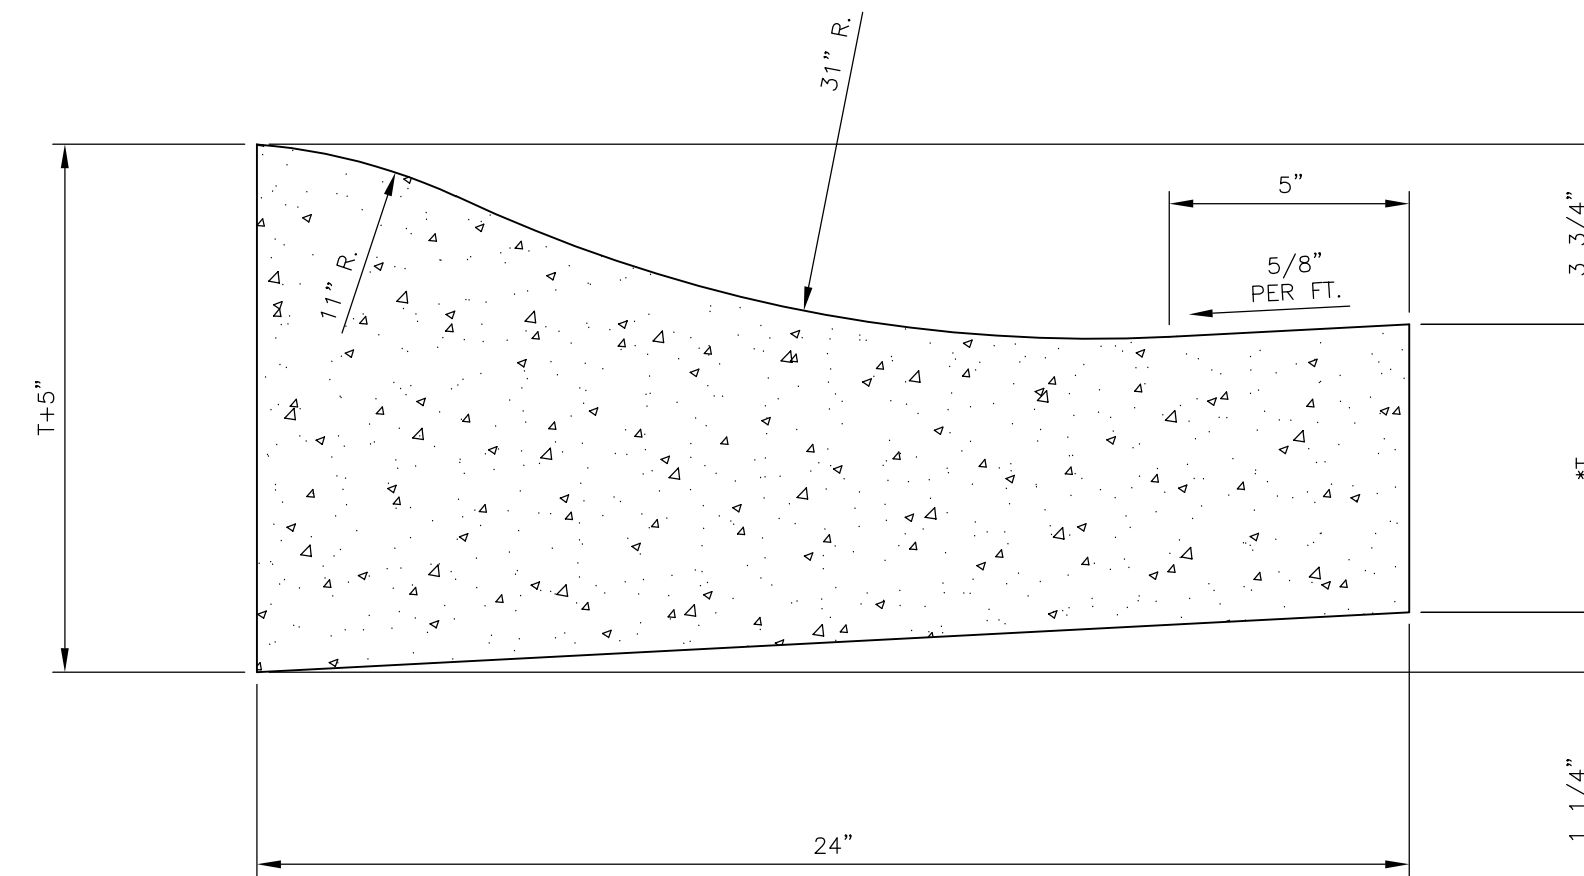


ROLL BACK CURB AND GUTTER
(TYPE CG-2)

*NOTE: T=PROPOSED ROADWAY PAVEMENT THICKNESS FOR CONCRETE STREETS
T=6" MINIMUM FOR ASPHALT STREETS

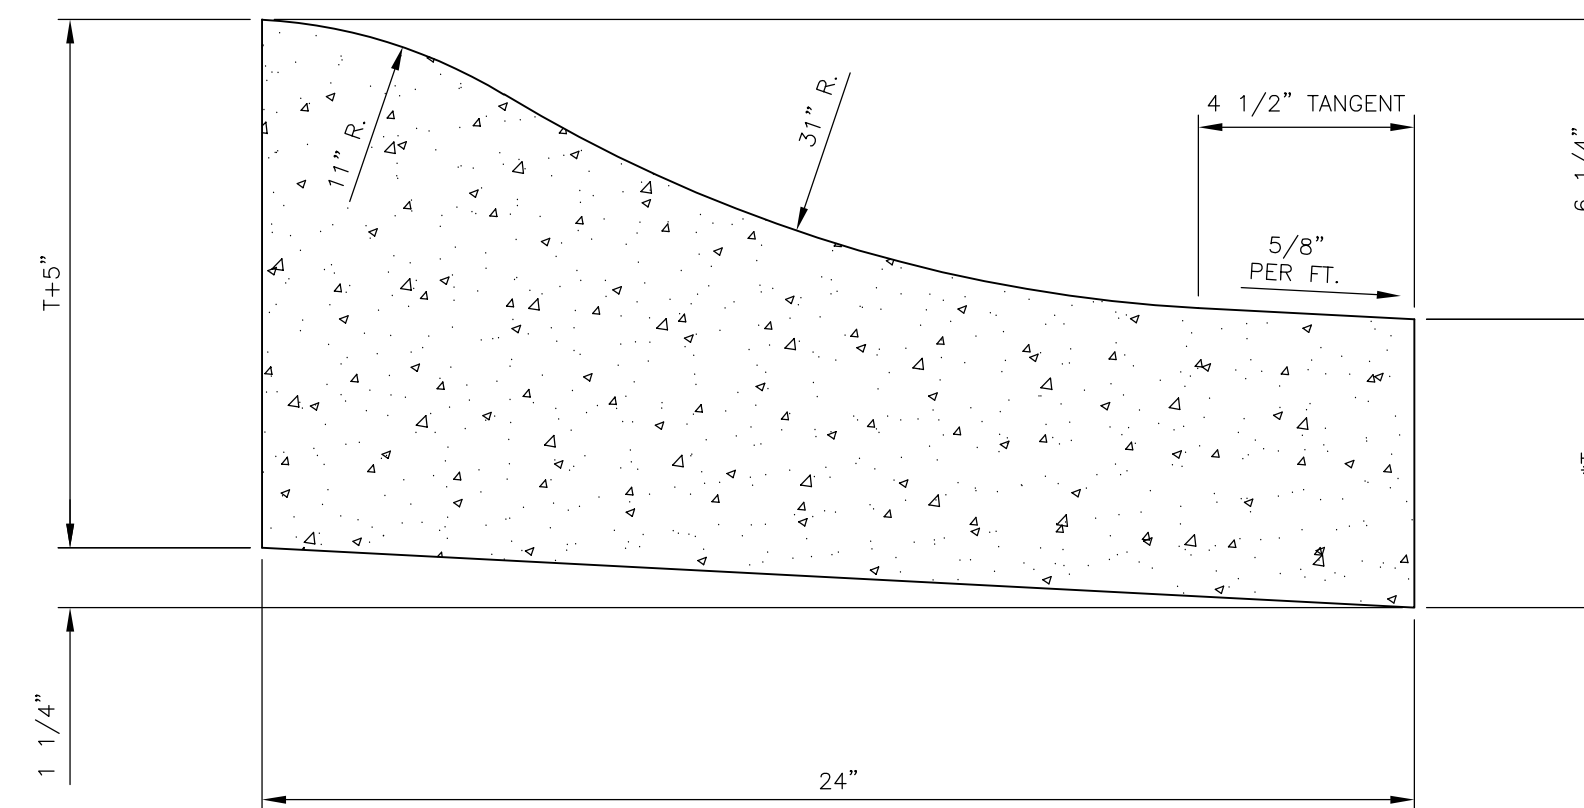

ROLL BACK CURB AND GUTTER
(TYPE CG-2, DRY)


*NOTE: T=PROPOSED ROADWAY PAVEMENT THICKNESS FOR CONCRETE STREETS
T=6" MINIMUM FOR ASPHALT STREETS

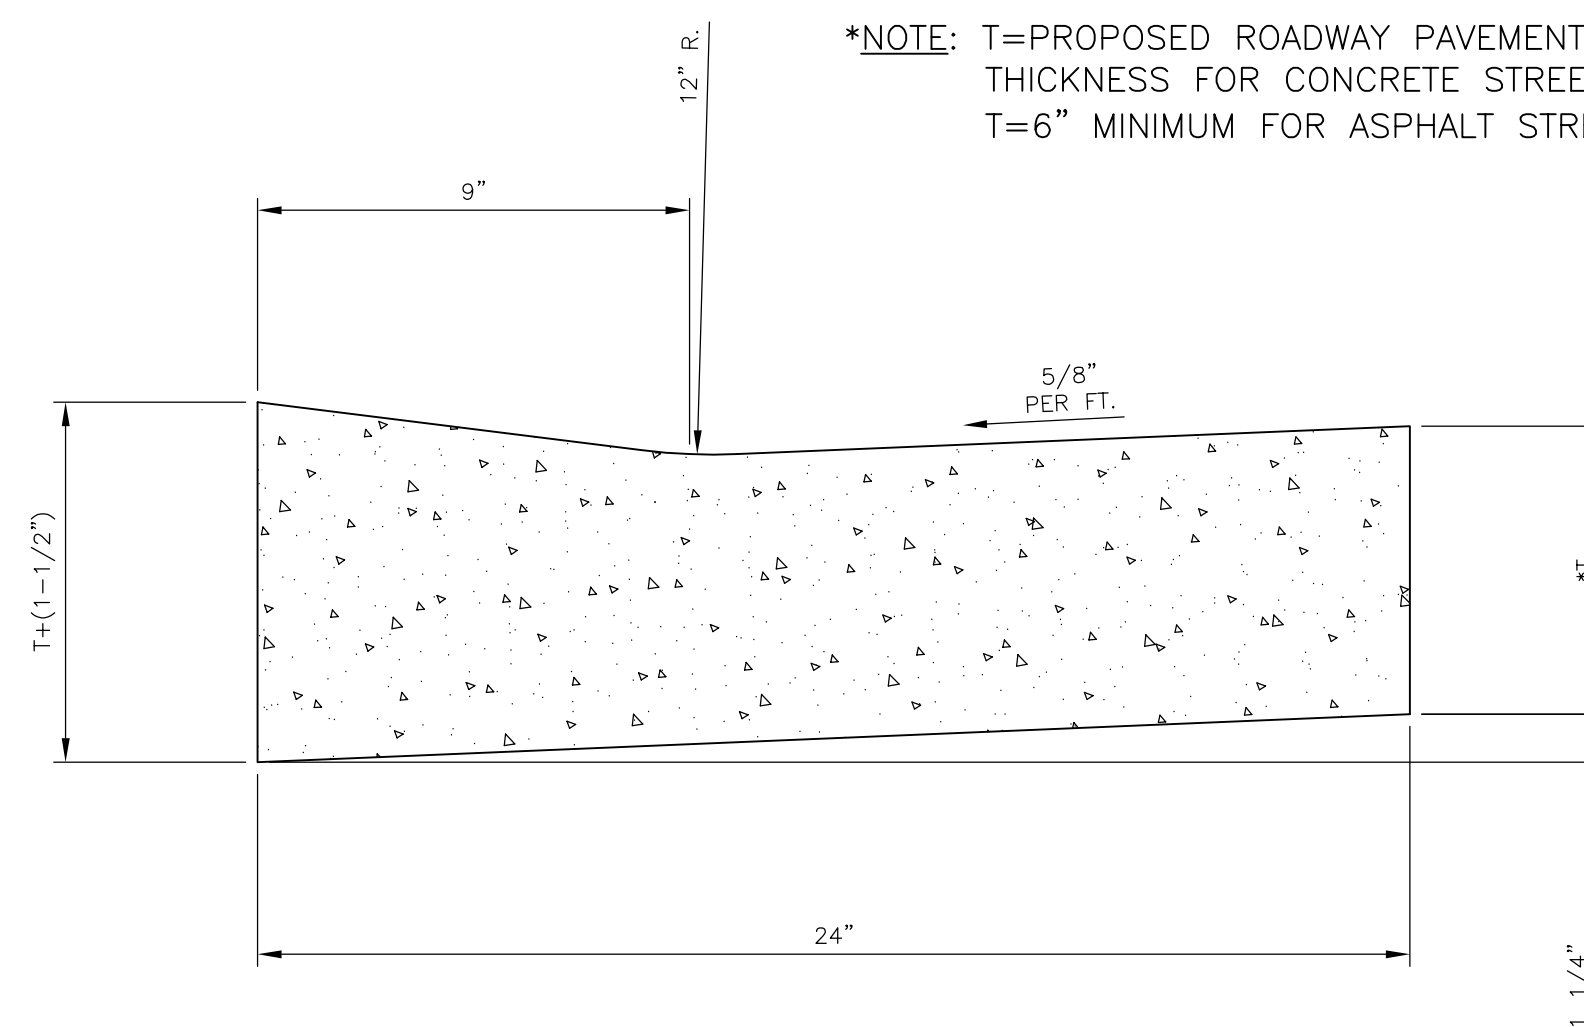

CURB AND GUTTER THROUGH DRIVEWAYS
(TYPE CG-3)

CURB AND GUTTER GENERAL NOTES

1. TYPE CG-2 OR CG-2 DRY ROLL BACK CURB AND GUTTER MAY BE USED ONLY ON RESIDENTIAL STREETS. CURB CUTS FOR DRIVEWAYS ARE NOT REQUIRED WITH ROLL BACK CURB AND GUTTER.
2. INSTALL JOINTS IN ACCORDANCE WITH STANDARD SPECIFICATIONS.
3. CONCRETE SHALL CONFORM TO STANDARD SPECIFICATIONS, SECTION 2000.
4. ASPHALTIC CONCRETE SURFACE COURSE SHALL CONFORM TO STANDARD SPECIFICATIONS, SECTION 1300.
5. PAVEMENT REMOVAL AND REPLACEMENT BEYOND THE LIMITS OF CURB AND GUTTER REMOVAL IS AT THE CONTRACTOR'S OPTION AND COST.
6. ALL CURB JOINTS SHALL BE SAWED AND SEALED TO THE FLOWLINE WITH JOINT SEALING THAT CONFORMS TO THE STANDARD SPECIFICATIONS, SECTION 1400.
7. FOR THE CONCRETE GUTTER THROUGH CURB RAMP DETAIL, REFER TO THE STANDARD DETAILS FOR "CONCRETE SIDEWALK ACCESS RAMPS". CURB THROUGH ACCESS RAMP TO BE PAID BY LINEAR FOOT AS SAME TYPE ADJACENT TO THE RAMP.

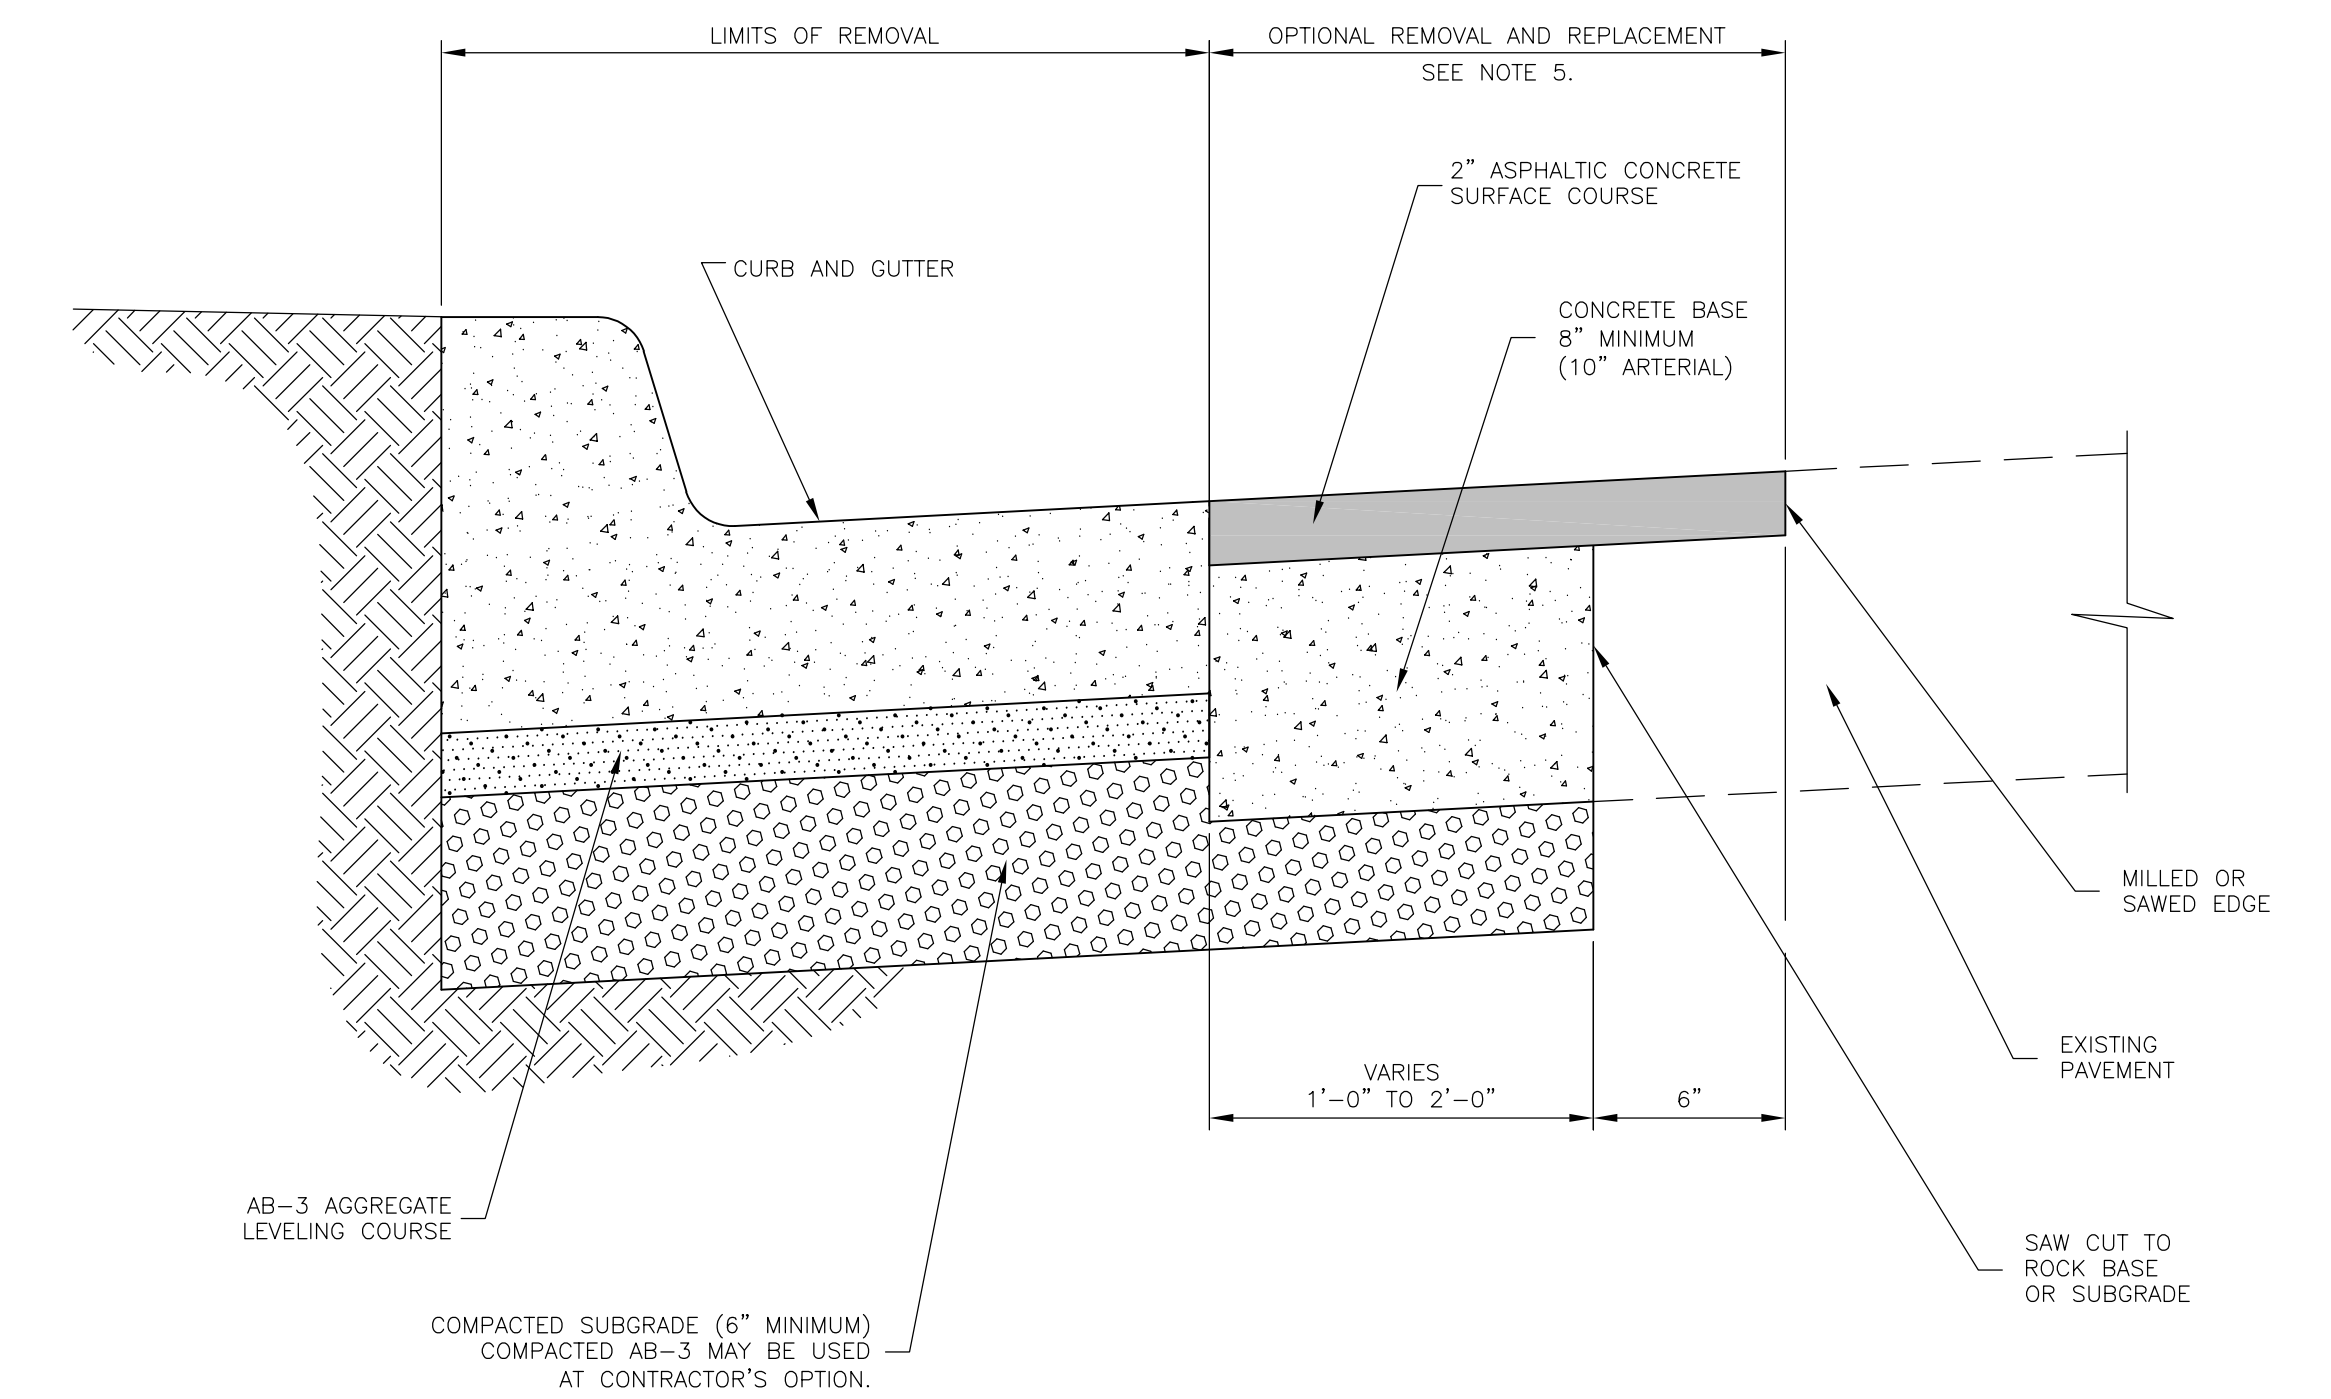

CURB REPLACEMENT DETAIL

(NOTE: TO BE USED ONLY WHEN EXISTING CURB AND GUTTER IS REMOVED AND REPLACED, BUT STREET PAVEMENT REMAINS IN PLACE)

2021 EDITION

SHEET 42 OF 49

DATE	BY	REVISION
03-01-21	LJM	REPLACES ALL PREVIOUS VERSIONS OF CONCRETE CURB AND GUTTER DETAILS
03-01-20	LJM	REPLACES ALL PREVIOUS VERSIONS OF CONCRETE CURB AND GUTTER DETAILS





STANDARD DETAILS FOR
CONCRETE CURB AND GUTTER

DAVID P. CRONIN
CITY ENGINEER



CRAIG S. OWENS
CITY MANAGER



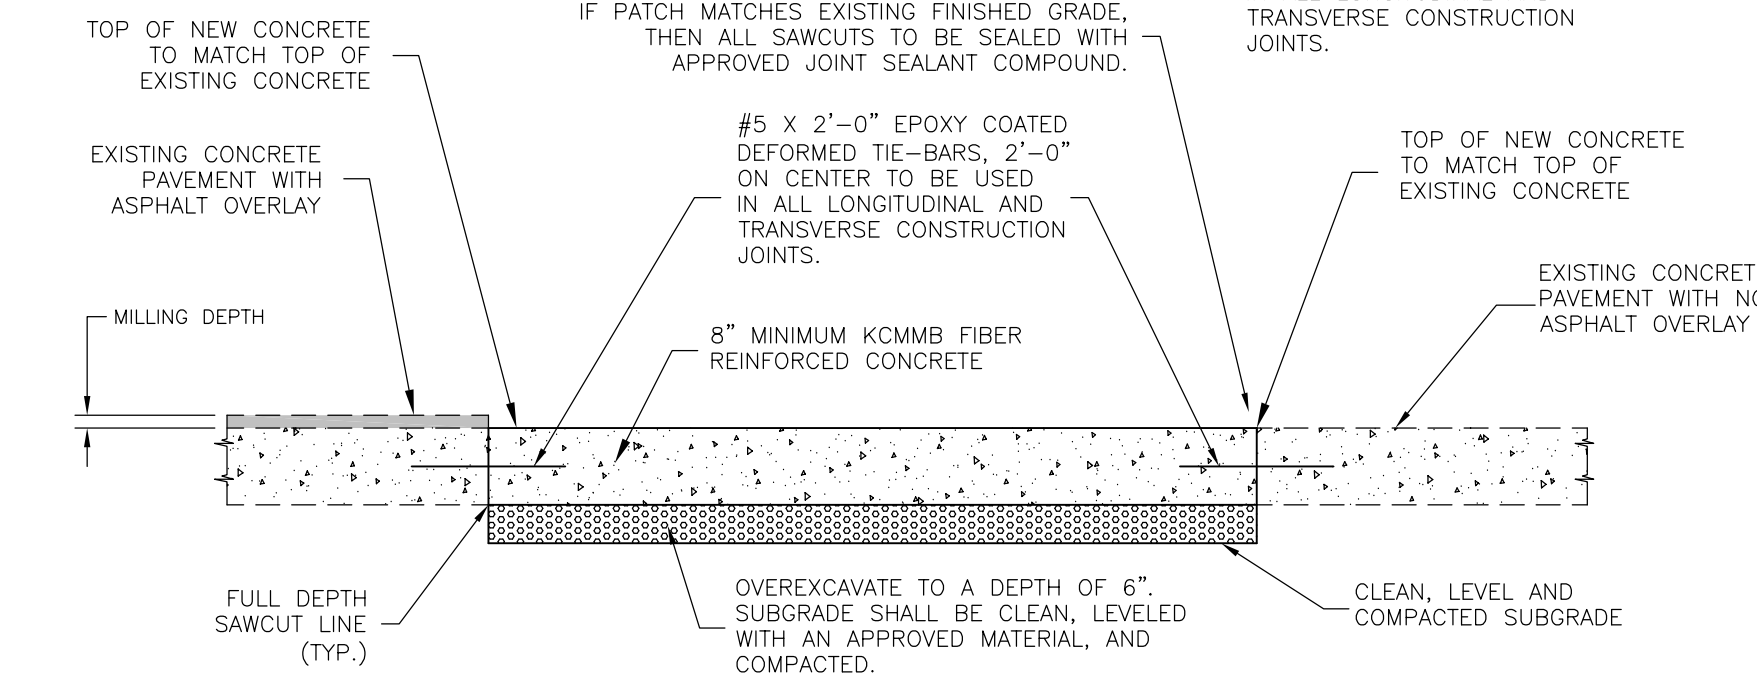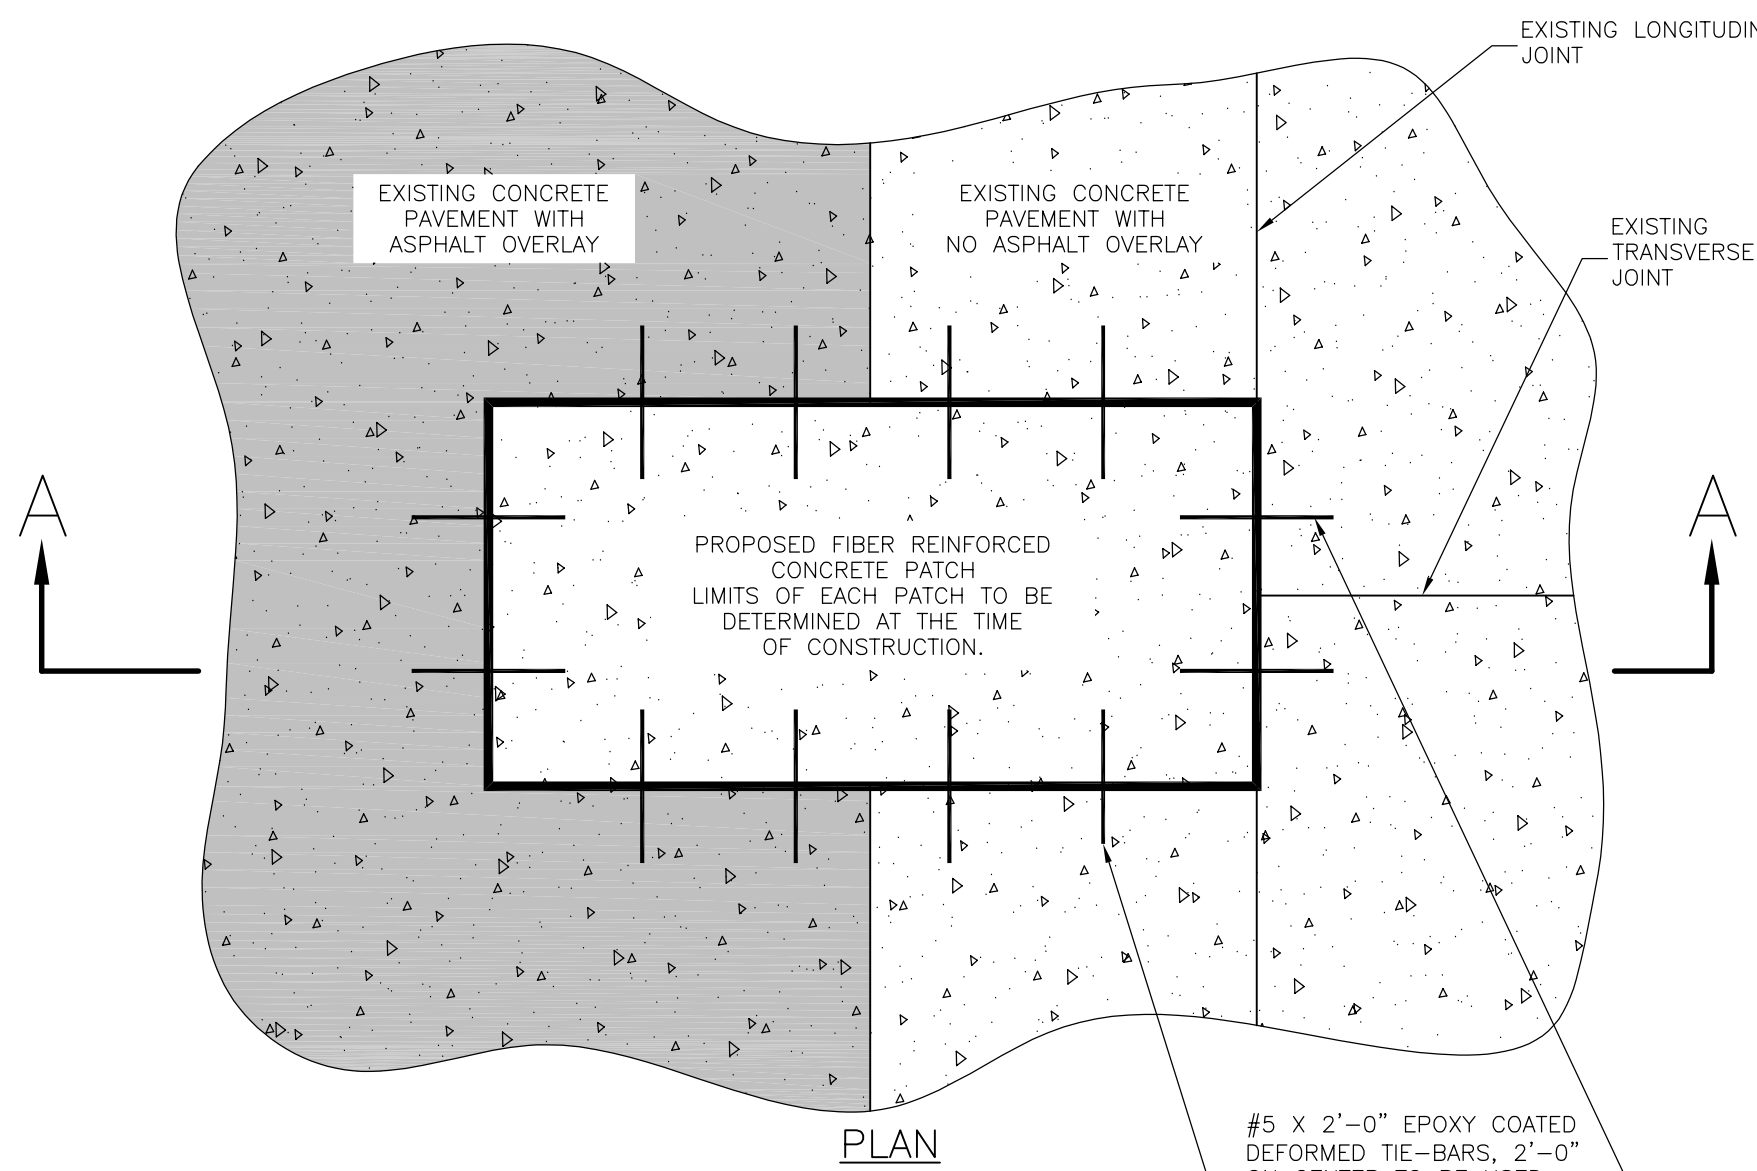



SECTION A-A

PORTLAND CEMENT CONCRETE PATCHING DETAILS

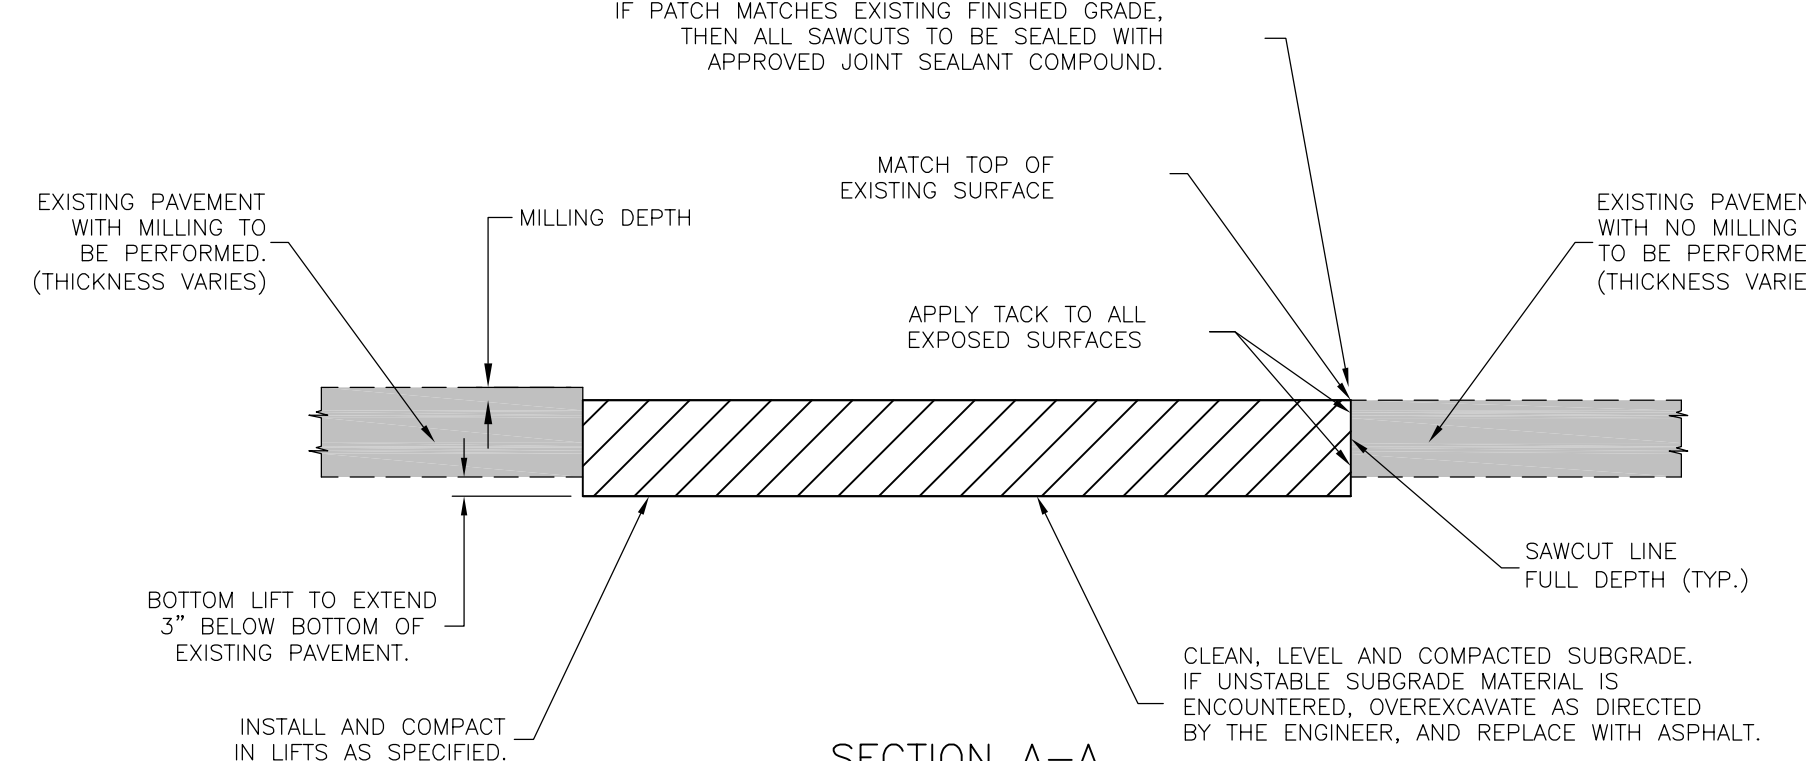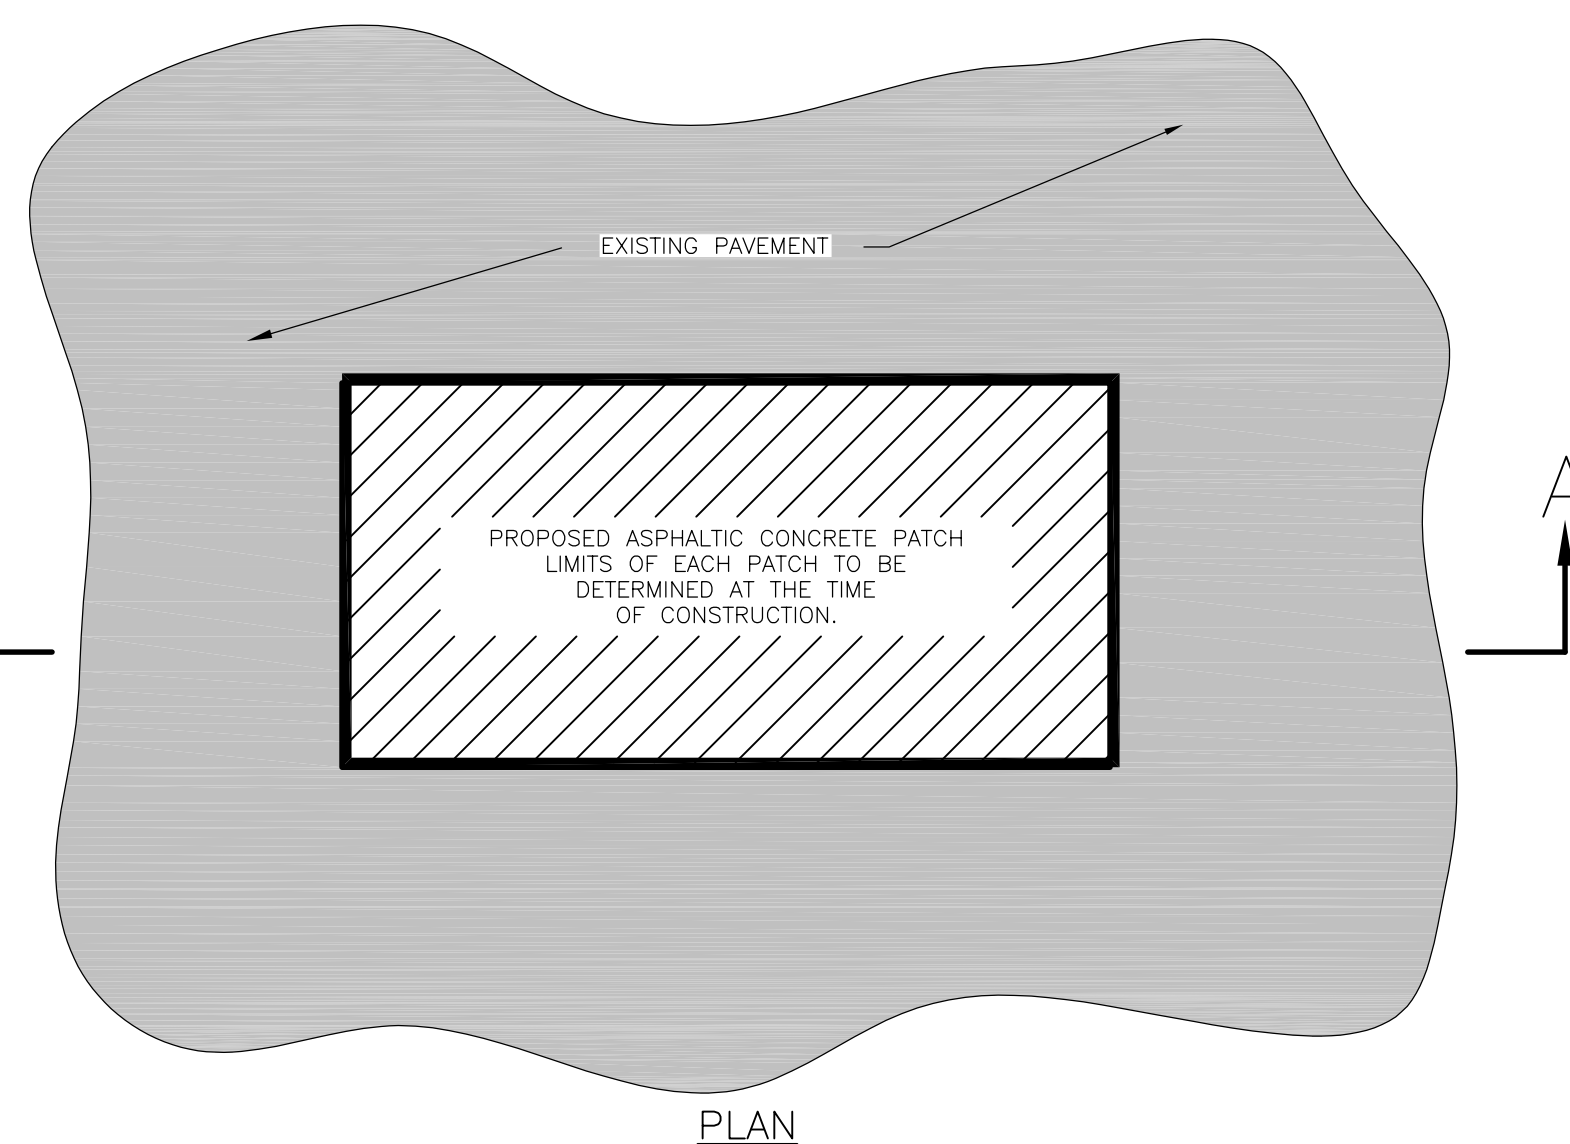

SECTION A-A



ASPHALTIC CONCRETE PATCHING DETAILS

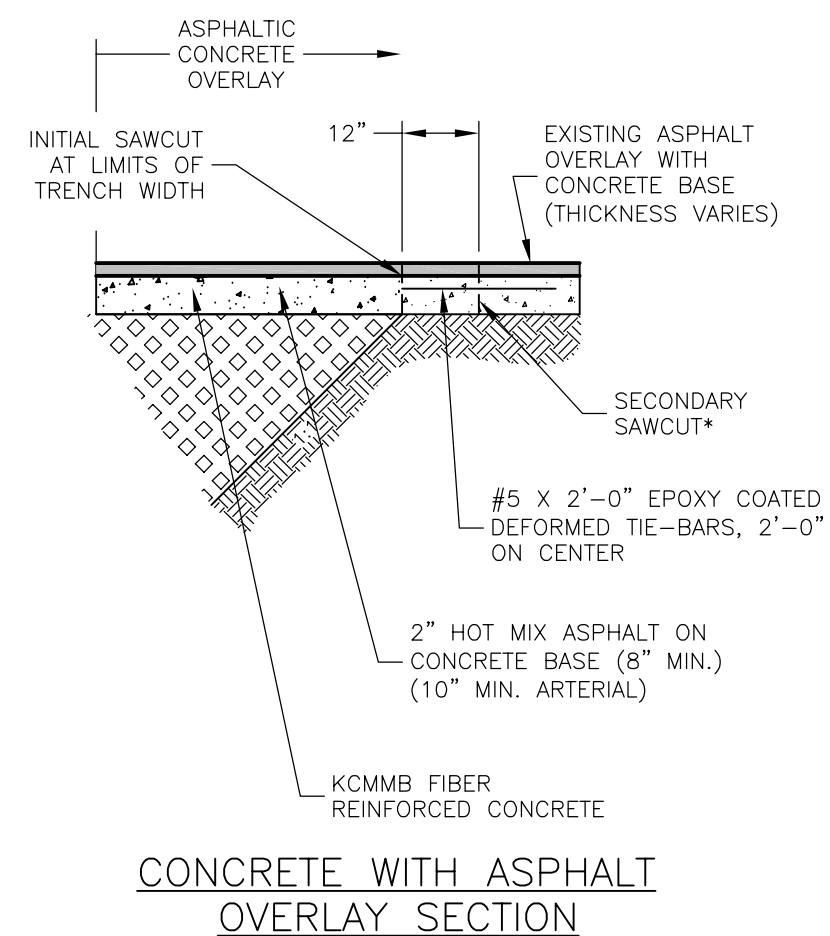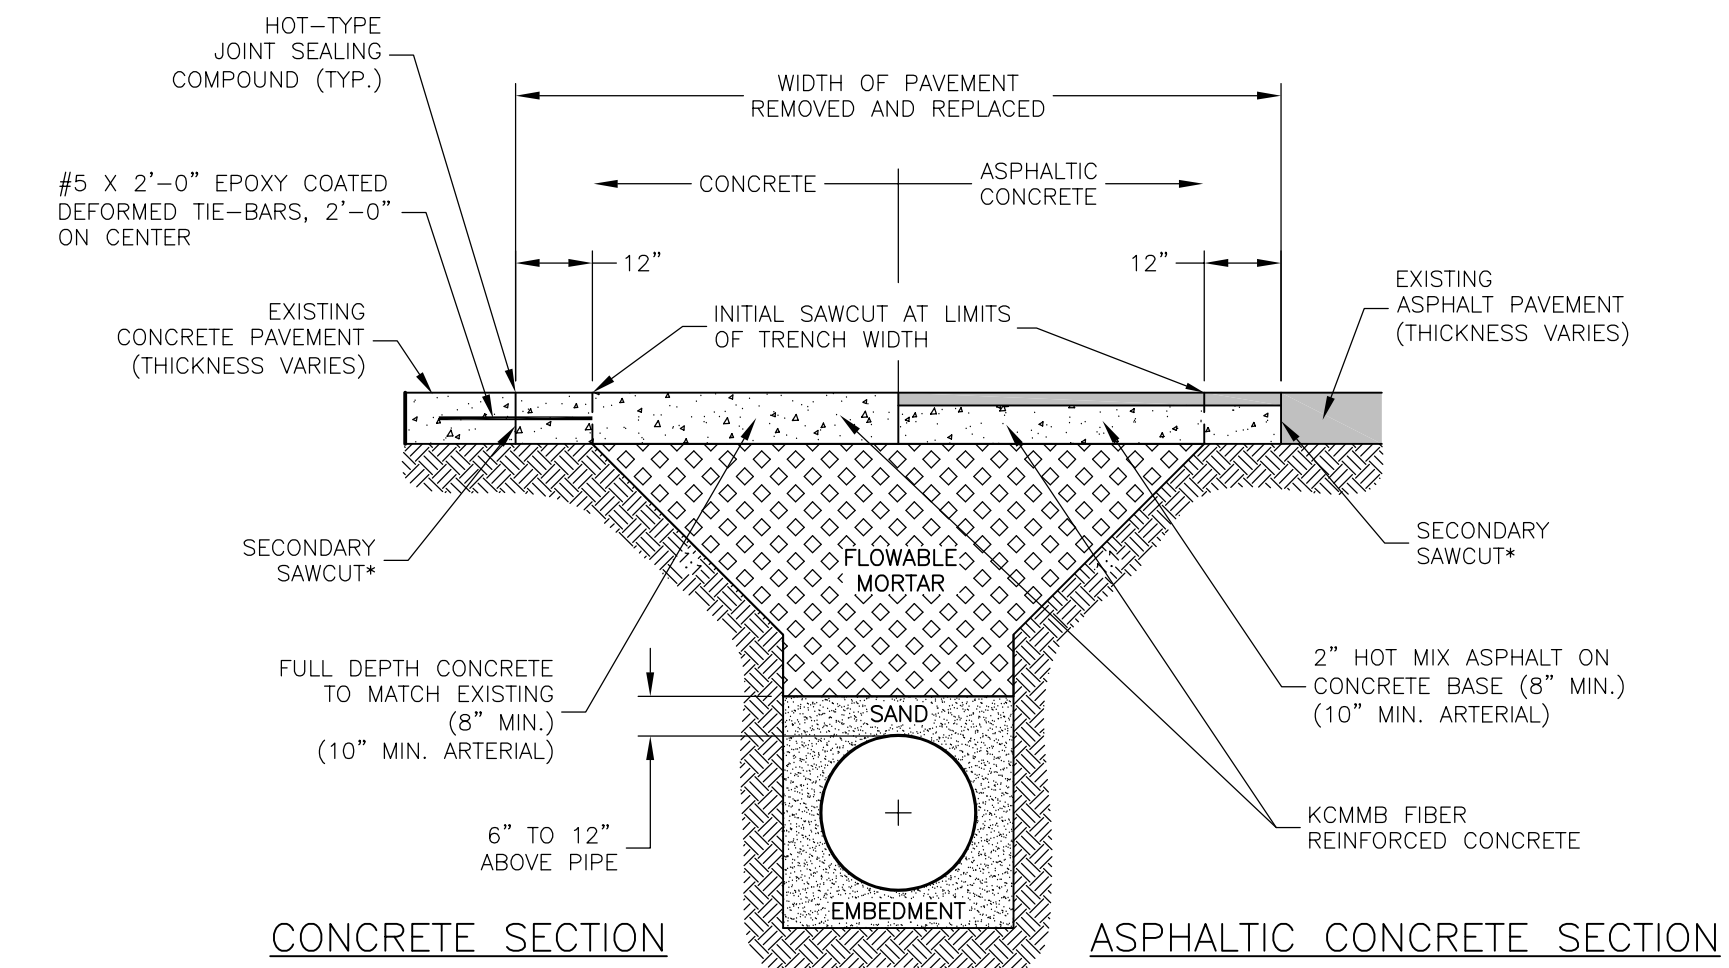

NOTES

1. ALL PAVEMENT SAW CUTS SHALL BE MADE TO FULL DEPTH OF PAVEMENT THICKNESS AND PAVEMENT REMOVED WITHOUT DAMAGE TO ADJACENT PAVEMENT.
2. ALL TRENCHING AND BACKFILL SHALL BE ACCOMPLISHED TO PAVING SUBGRADE PRIOR TO INITIATION OF SECOND SAW CUT AND ADDITIONAL PAVEMENT REMOVAL.
3. PRIOR TO INSTALLATION OF FLOWABLE MORTAR AND NEW PAVEMENT, PAVEMENT SHALL BE OVERCUT TO EXTEND BEYOND ANY LOCATION THAT BECOMES UNDERMINED WITH APPARENT VOIDS UNDER PAVEMENT.
4. BARS SHALL BE DRILLED AND GROUTED INTO EXISTING CONCRETE PAVEMENT.
5. DRILLING AND GROUTING SHALL BE PER KDOT SPECIFICATIONS SECTION 842.
6. TRENCH BACKFILL SHALL BE FLOWABLE FILL FROM TWO (2) FEET BEHIND THE BACK OF CURB ON EACH SIDE OF THE STREET (INCLUSIVE OF GRAVEL DRIVES AND ALLEYS).
7. FOR OVERLAYED BRICK STREETS, THE BRICKS NEED TO BE CLEANED AND PALLETED. CONTACT THE CITY OF LAWRENCE STREET DIVISION TO SCHEDULE PICKUP. THE REMAINING TRENCH SHOULD BE TREATED AS PER THE ASPHALT OVERLAY DETAIL.
8. FOR BRICK STREETS, THE BRICK NEEDS TO BE REPLACED.

PERMANENT PAVEMENT REMOVAL AND REPLACEMENT DETAILS

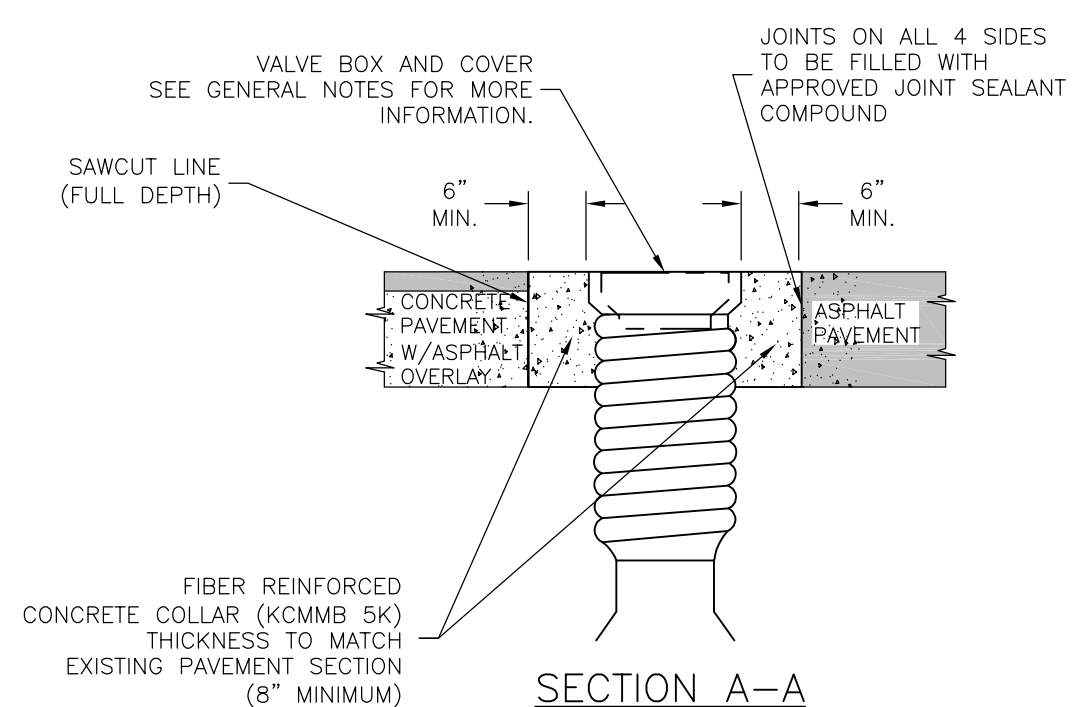
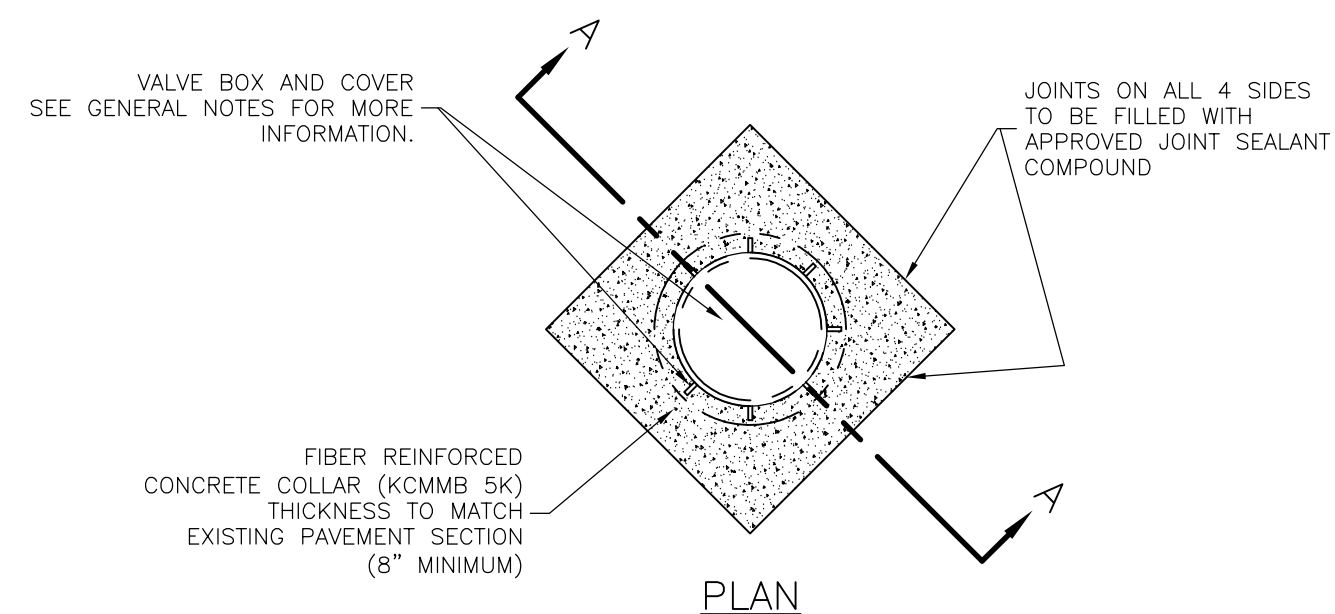


SECTION A-A

GENERAL NOTES

- 1.) ADJUST VALVE BOX FRAME AND COVER TO FINISH GRADE AND SLOPE.
- 2.) THE ORIENTATION OF THE REINFORCED CONCRETE COLLAR SHALL BE DETERMINED BY THE ENGINEER IN THE FIELD.
- 3.) ALL ITEMS SHOWN ABOVE ARE SUBSIDIARY TO THE BID ITEM "VALVE ADJUSTMENT".

STANDARD VALVE ADJUSTMENT DETAILS

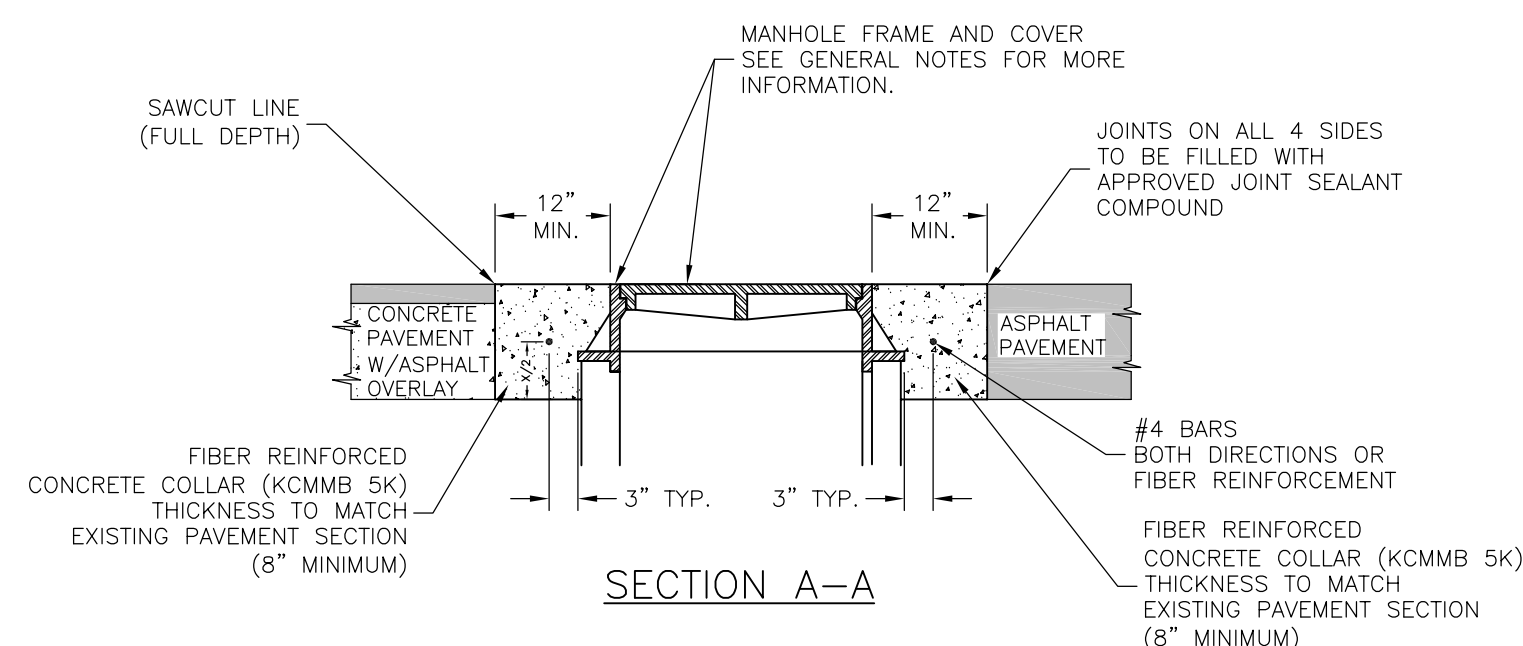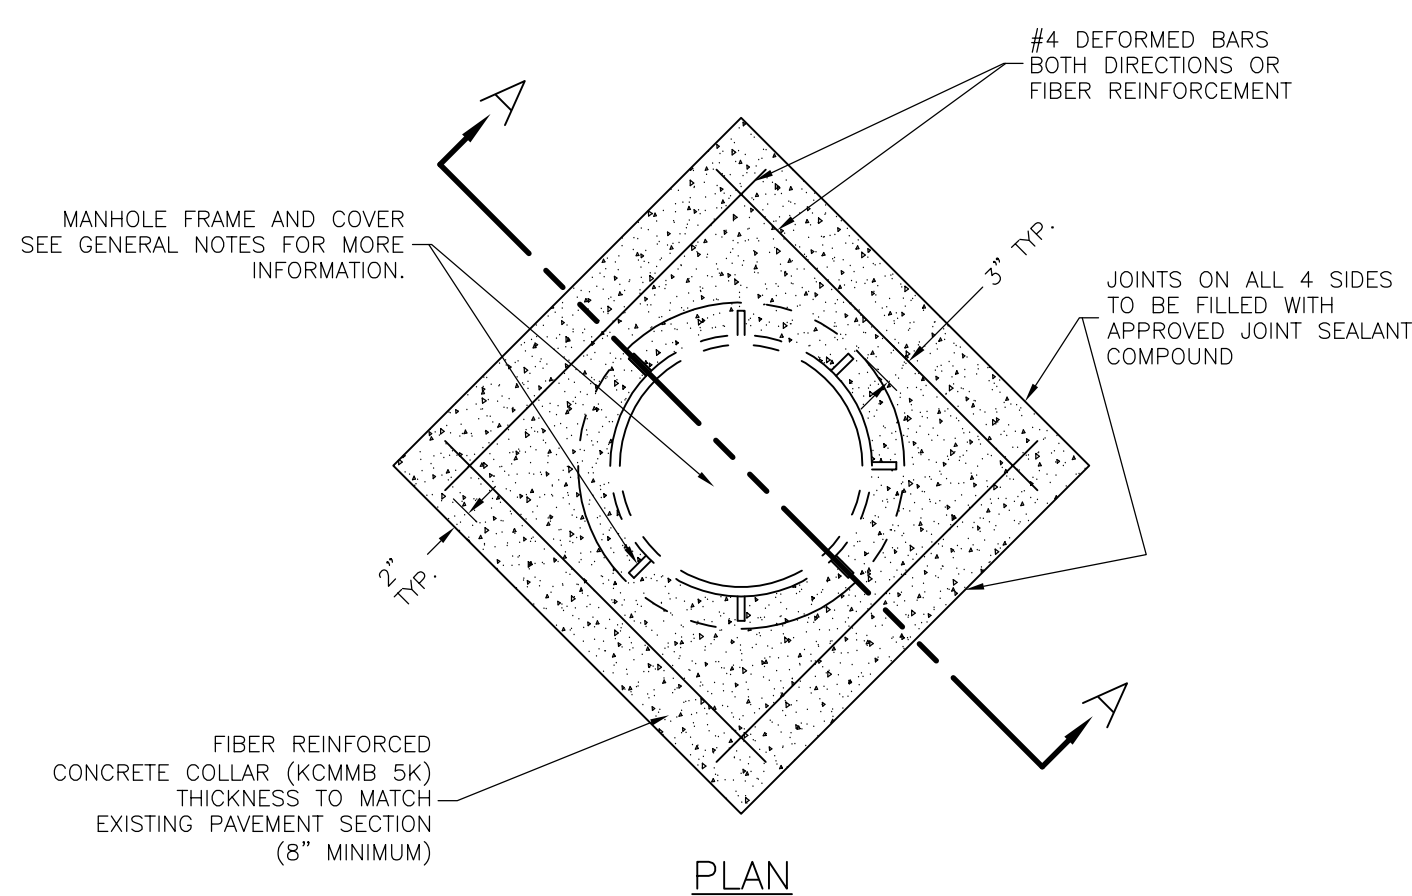


SECTION A-A

GENERAL NOTES

- 1.) ADJUST MANHOLE FRAME AND COVER TO FINISH GRADE AND SLOPE WITH CONCRETE ADJUSTMENT RINGS AND LEVELING MORTAR AS REQUIRED.
- 2.) THE ORIENTATION OF THE REINFORCED CONCRETE COLLAR SHALL BE DETERMINED BY THE ENGINEER IN THE FIELD.
- 3.) ALL ITEMS SHOWN ABOVE ARE SUBSIDIARY TO THE BID ITEM "MANHOLE ADJUSTMENT".


STANDARD MANHOLE ADJUSTMENT DETAILS

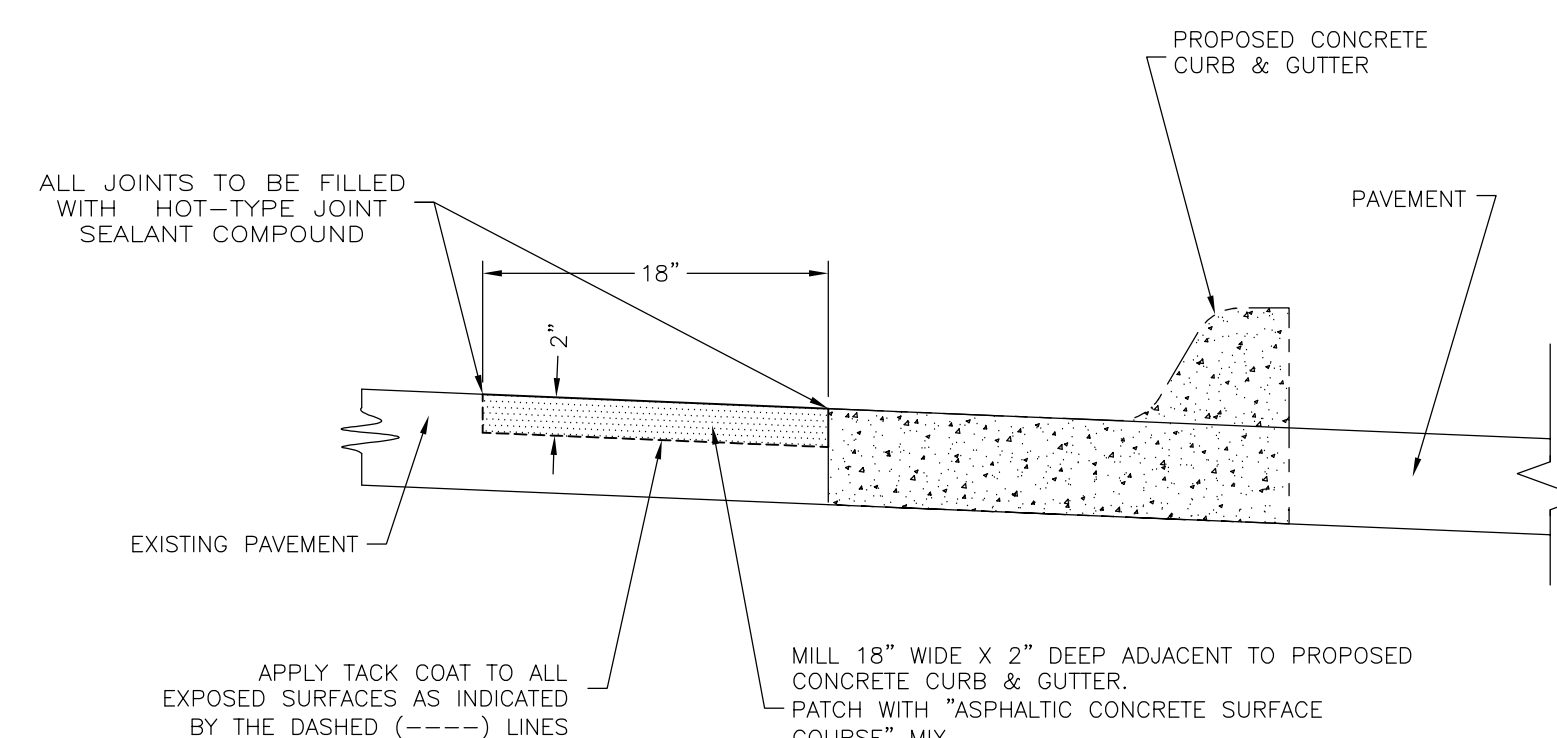

ASPHALTIC CONCRETE EDGE PATCH DETAIL ADJACENT TO PROPOSED CONCRETE CURB AND GUTTER OR PAVEMENT

GENERAL NOTES

- 1.) ADJUST MONUMENT BOX TO FINISH GRADE AND SLOPE WITH CONCRETE ADJUSTMENT RINGS AND LEVELING MORTAR AS REQUIRED.
- 2.) THE ORIENTATION OF THE REINFORCED CONCRETE COLLAR SHALL BE DETERMINED BY THE CITY SURVEYOR IN THE FIELD.
- 3.) ALL ITEMS SHOWN ABOVE ARE SUBSIDIARY TO THE BID ITEM "MONUMENT BOX INSTALL/ADJUSTMENT".
- 4.) JOINT SEALANT SUBSIDIARY TO OTHER BID ITEMS.
- 5.) TACK COAT SUBSIDIARY TO OTHER BID ITEMS.
- 6.) ASPHALTIC CONCRETE EDGE PATCH SUBSIDIARY TO OTHER BID ITEMS.

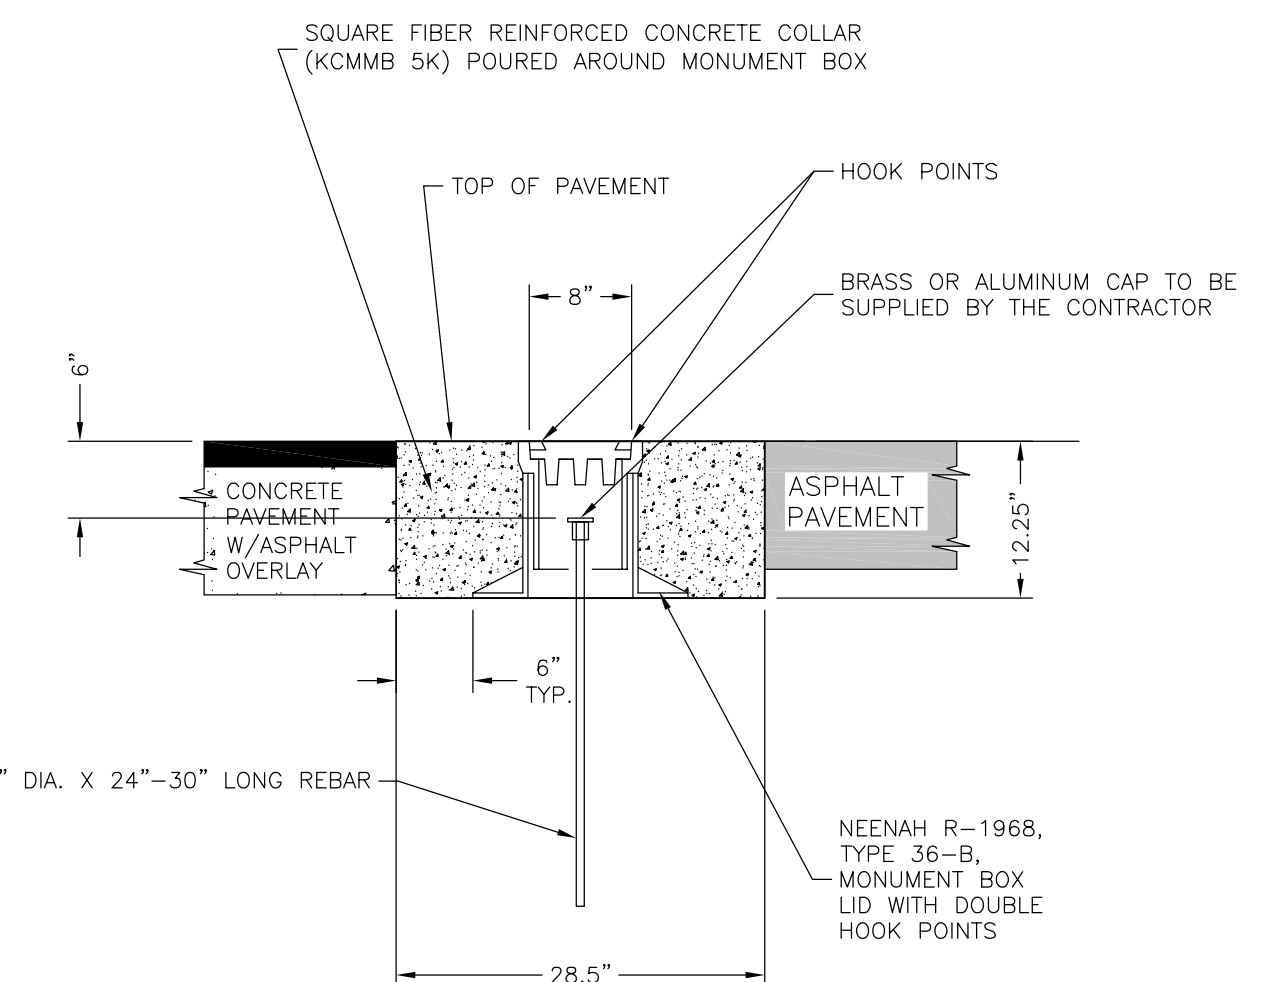

TYPE 1 MONUMENT BOX DETAIL

GENERAL NOTES

- 1.) ADJUST MONUMENT BOX TO FINISH GRADE AND SLOPE WITH CONCRETE ADJUSTMENT RINGS AND LEVELING MORTAR AS REQUIRED.
- 2.) THE ORIENTATION OF THE REINFORCED CONCRETE COLLAR SHALL BE DETERMINED BY THE CITY SURVEYOR IN THE FIELD.
- 3.) ALL ITEMS SHOWN ABOVE ARE SUBSIDIARY TO THE BID ITEM "MONUMENT BOX INSTALL/ADJUSTMENT".
- 4.) OPTION TO INSTALL BY CORING METHOD AS APPROVED BY THE ENGINEER.

2021 EDITION

SHEET 43 OF 49

DATE	BY	REVISION
03-01-21	LJM	REPLACES ALL PREVIOUS VERSIONS OF STREET REPAIR DETAILS
03-01-20	LJM	REPLACES ALL PREVIOUS VERSIONS OF STREET REPAIR DETAILS



STANDARD DETAILS FOR STREET REPAIR

DAVID P. CRONIN
CITY ENGINEER

CRAIG S. OWENS
CITY MANAGER





1. FLOWABLE MORTAR MATERIALS AND PLACEMENT LIMITS SHALL CONFORM TO SECTION 1102E AND 1107B OF THE CITY OF LAWRENCE CONSTRUCTION AND MATERIAL SPECIFICATIONS SECTION 1100--GRADING RESPECTIVELY.
2. COMPACTED BACKFILL SHALL CONFORM TO SECTION 1107B AND 1108 OF THE CITY OF LAWRENCE CONSTRUCTION AND MATERIAL SPECIFICATIONS SECTION 1100--GRADING.
3. DETAIL SHOWN SHALL GOVERN IN NEW CONSTRUCTION. THE CITY OF LAWRENCE STANDARD DETAILS FOR STREET REPAIR--PAVEMENT REPAIRS AND REPLACEMENT DETAIL FOR TRENCHING WITHIN EXISTING ROADWAYS SHALL GOVERN WITHIN EXISTING PAVEMENT.

SANITARY SEWER TRENCH DETAILS
N.T.S.



NOTES

1. PRECAST MANHOLES SHALL CONFORM TO ASTM C-478 AND THE KANSAS DEPARTMENT OF HEALTH AND ENVIRONMENT MINIMUM STANDARDS OF DESIGN.
2. PIPE(S) SHALL BE TEMPORARILY PLUGGED PRIOR TO FORMING INVERTS. INVERTS SHALL BE FORMED WITH KOMBB 4K CONCRETE OR GROUT PER SPECIFICATIONS.
3. STANDARD DEPTH MANHOLE IS 6'-0". LESSER DEPTH TO BE PAID FOR AS STANDARD 6'-0" MANHOLE.
4. GRANULAR EMBEDMENT SHALL BE PLACED FROM THE OUTSIDE FACE OF THE MANHOLE TO A DISTANCE OF 18" BEYOND THE LIMITS OF EXCAVATION FOR THE MANHOLE, AS SHOWN.
5. COMPRESSION TYPE PIPE TO MANHOLE CONNECTIONS SHALL BE A-LOOK, MANHOLE PIPE CONNECTORS, OR APPROVED EQUAL.
6. D.I.P., V.C.P., OR TRUSS PIPE TO PIPE CONNECTIONS SHALL BE FERNCO RUBBER GASKET COUPLING OR APPROVED EQUAL.
7. MANHOLE RINGS AND LIDS SHALL BE DEETER FOUNDRY MODEL 1048, OR APPROVED EQUAL, WITH CASING INSIDE DIAMETER OF TWENTY-FOUR (24) INCHES, LID OUTSIDE DIAMETER OF TWENTY-FIVE AND ONE-QUARTER (25.25) INCHES, AND LID SEATING THICKNESS OF ONE AND ONE-HALF (1.5) INCHES PLUS/MINUS ONE-EIGHTH (0.125) OF AN INCH.
8. BEFORE FINAL ACCEPTANCE OF THE PROJECT, A 2"x4" PIECE OF LUMBER, 6'-0" TO 8'-0" TALL, OR A STEEL FENCE POST, 5'-0" TO 6'-0" TALL, SHALL BE PLACED ADJACENT TO EACH MANHOLE, IN ORDER TO LOCATE THESE STRUCTURES FOR CONTRACTORS DURING FUTURE DEVELOPMENT.
9. THE WALL THICKNESS FOR MANHOLES UNDER 16'-0" DEEP SHALL BE 1/12 OF THE INTERNAL SHELL DIAMETER, OR 4", WHICHEVER IS GREATER. THE WALL THICKNESS FOR MANHOLES 16'-0" DEEP OR GREATER SHALL BE 1/12 OF THE INTERNAL SHELL DIAMETER PLUS 1" OR 5", WHICHEVER IS GREATER.
10. IF THE SANITARY SEWER PIPE HAS A DEFLECTION IN IT, SUCH PIPE SHALL BE ROTATED SO THAT THE DEFLECTION IS ON IT'S SIDE.
11. ANY SANITARY SEWER PIPE FOUND TO HAVE MORE THAN A 5% DEFLECTION WILL BE REJECTED.
12. ALL REINFORCING SHALL AS BE NOTED ON PLANS AND/OR SHOP DRAWINGS AND SHALL CONFORM TO CITY OF LAWRENCE MUNICIPAL SERVICES AND OPERATIONS DEPARTMENT SPECIFICATIONS FOR SANITARY SEWER, SECTION 2510.3.7.
13. LIFT HOLES IN PRE-CAST STRUCTURES SHALL BE PATCHED WITH NON-SHRINK GROUT AFTER TESTING.

2021 EDITION			SHEET 44 OF 49		
DATE	BY	REVISION			
03-01-21	LJM	REPLACES ALL PREVIOUS VERSIONS OF SANITARY SEWER DETAILS			
03-01-20	LJM	REPLACES ALL PREVIOUS VERSIONS OF SANITARY SEWER DETAILS			



STANDARD DETAILS FOR SANITARY SEWER—GRAVITY

1 OF 2

ANDREW P. ENSZ CRAIG S. OWENS
PROGRAM MANAGER CITY MANAGER




-
- 1" CAPPED PVC PIPE
- 1'-6" (MIN.)
- 5'-0" (MAX.)
- FINISHED GRADE
- 5' INTO LOT FROM EASEMENT LINE
- SOLVENT WELD CAP
- 45° BEND
- SCH. 40 PVC 12" MIN. LENGTH
- 4" BEDDING
- 45° BEND
- 45° BEND
- 24" MIN.
- 4" BEDDING
- 45°
- SCH. 40 PVC 24" MIN. LENGTH
- SERVICE TEE OR WYE 6x6xSCH.40 HUB
- 15' UTILITY EASEMENT (TYP.)
- 7.5' TYP.
- LOT LINE
- PRIVATE
- PUBLIC
- TRENCH WALL
- GRAVITY SANITARY SEWER MAIN
- TRENCH BOTTOM
- EMBEDMENT PER SPEC. SECTION 2503.3
- 3'-0" MIN. TO TOP OF EMBEDMENT


Diagram illustrating the layout of a trench. The trench width is specified as 1'-0". The trench length is also specified as 1'-0". A circular feature, likely a manhole or access point, is located within the trench. The diagram includes dimensions for the trench width and length, and a label "TRENCH WIDTH".

DIP, VCP OR TRUSS PIPE CONNECTION
(REPAIRS ONLY)
N.T.S.


CONNECTION TO EXISTING MANHOLE
N.T.S.

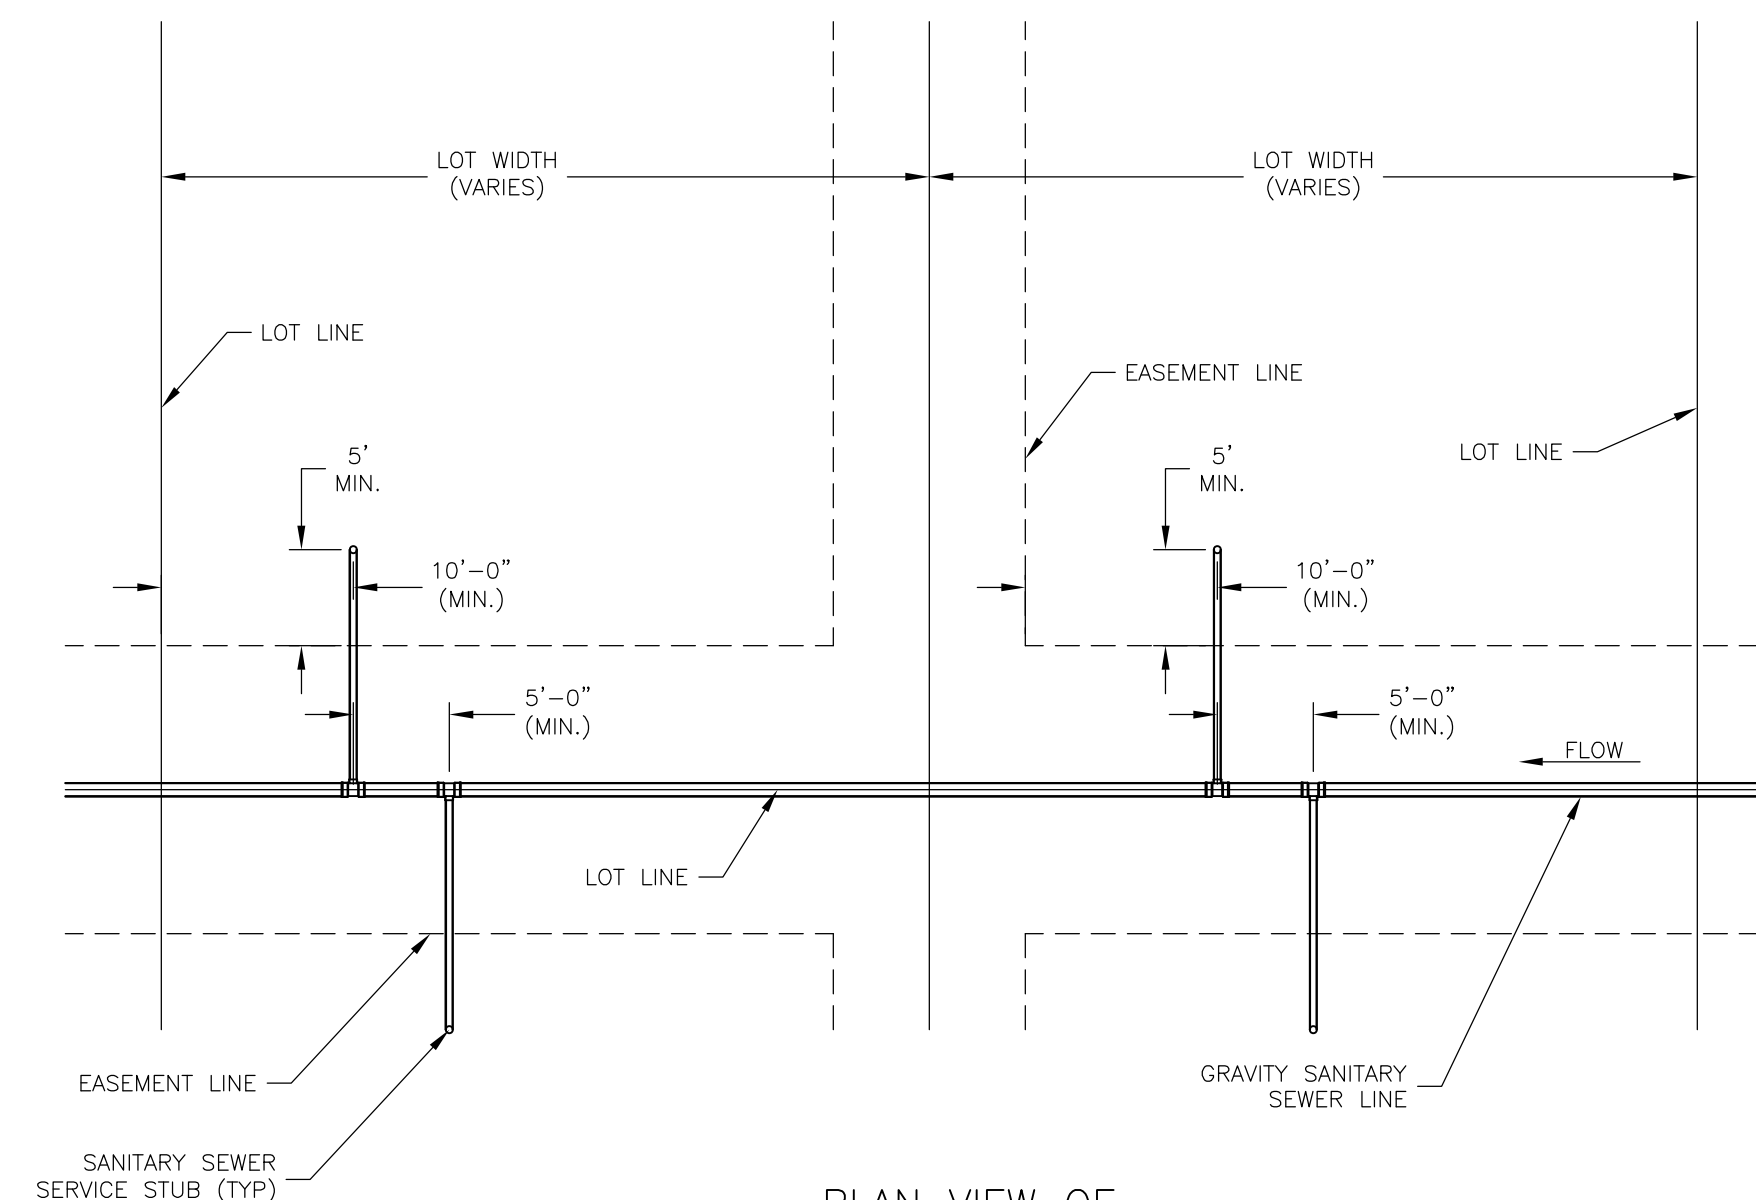

PLAN VIEW OF
SANITARY SEWER SERVICE
TEE CONNECTION STUB OUT LOCATIONS
BACK LOT LINE EXAMPLE SHOWN

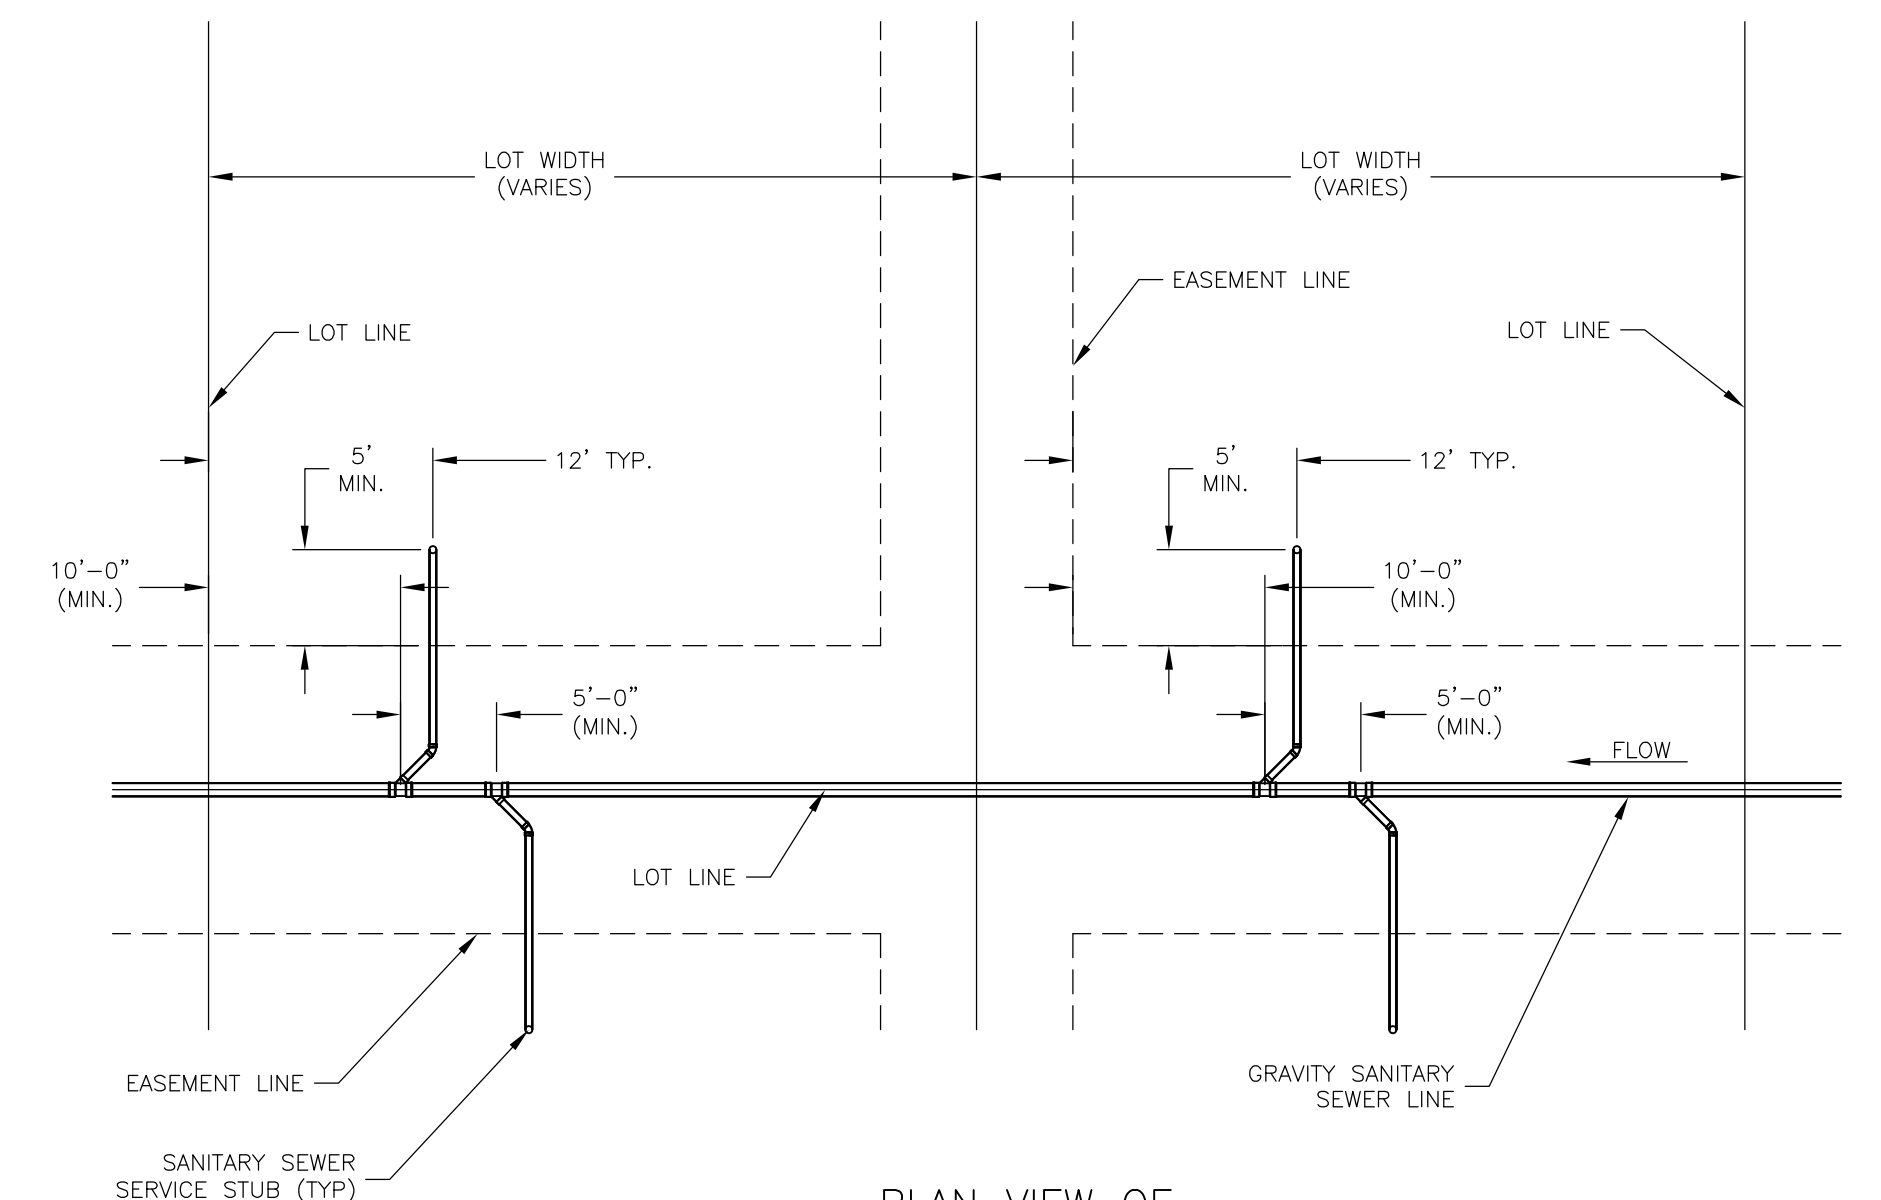

PLAN VIEW OF
SANITARY SEWER SERVICE
WYE CONNECTION STUB OUT LOCATIONS
BACK LOT LINE EXAMPLE SHOWN

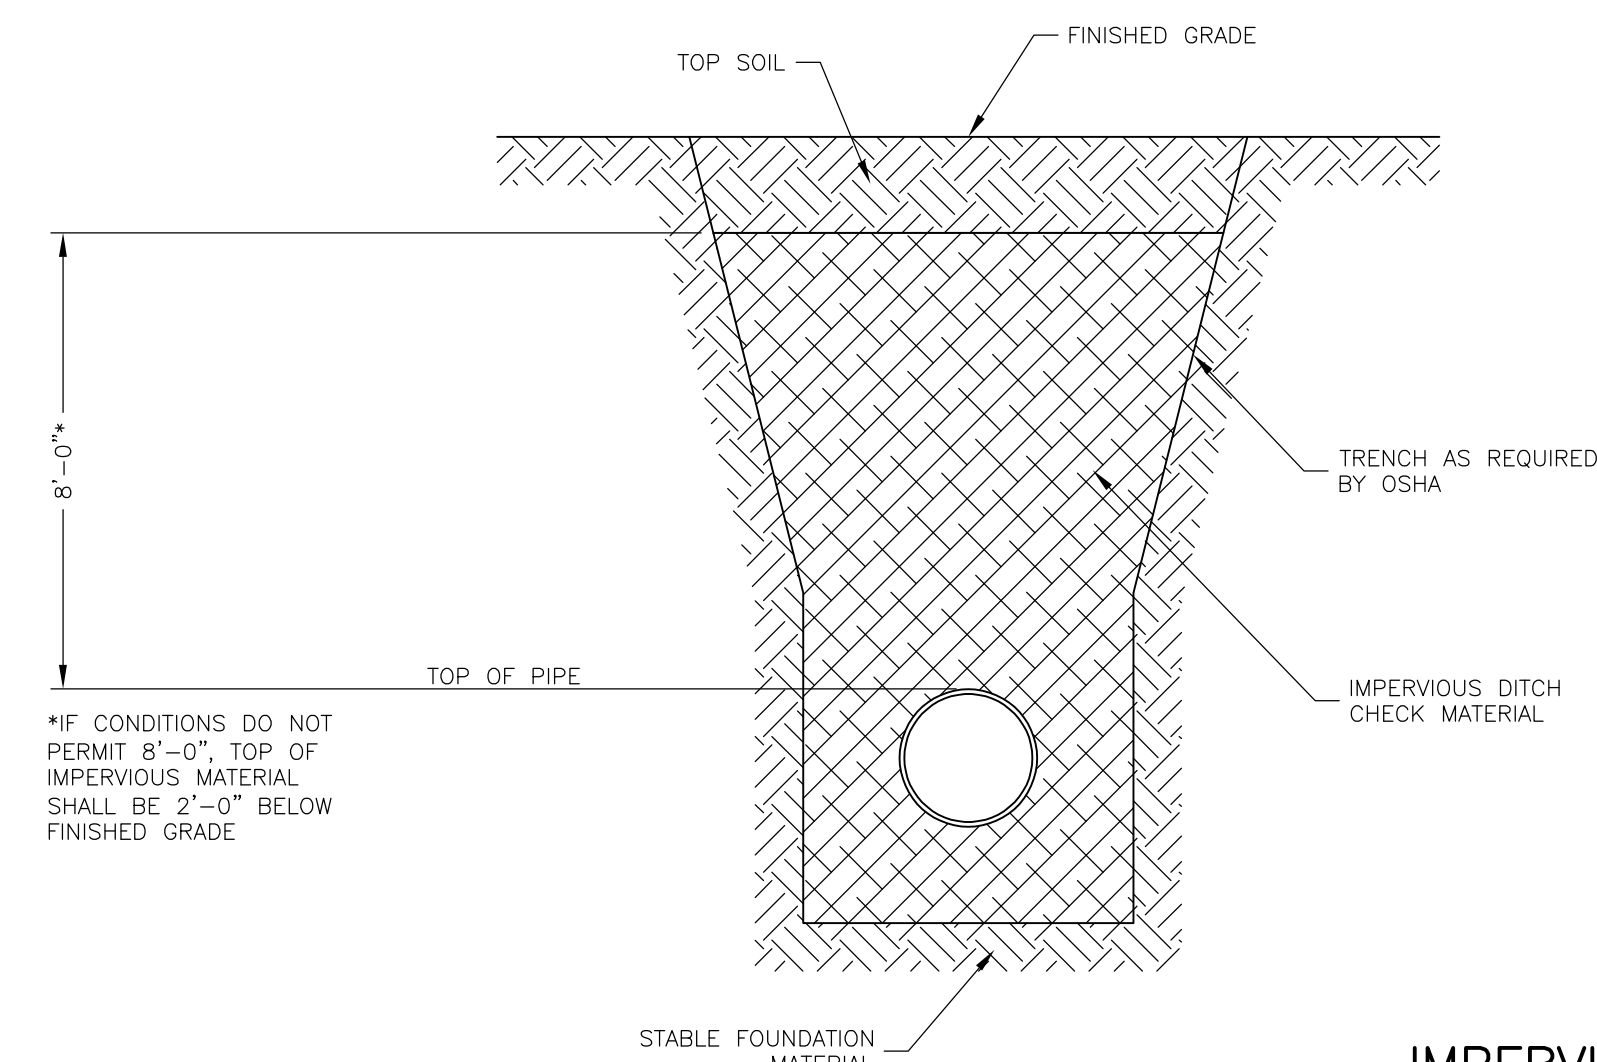

Technical drawing of a wellhead assembly. The drawing shows a side view of a horizontal pipe assembly. Key components and labels include:

- CASING SPACERS PER SPEC. SECTION 2503.5.4.d**: Points to the spacers on the right side of the pipe.
- 12" MAX.**: Dimension line indicating the maximum length of the spacer section.
- END SEAL PER SPEC SECTION 2503.5.4.e**: Points to the seal on the right side of the pipe.
- CASING PIPE PER SPEC SECTION 2503.5.4**: Points to the main pipe body.
- PROVIDE PIPE JOINT AT EACH END OF CASING**: Two labels pointing to the left and right ends of the pipe.
- A**: Two arrows pointing to the right, indicating the direction of flow or pressure.

CASING SPACERS
PER SPEC. SECTION 2503.5.4.d

CASING PIPE
PER SPEC SECTION 2503.5.4

SECTION A-A


2021 EDITION SHEET 45 OF 49

DATE	BY	REVISION
03-01-21	LJM	REPLACES ALL PREVIOUS VERSIONS OF SANITARY SEWER DETAILS
03-01-20	LJM	REPLACES ALL PREVIOUS VERSIONS OF SANITARY SEWER DETAILS


STANDARD DETAILS FOR
SANITARY SEWER—GRAVITY

OF 2 |


ANDREW P. ENSZ CRAIG S. OWENS
PROGRAM MANAGER CITY MANAGER

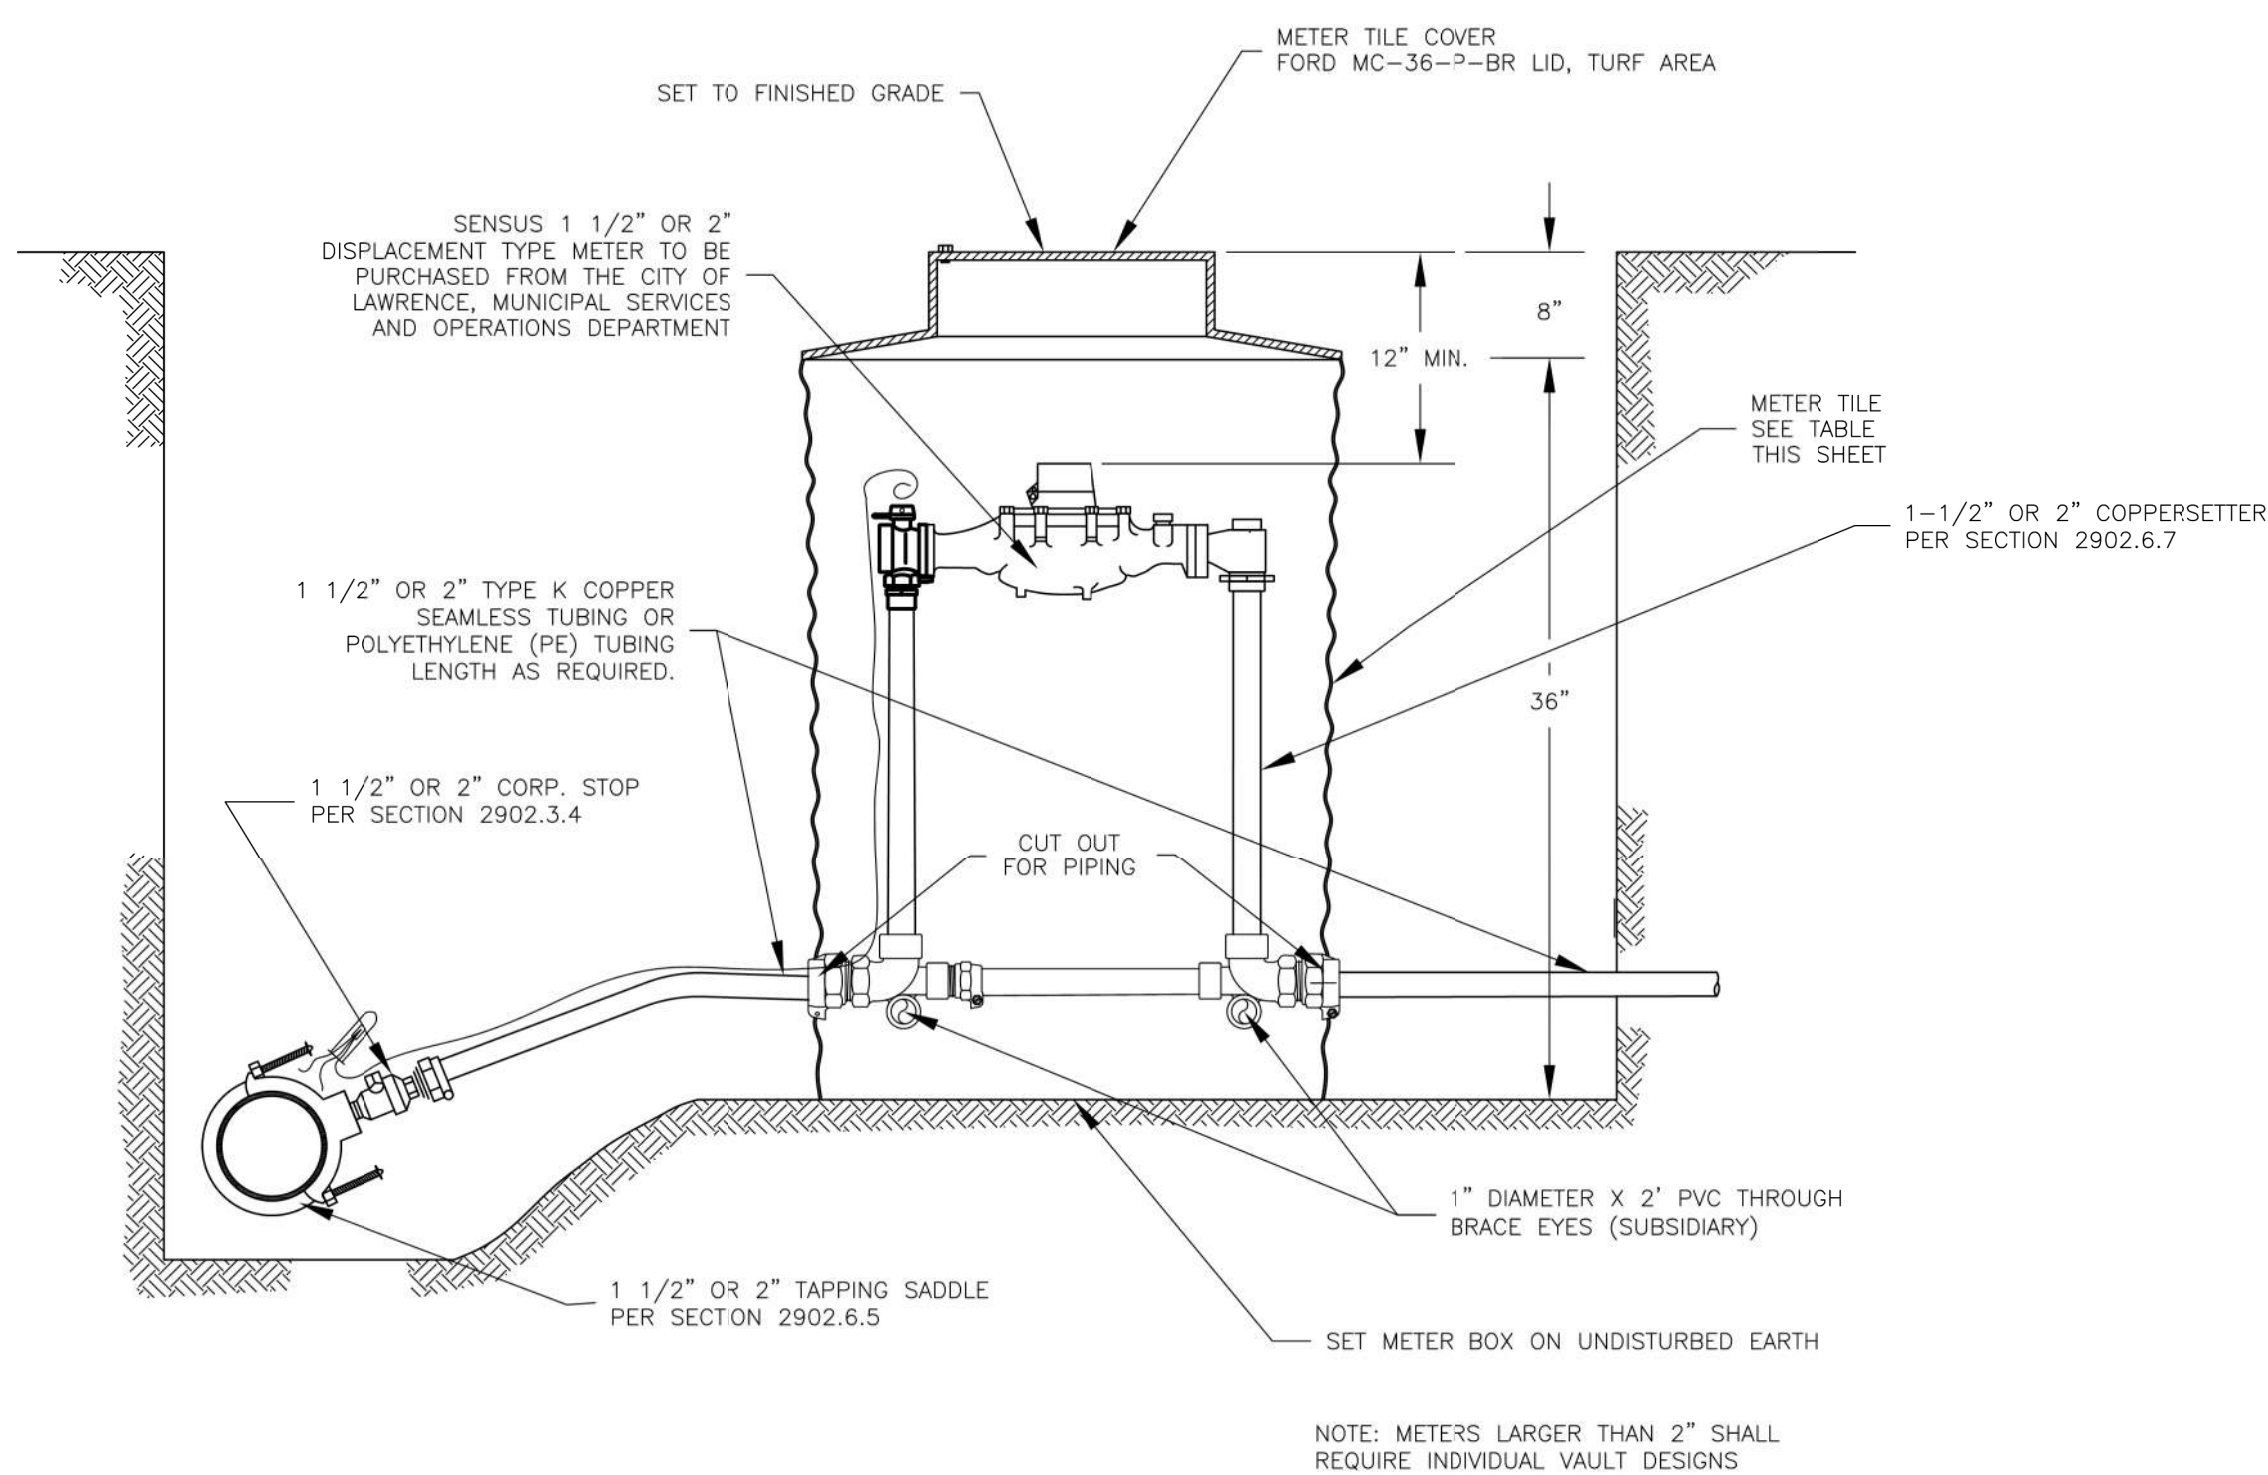


TYPICAL 1-1/2" OR 2" SERVICE CONNECTION
N.T.S.

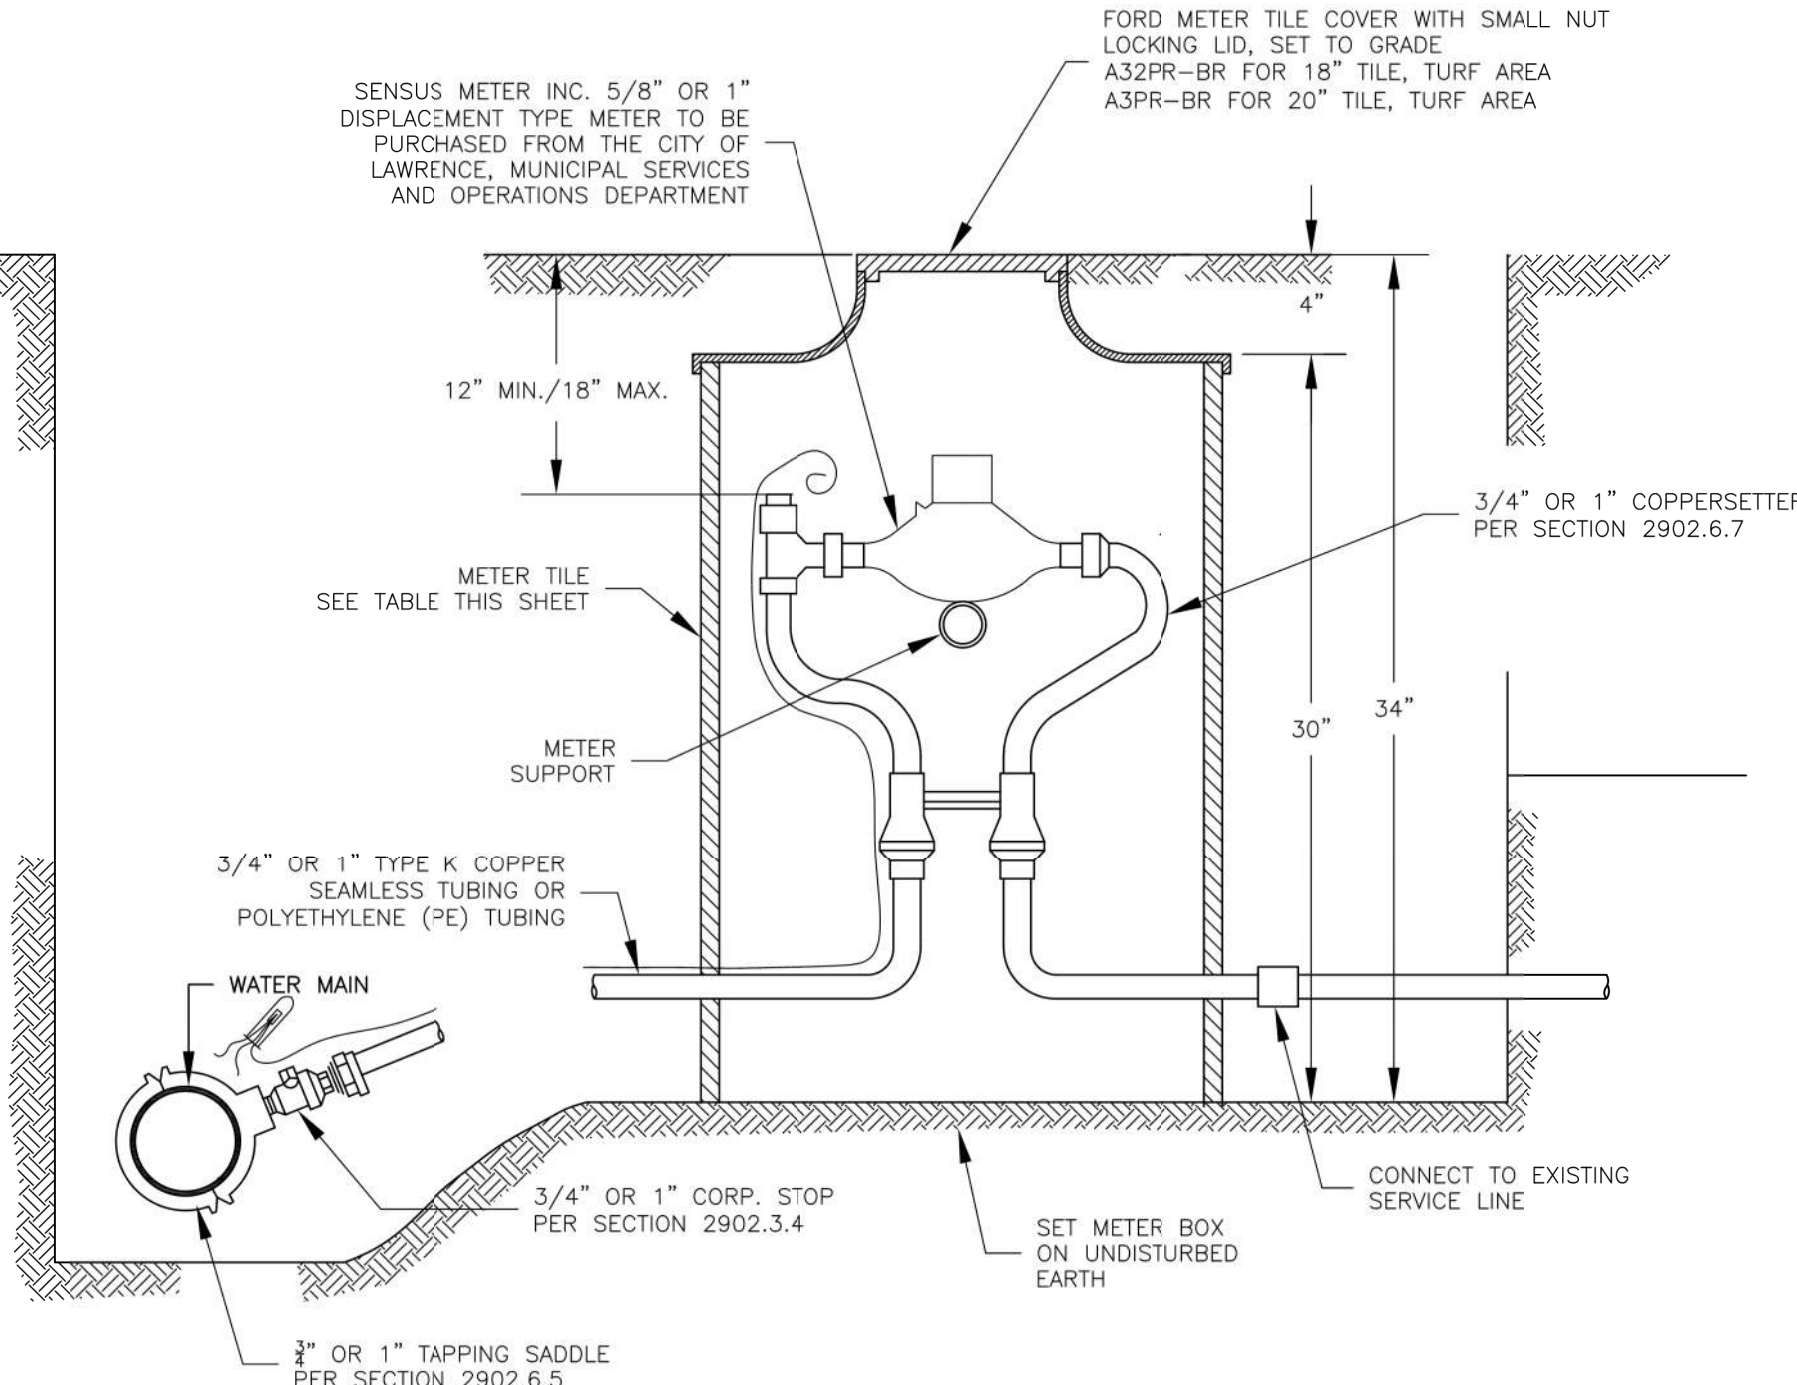


TYPICAL 3/4" AND 1" SERVICE CONNECTION
N.T.S.

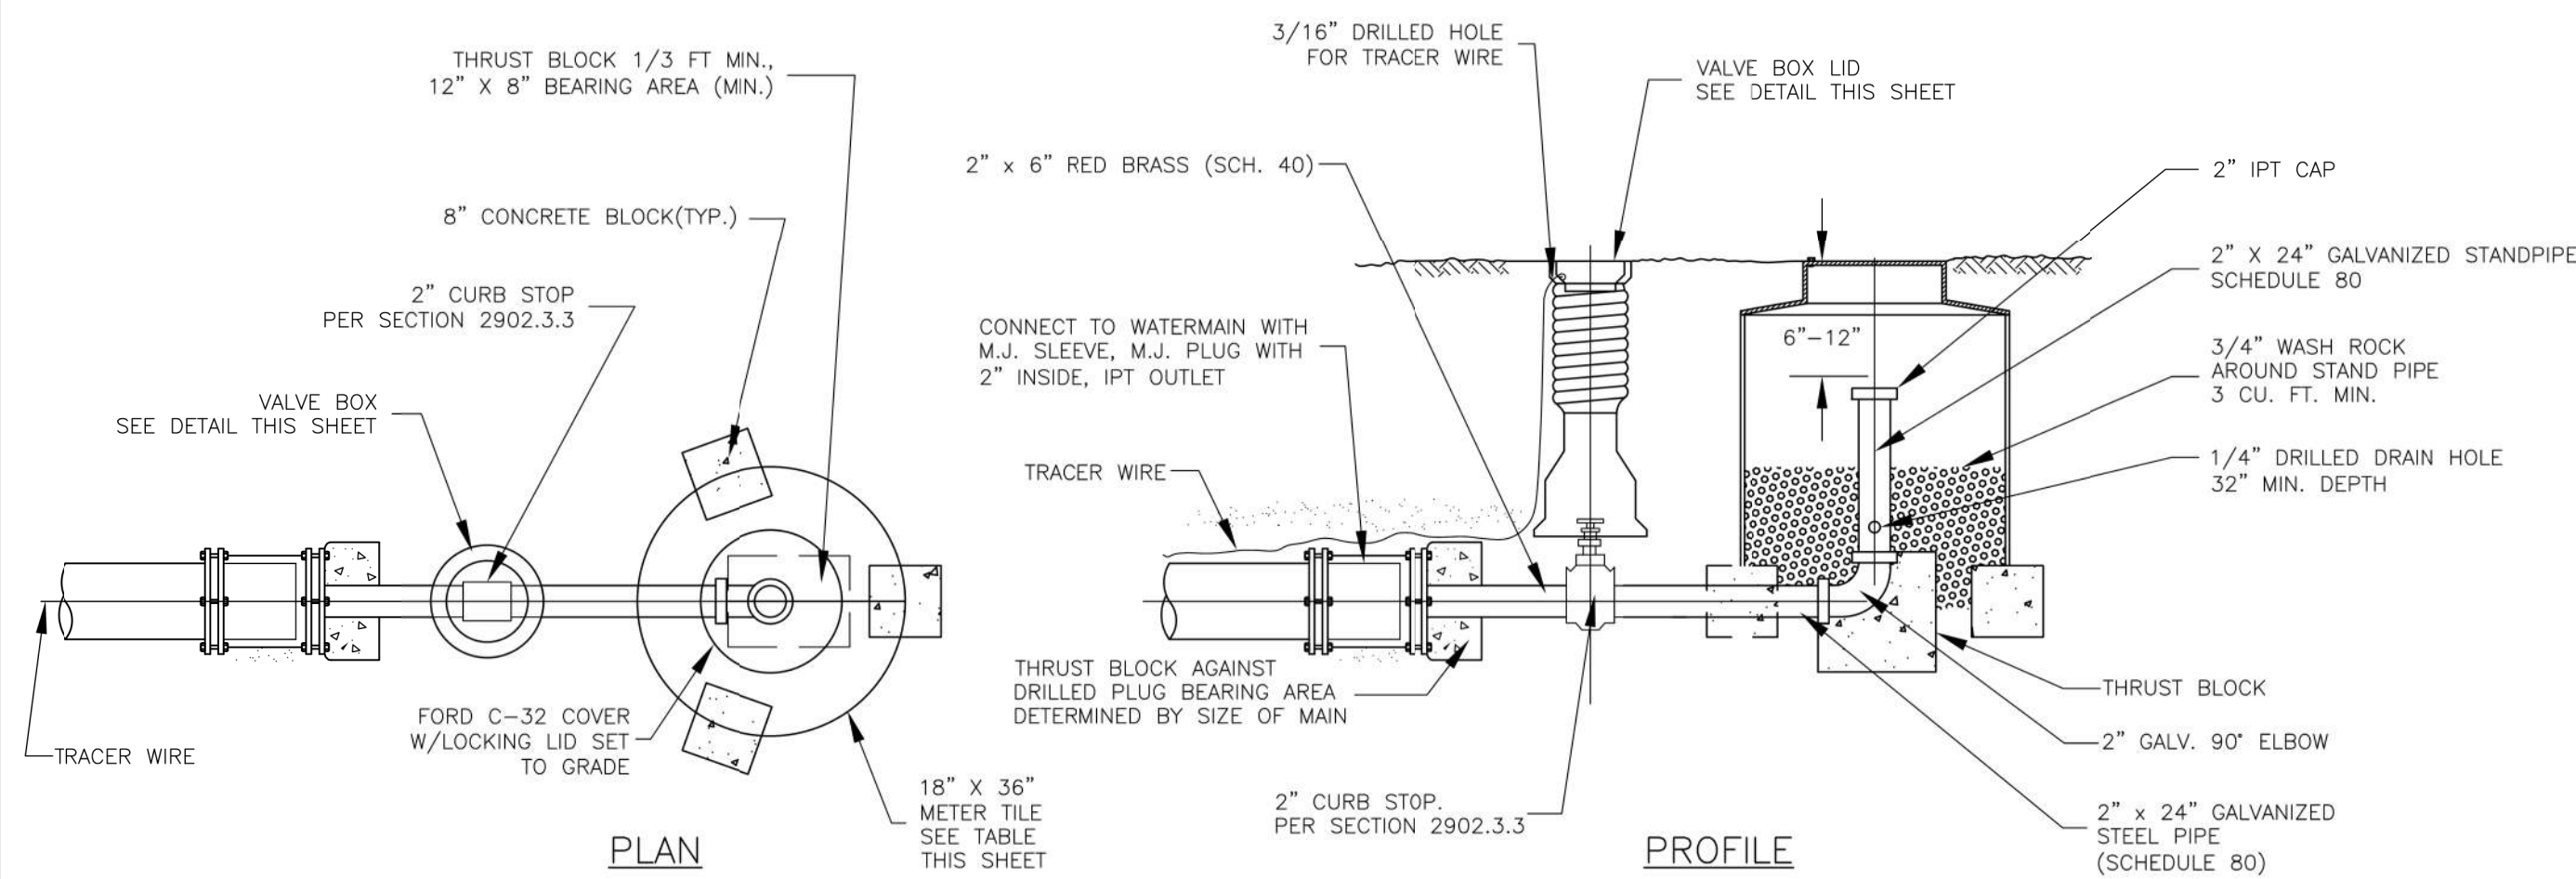


BLOWOFF DETAIL
N.T.S.

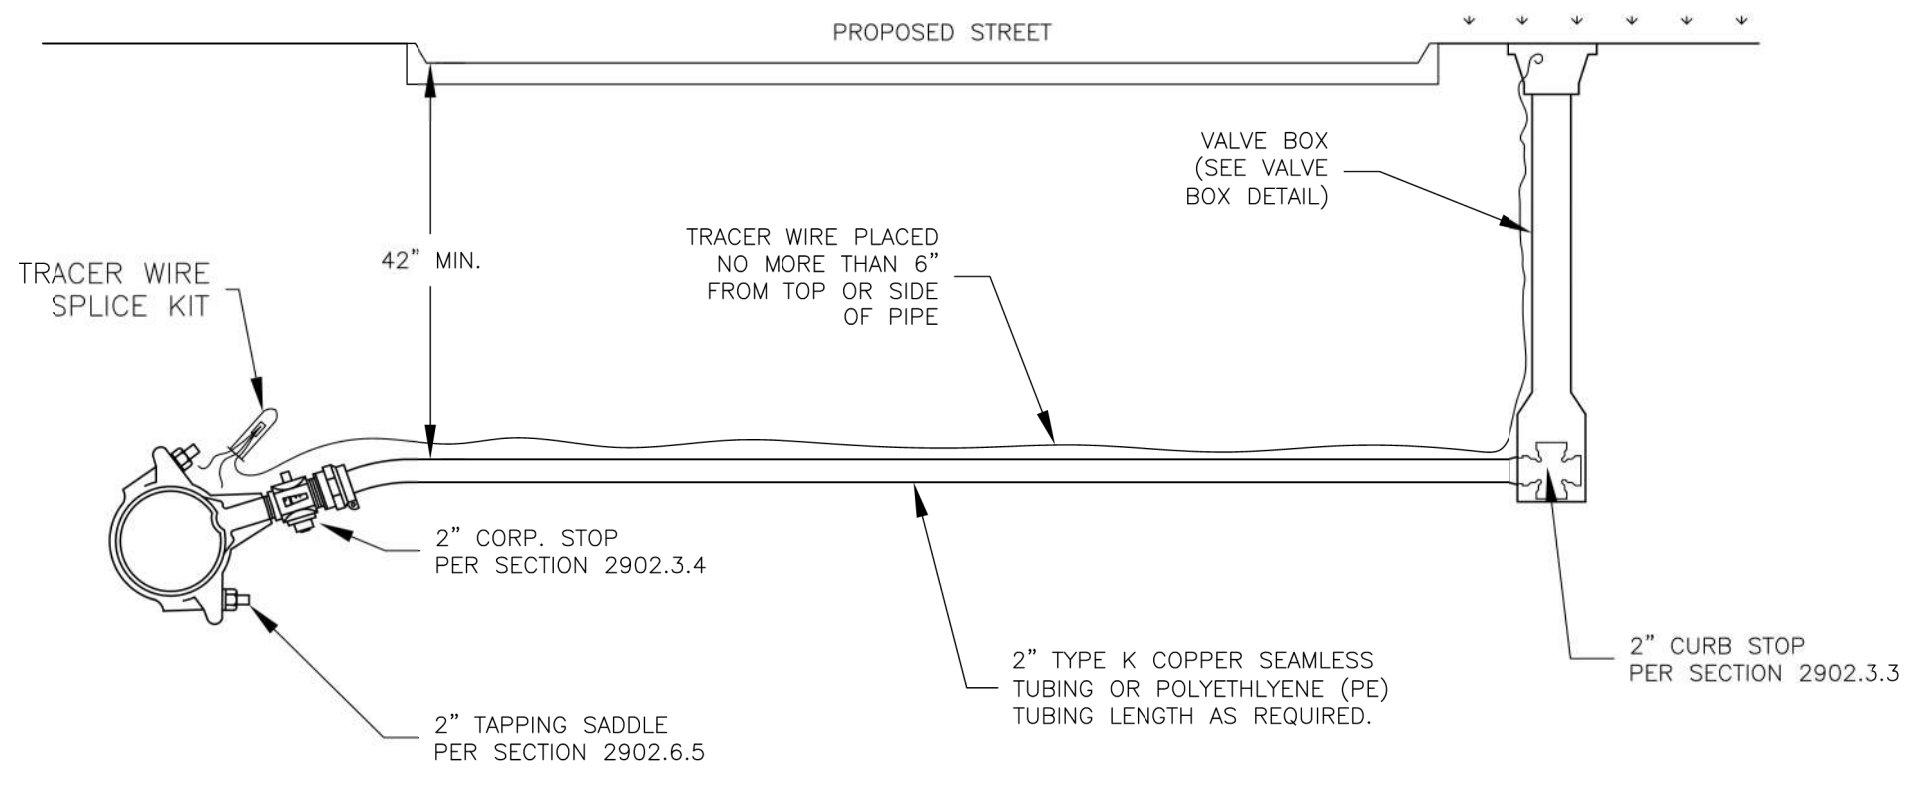

2" STREET SERVICE CROSSING
N.T.S.

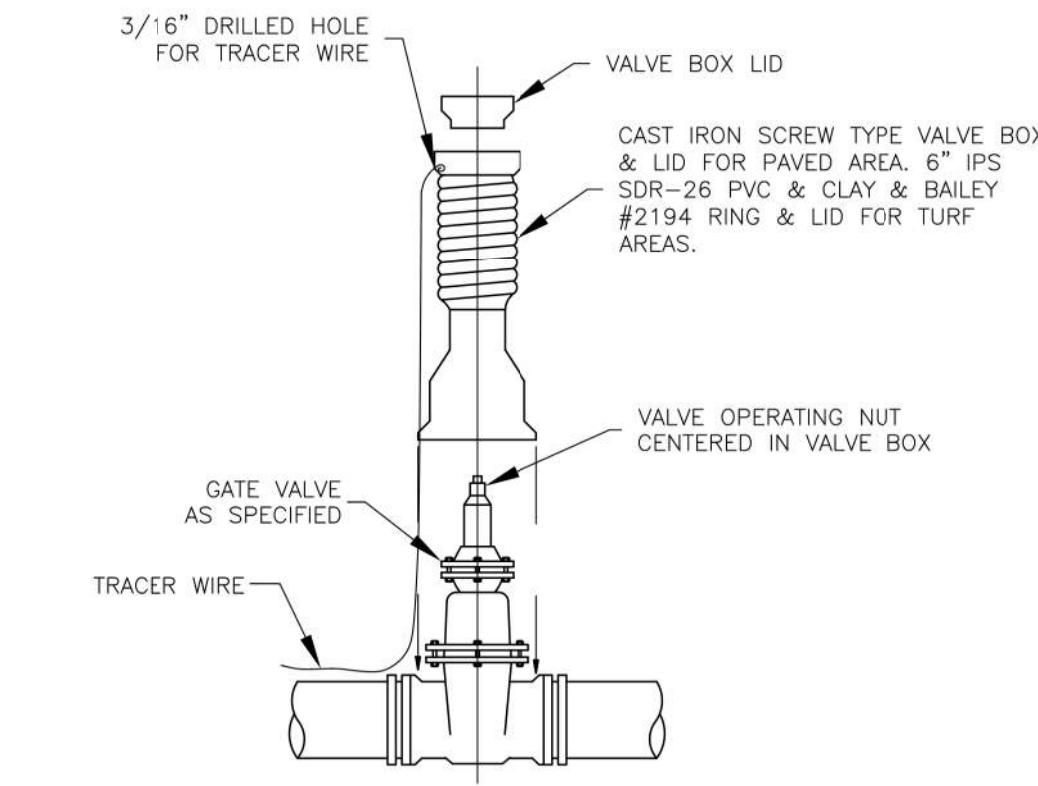


VALVE AND VALVE BOX DETAIL
N.T.S.

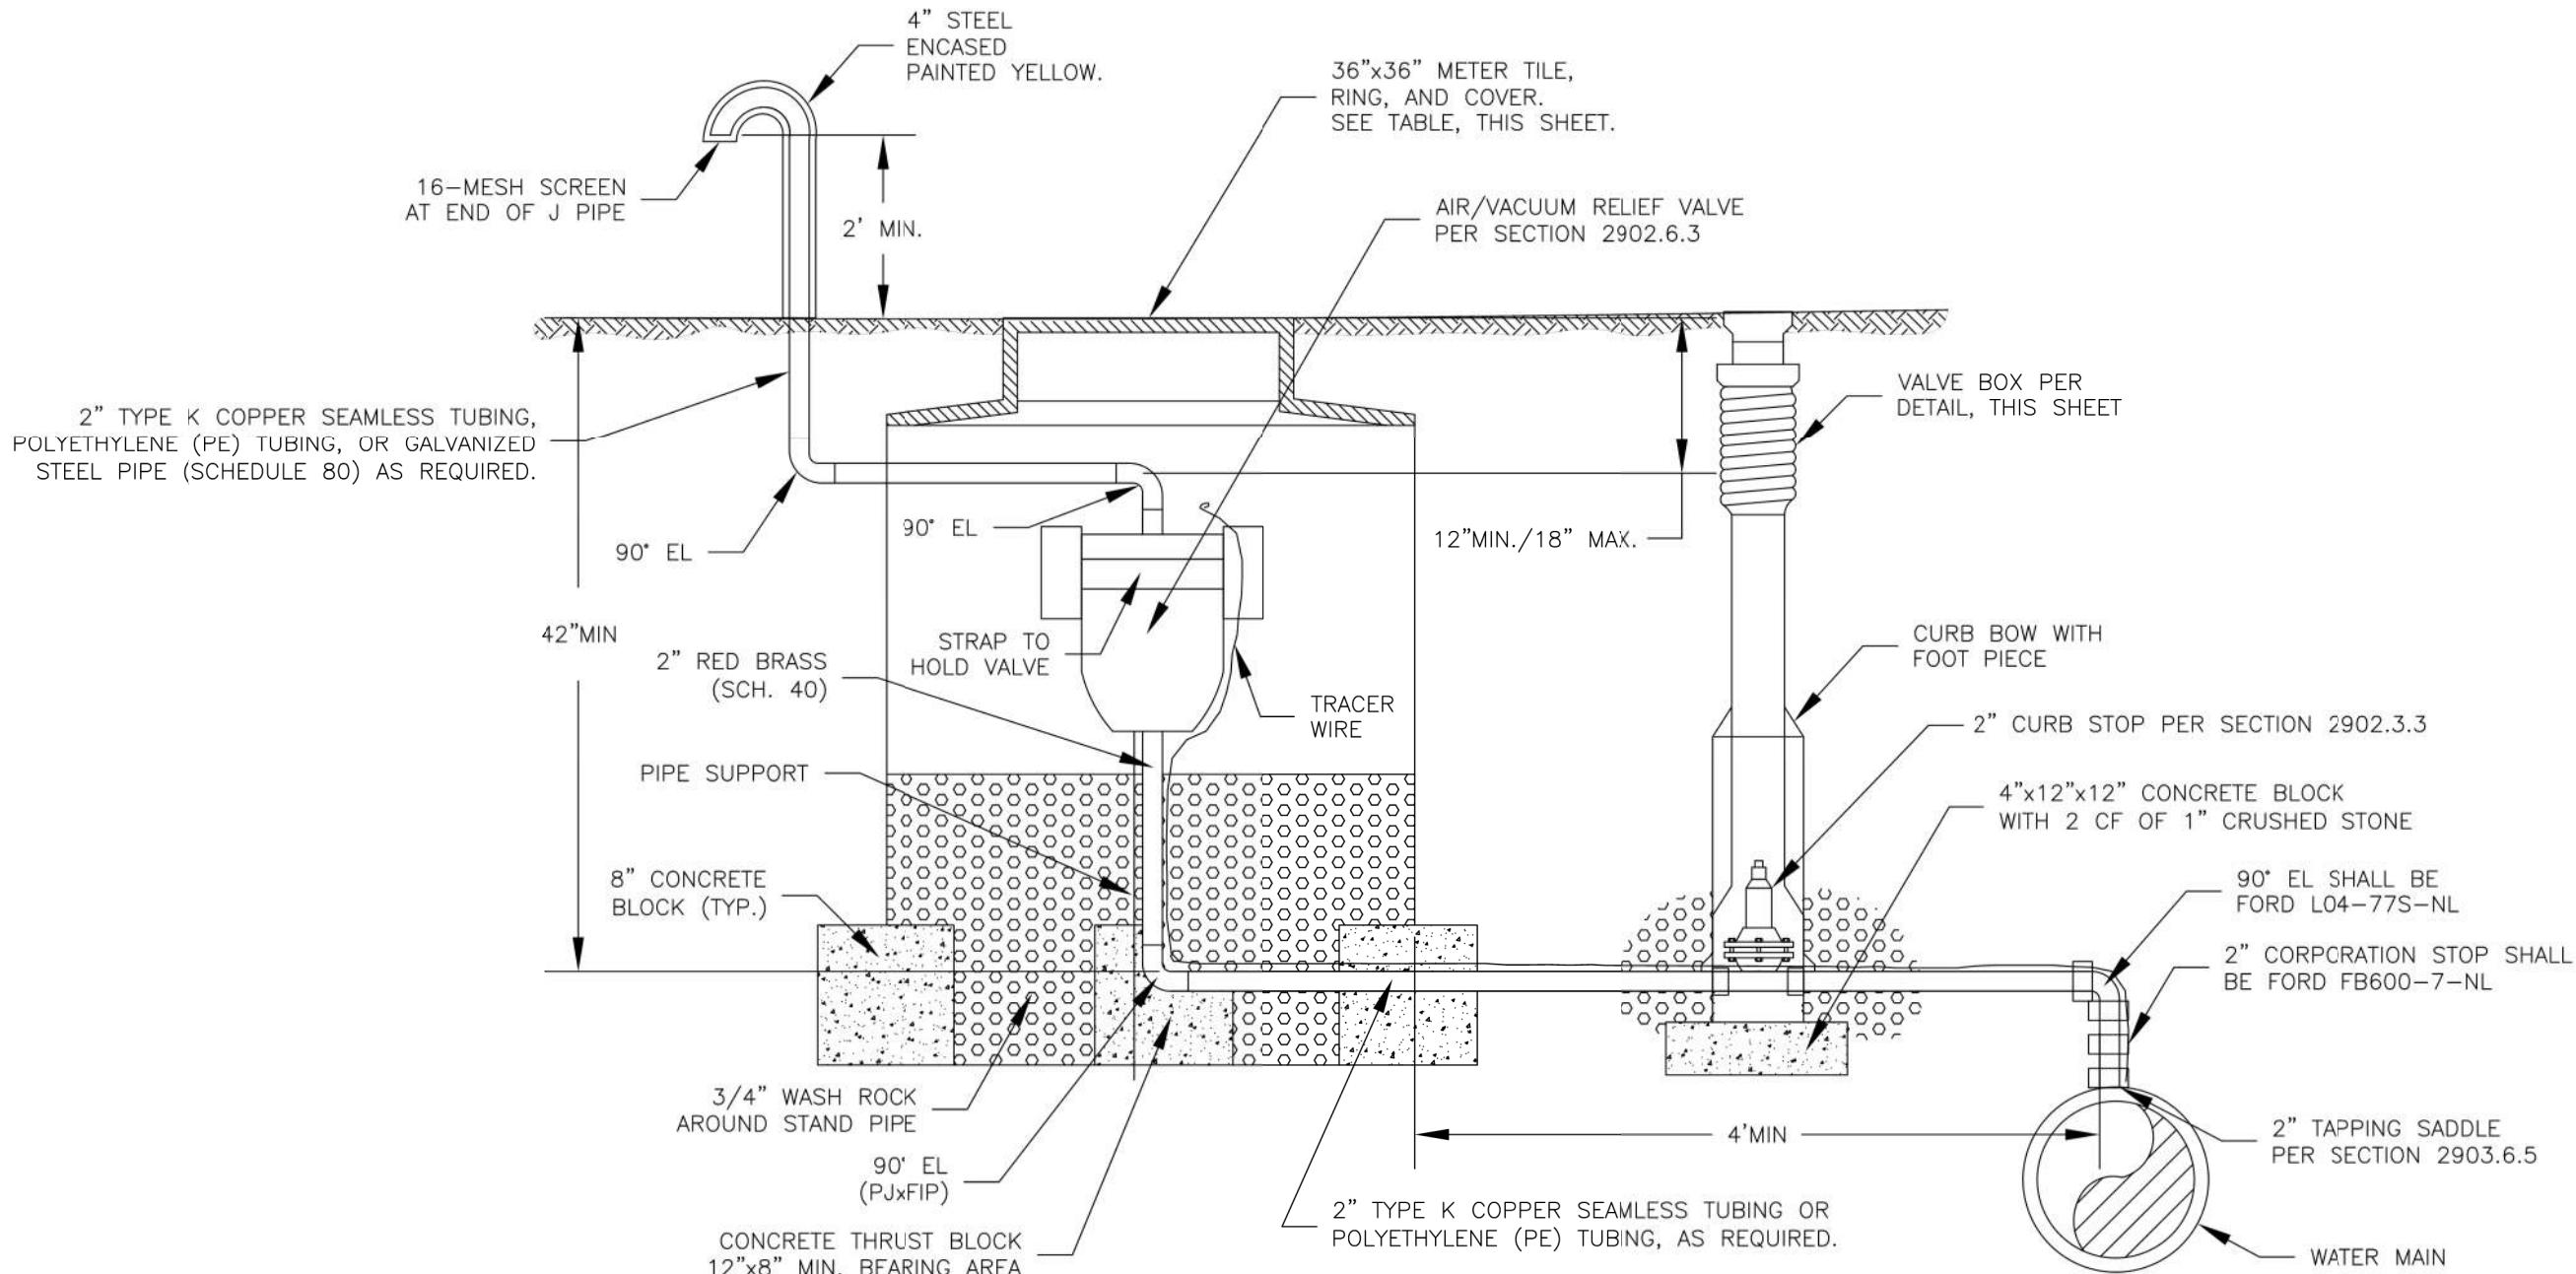

AIR RELEASE VALVE DETAIL
N.T.S.

METER SIZE	SERVICE LINE SIZE*	METER SETTER	METER BOX SIZE/ ACCEPTABLE PRODUCTS	METER BOX COVER SIZE/ ACCEPTABLE PRODUCTS
5/8"	3/4"	FORD VB-81W-44-33-NL	18" x 30" ADS 1805AH OR ADS 1805012H OR ADS N-12 OR SIGMA RMP1830-SW-W OR CONTECH A2000 OR APPROVED EQUAL	18"/FORD A32PR-BR
1"	1"	FORD VB-84W-44-44-NL	20" / SIGMA RMP2030-W OR APPROVED EQUAL	20"/FORD A3PR-BR
1.5"	1.5"	Ford VBH76-18-44-66-NL	36" / ADS N-12 OR SIGMA RMP2030-W OR CONTECH A2000 PVC OR APPROVED EQUAL	36"/FORD MC-36-P-BR
2"	2"	FORD VBH77-18-44-77-NL		
3"	4"			
4" +	MATCH METER DIAMETER	METERS LARGER THAN 2" SHALL REQUIRE INDIVIDUAL VAULT DESIGNS. THE DESIGN ENGINEER SHALL SUBMIT PLANS FOR THE VAULT DESIGN TO THE ENGINEER FOR REVIEW AND APPROVAL ON A CASE-BY-CASE BASIS.		
*PUBLIC SERVICE LINE DIAMETER. CUSTOMER MAY INCREASE SERVICE LINE DIAMETER BEYOND THE SETTER.				

APPROVED WATER SERVICE MATERIALS

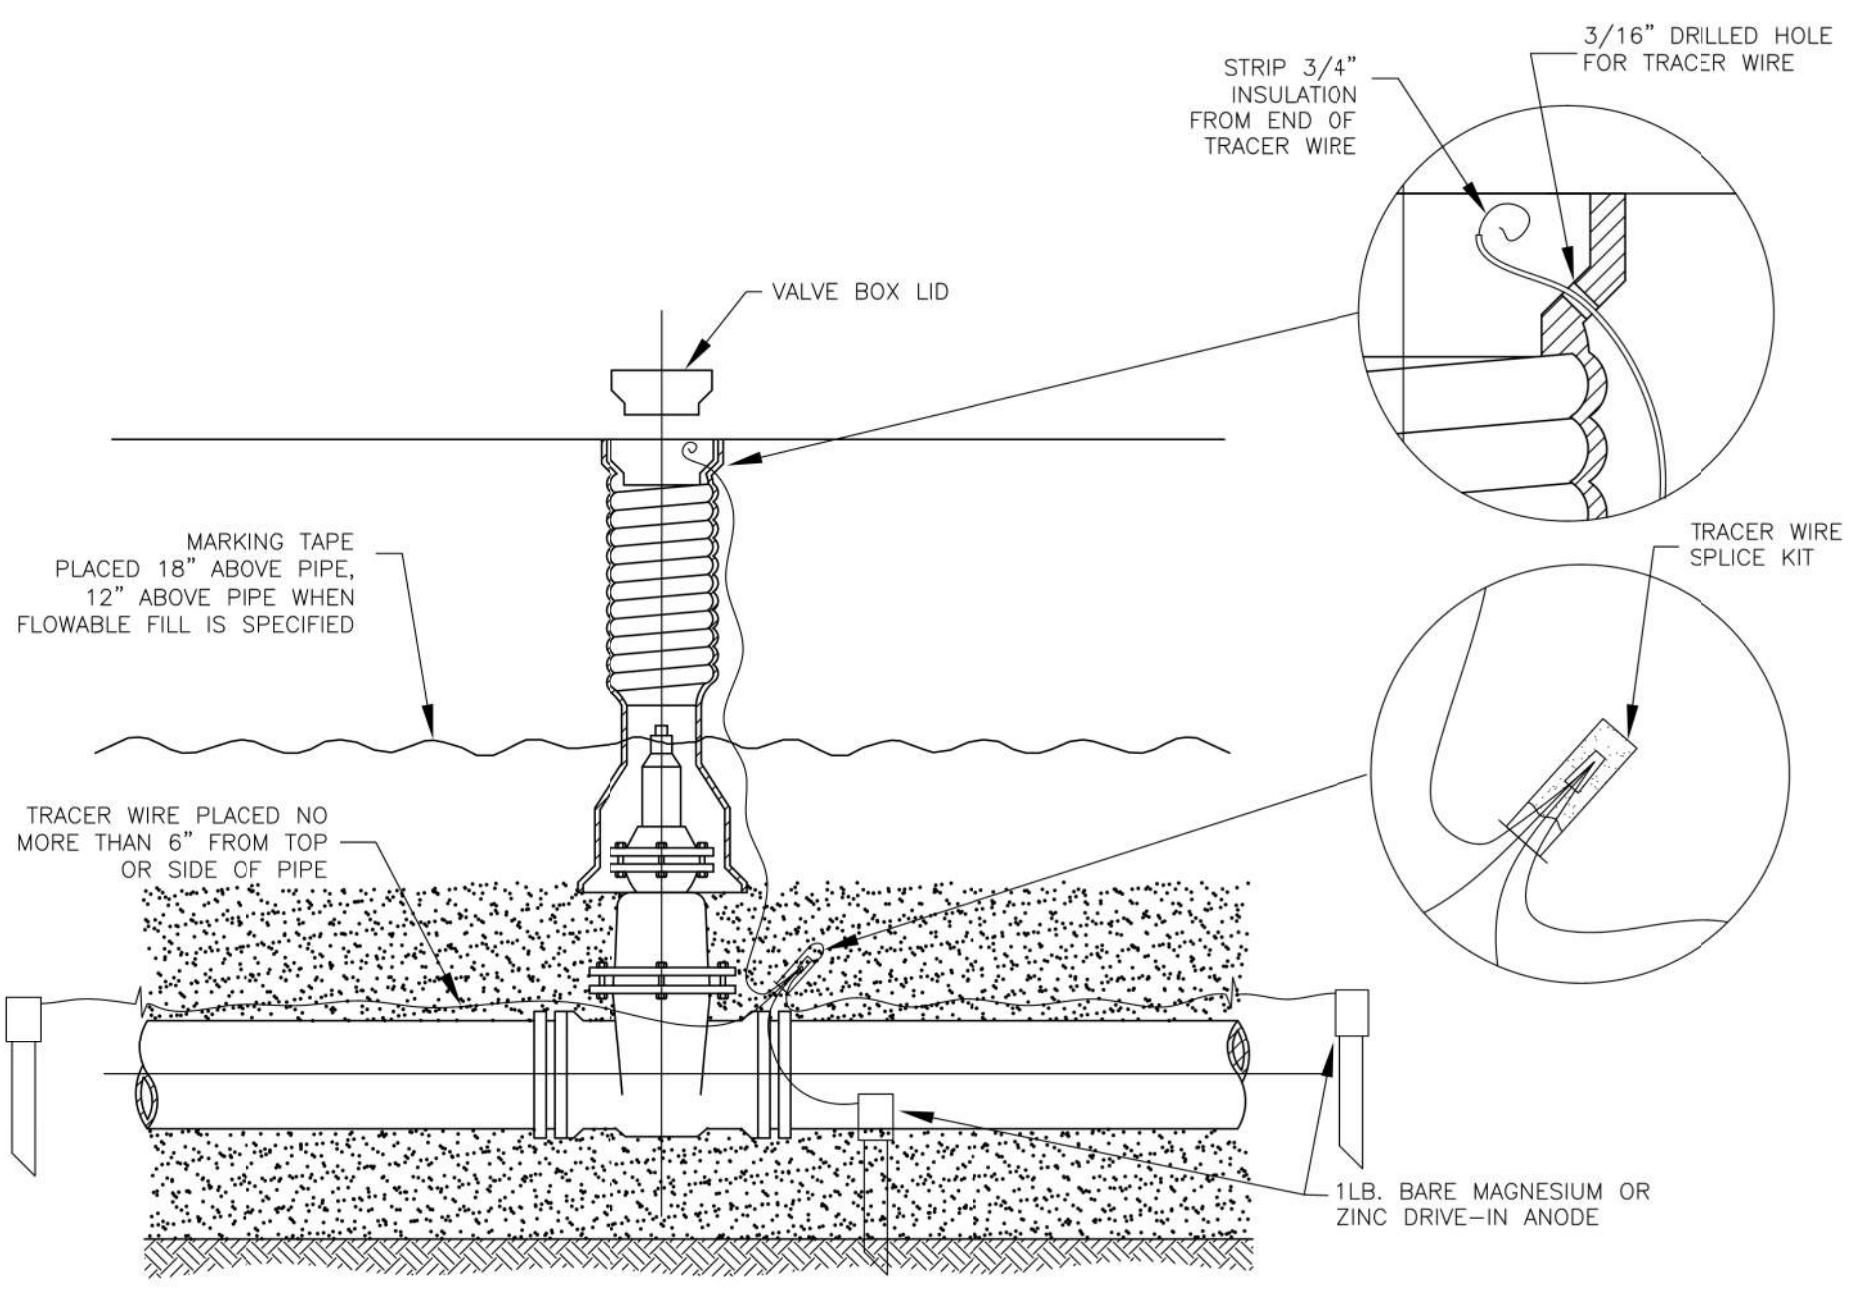

- *NOTE:**
- ANODES SHALL BE A MINIMUM OF ONE POUND (1 LB.) BARE MAGNESIUM OR ZINC DRIVE-IN GROUNDING ANODE ROD AND SHALL BE DRIVEN INTO THE GROUND AT THE SAME ELEVATION AS THE WATERLINE. ANODES SHALL BE PLACED AT THE BEGINNING AND THE END OF THE WATERLINE, AT EVERY VALVE BOX OR TEST STATION, AT ALL DEAD ENDS, AT THE END OF SERVICE LINES, AND/OR AT LEAST EVERY FIVE HUNDRED FEET (500').
 - SPLICE CONNECTIONS SHALL BE COPPERHEAD INDUSTRIES LLC SNAKEBITE LOCKING WIRE CONNECTOR, COPPERHEAD INDUSTRIES SCB-01SR DIRECT BURY, COPPERHEAD INDUSTRIES LLC 3WB-01 DRYCONN THREE-WAY DIRECT BURY LUG CONNECTOR, OR 3M DBR/Y-6 DIRECT BURY.
 - TRACER WIRE SHALL BE 12AWG COPPER CLAD STEEL (CCS), MINIMUM BREAK LOAD OF 280 LBS. WITH BLUE 30MIL HDPE JACKET FOR OPEN TRENCH INSTALLATIONS OR 12AWG COPPER CLAD STEEL (CCS), MINIMUM BREAK LOAD OF 1,100 LBS. WITH BLUE 45 MIL HDPE JACKET FOR DIRECTIONAL DRILL INSTALLATION. TRACER WIRE SHALL BE PLACED NO FURTHER THAN 6" TO THE SIDE OR ABOVE THE WATERLINE. TRACER WIRE SHALL BE ACCESSIBLE AT VALVE BOX OR TEST STATIONS AT LEAST EVERY 500'.
 - MARKING TAPE SHALL BE INSTALLED 18" ABOVE PVC PIPE OR DUCTILE IRON PIPE. MARKER TAPE SHALL BE AT LEAST 3" IN WIDTH, BLUE IN COLOR WITH BLACK LETTERING STATING, "CAUTION BURIED WATERLINE BELOW."
 - TRACER WIRE SHALL BE REQUIRED ON ALL POLYETHYLENE (PE) TUBING SERVICE LINES. SPLICE SERVICE LINE TRACER WIRE TO TRACER WIRE AT THE EXISTING WATERMAIN WITH APPROVED CONNECTOR. IF NO TRACER WIRE IS IN PLACE ON THE EXISTING WATERMAIN, TIE SERVICE LINE TRACER WIRE TO 1LB MIN. ANODE AT EXISTING WATERMAIN.
 - ALL PUBLIC SERVICE LINES SHALL BE INSTALLED IN A MANNER THAT ALLOWS FOR LOCATION OF SAID INFRASTRUCTURE BY THE DEPARTMENT POST-CONSTRUCTION. MIXED MATERIALS (I.E. COPPER AND POLYETHYLENE) FROM THE WATER MAIN TO THE WATER METER SHALL NOT BE PERMITTED WITHOUT THE ADDITION OF A TRACER WIRE.

TRACER WIRE/MARKER TAPE DETAIL
N.T.S.

2022 EDITION SHEET 46 OF 49

DATE	BY	REVISION
03-01-22	LJM	REPLACES ALL PREVIOUS VERSIONS OF WATERLINE DETAILS
12-01-21	LJM	REPLACES AIR RELEASE VALVE DETAIL

City of Lawrence
MUNICIPAL SERVICES & OPERATIONS

STANDARD DETAILS FOR WATERLINE

DAVID P. CRONIN CITY ENGINEER CRAIG S. OWENS CITY MANAGER





NOTES:

1. BLOCKS SHALL BE POURED AGAINST UNDISTURBED EARTH. PLUGS SHALL BE INDIVIDUALLY RESTRAINED. ALL CONCRETE USED FOR THRUST BLOCKS AND ENCASEMENT SHALL BE CLASS A CONCRETE.
2. PIPE AND FITTINGS WITHIN 2 FEET OF CONCRETE BLOCKING SHALL BE WRAPPED IN 8 MIL POLY WRAP WITH 18" MINIMUM OVERLAP AT SEAM. (TYPICAL ALL BLOCKING INSTALLATIONS EXCEPT BLOCKING FOR FIRE HYDRANT BASE)

LINE SIZE	BEARING AREA IN SQUARE FEET				
	TEE DEAD OR	90° ELLS	45° ELLS	22 1/2 ° ELLS	11 1/4 ° ELLS
4"	2.7	3.8	2.1	1.1	0.5
6"	5.6	7.9	4.3	2.2	1.1
8"	9.6	13.6	7.4	3.8	1.9
10"	14.5	20.5	11.1	5.7	2.8
12"	20.5	29.0	15.7	8.0	4.0

BEARING AREA BASED ON THE FOLLOWING:
DESIGN PRESSURE: 150 psi
SOIL BEARING CAPACITY: 1500 PSF
SAFETY FACTOR: 1.5


THRUST BLOCK DETAILS
N.T.S.

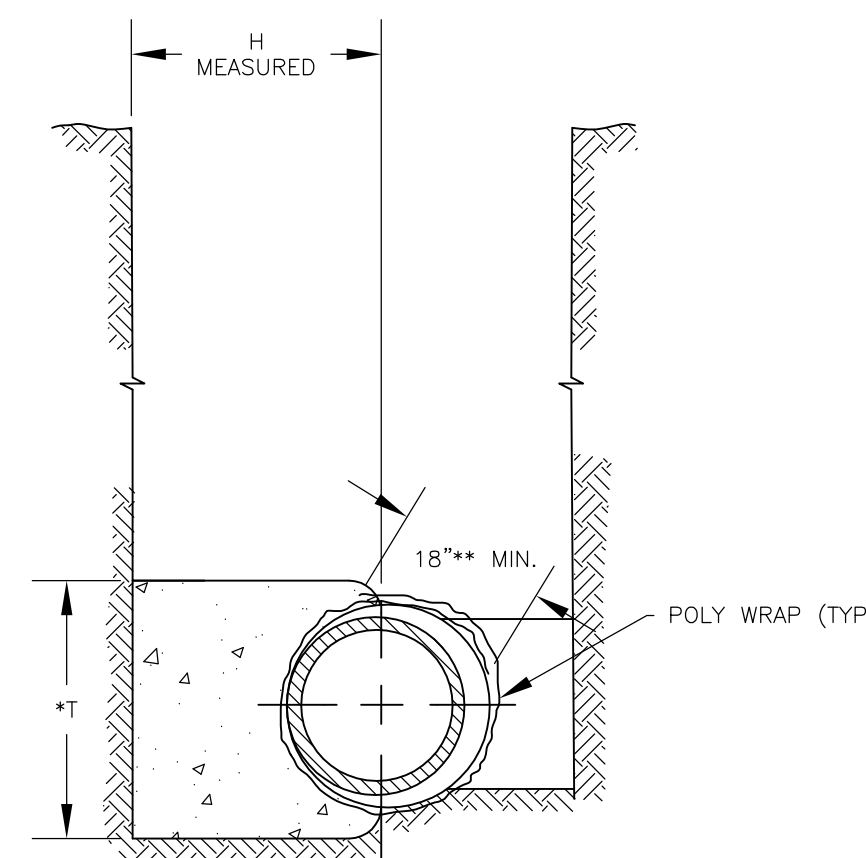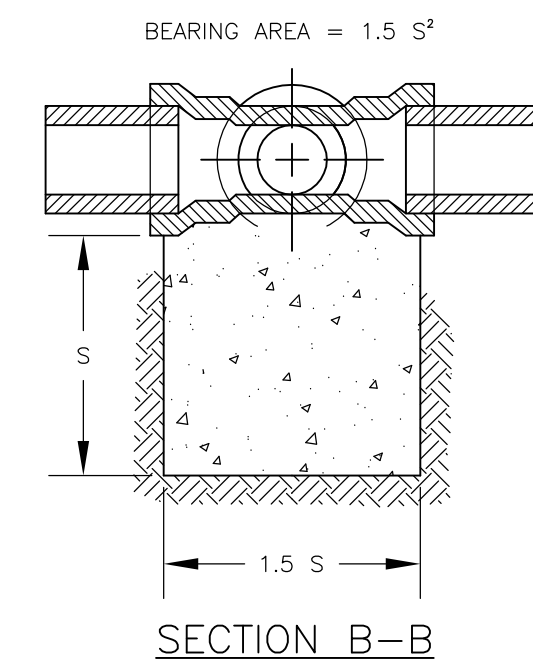


* AS REQUIRED TO OBTAIN THE MINIMUM BEARING AREA SHOWN IN THE TABLE. IN NO CASE SHALL THIS BE LESS THAN THE O.D. OF THE PIPE.
BEARING AREA = LxT

** POLYWRAP OVERLAP AT SEAM


SECTION A-A

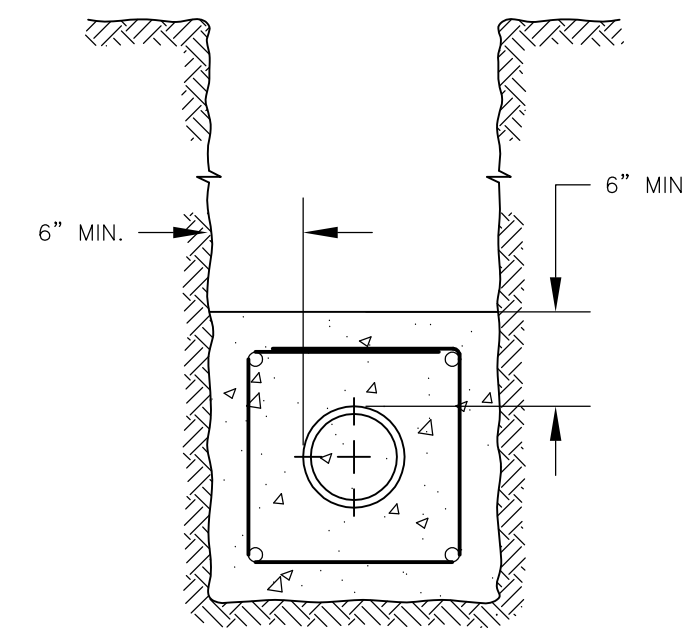

CONCRETE ENCASEMENT DETAIL
N.T.S.

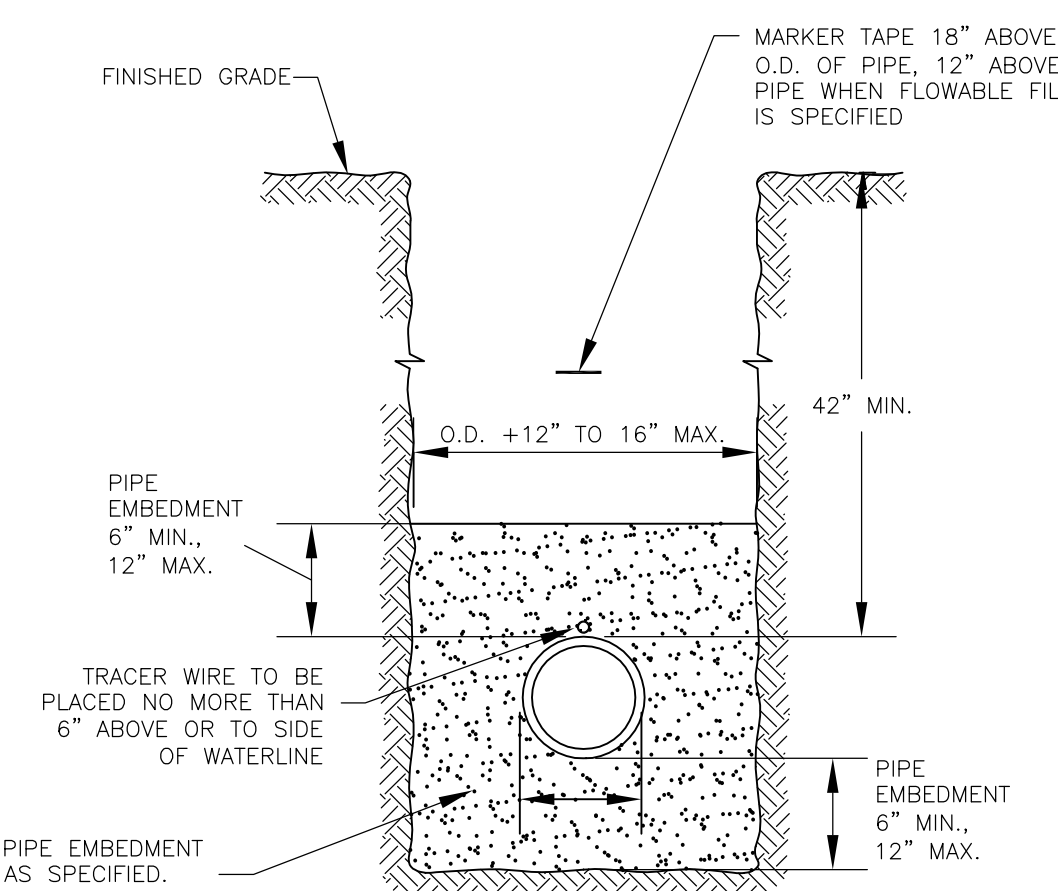


TYPICAL TRENCH SECTION
N.T.S.

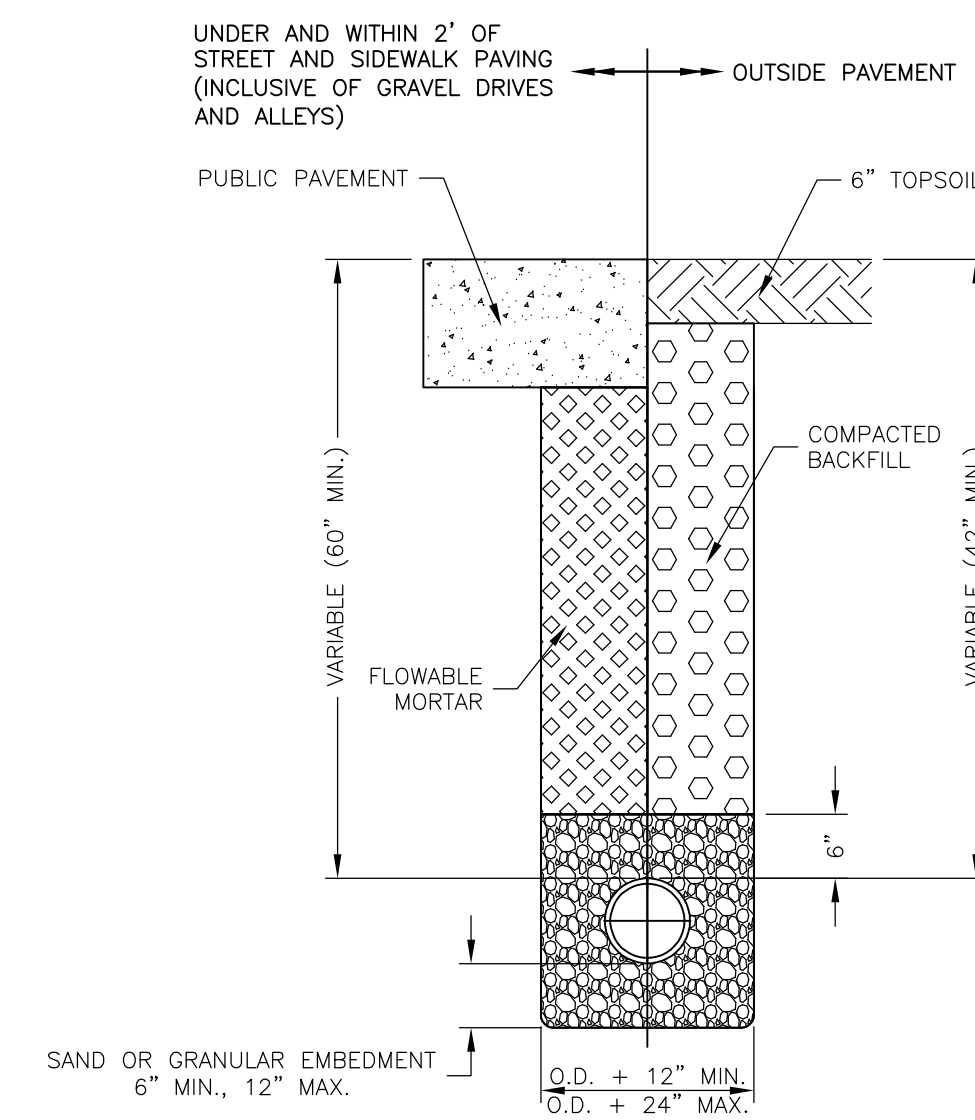

NOTES


1. FLOWABLE MORTAR MATERIALS AND PLACEMENT LIMITS SHALL CONFORM TO SECTIONS 1102E AND 1107B OF THE CITY OF LAWRENCE CONSTRUCTION AND MATERIAL SPECIFICATIONS SECTION 1100-GRADING RESPECTIVELY.
2. COMPACTED BACKFILL SHALL CONFORM TO SECTION 1107B AND 1108 OF THE CITY OF LAWRENCE CONSTRUCTION AND MATERIAL SPECIFICATIONS SECTION 1100-GRADING.
3. DETAIL SHOWN SHALL GOVERN IN NEW CONSTRUCTION. THE CITY OF LAWRENCE STANDARD DETAILS FOR STREET REPAIR-PAVEMENT REMOVAL AND REPLACEMENT DETAILS FOR TRENCHING WITHIN EXISTING ROADWAYS SHALL GOVERN WITHIN EXISTING PAVEMENT.

WATERLINE TRENCH DETAILS
N.T.S.

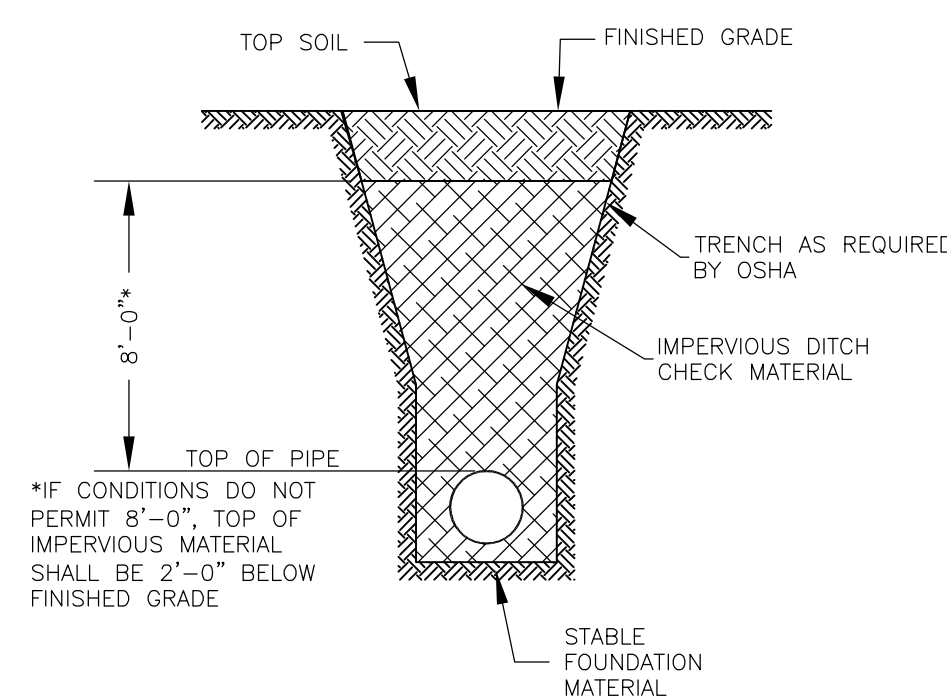


IMPERVIOUS DITCH CHECKS SHALL BE PLACED WHERE SHOWN ON THE PLANS. LENGTHS SHALL BE A MINIMUM OF 10 LF. FLOWABLE FILL IS REQUIRED FOR PVC PIPE. FOR OTHER PIPE TYPES, CLAY MATERIAL OR FLOWABLE FILL MAY BE USED AT THE CONTRACTORS OPTION. FLOWABLE FILL MATERIAL TO COMPLY WITH CITY OF LAWRENCE CONSTRUCTION AND MATERIAL SPECIFICATIONS SECTION 05400. CLAY MATERIAL SHALL BE FREE OF CLODS, CLUMPS, DEBRIS, ORGANIC MATERIAL, AND STONES, COMPACTED SO AS TO OBTAIN 95% OF STANDARD PROCTOR MAXIMUM DENSITY AS DETERMINED BY ASTM D698.


IMPERVIOUS DITCH CHECK
N.T.S.

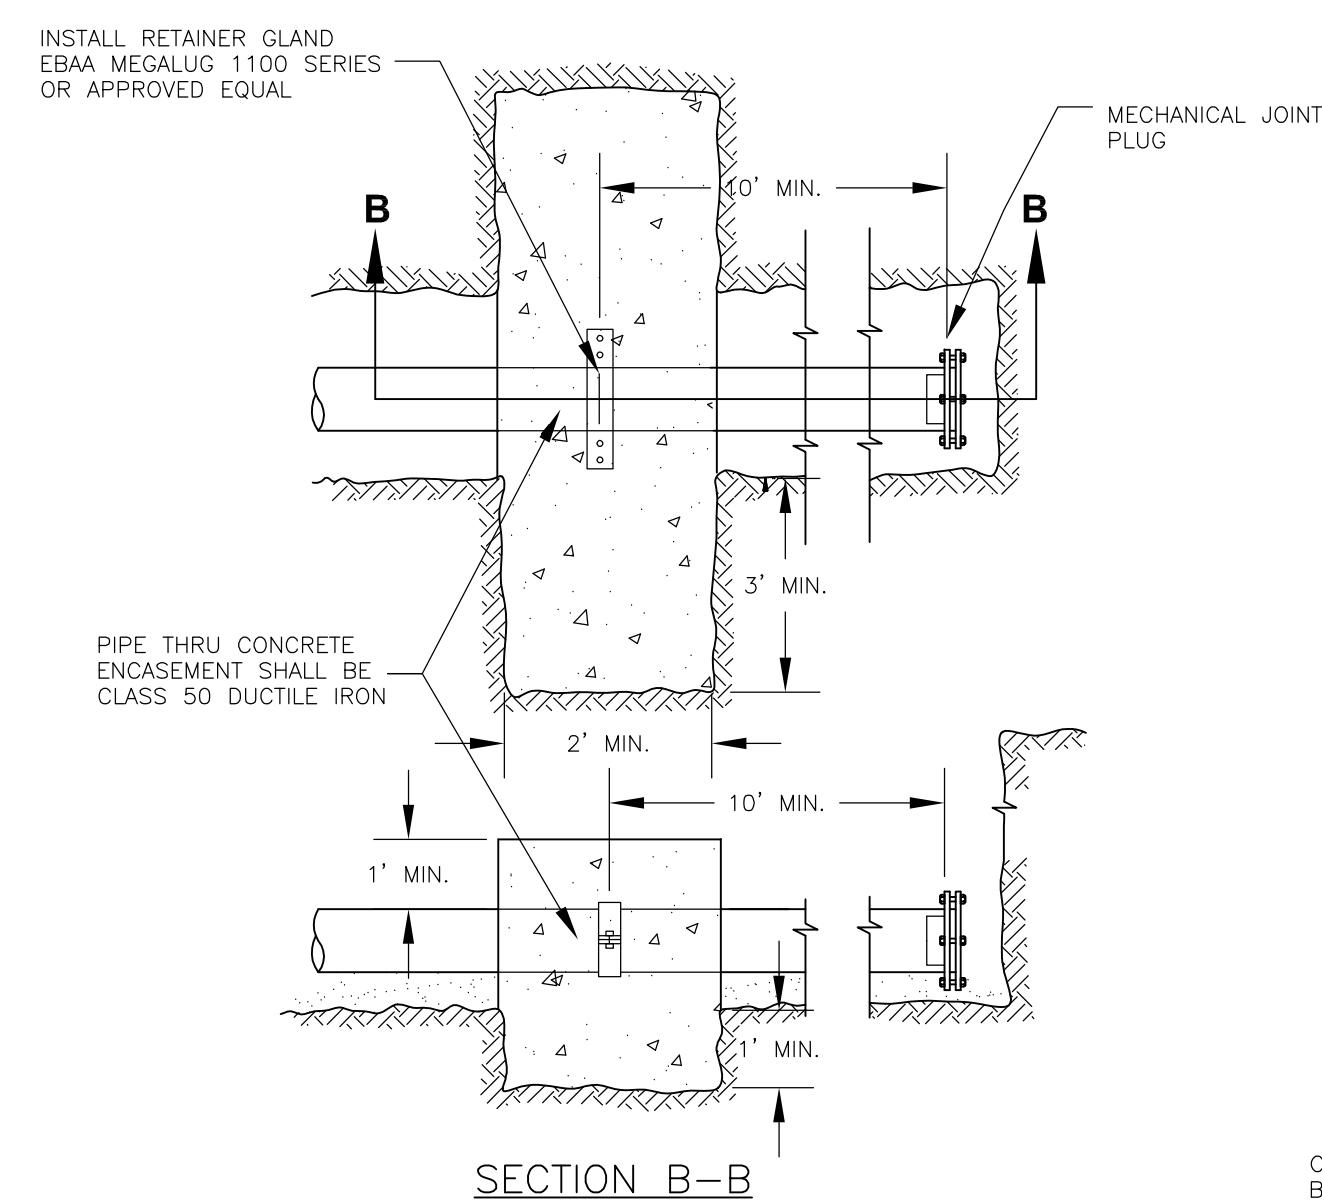

STRADDLE OR END BLOCKING
N.T.S.

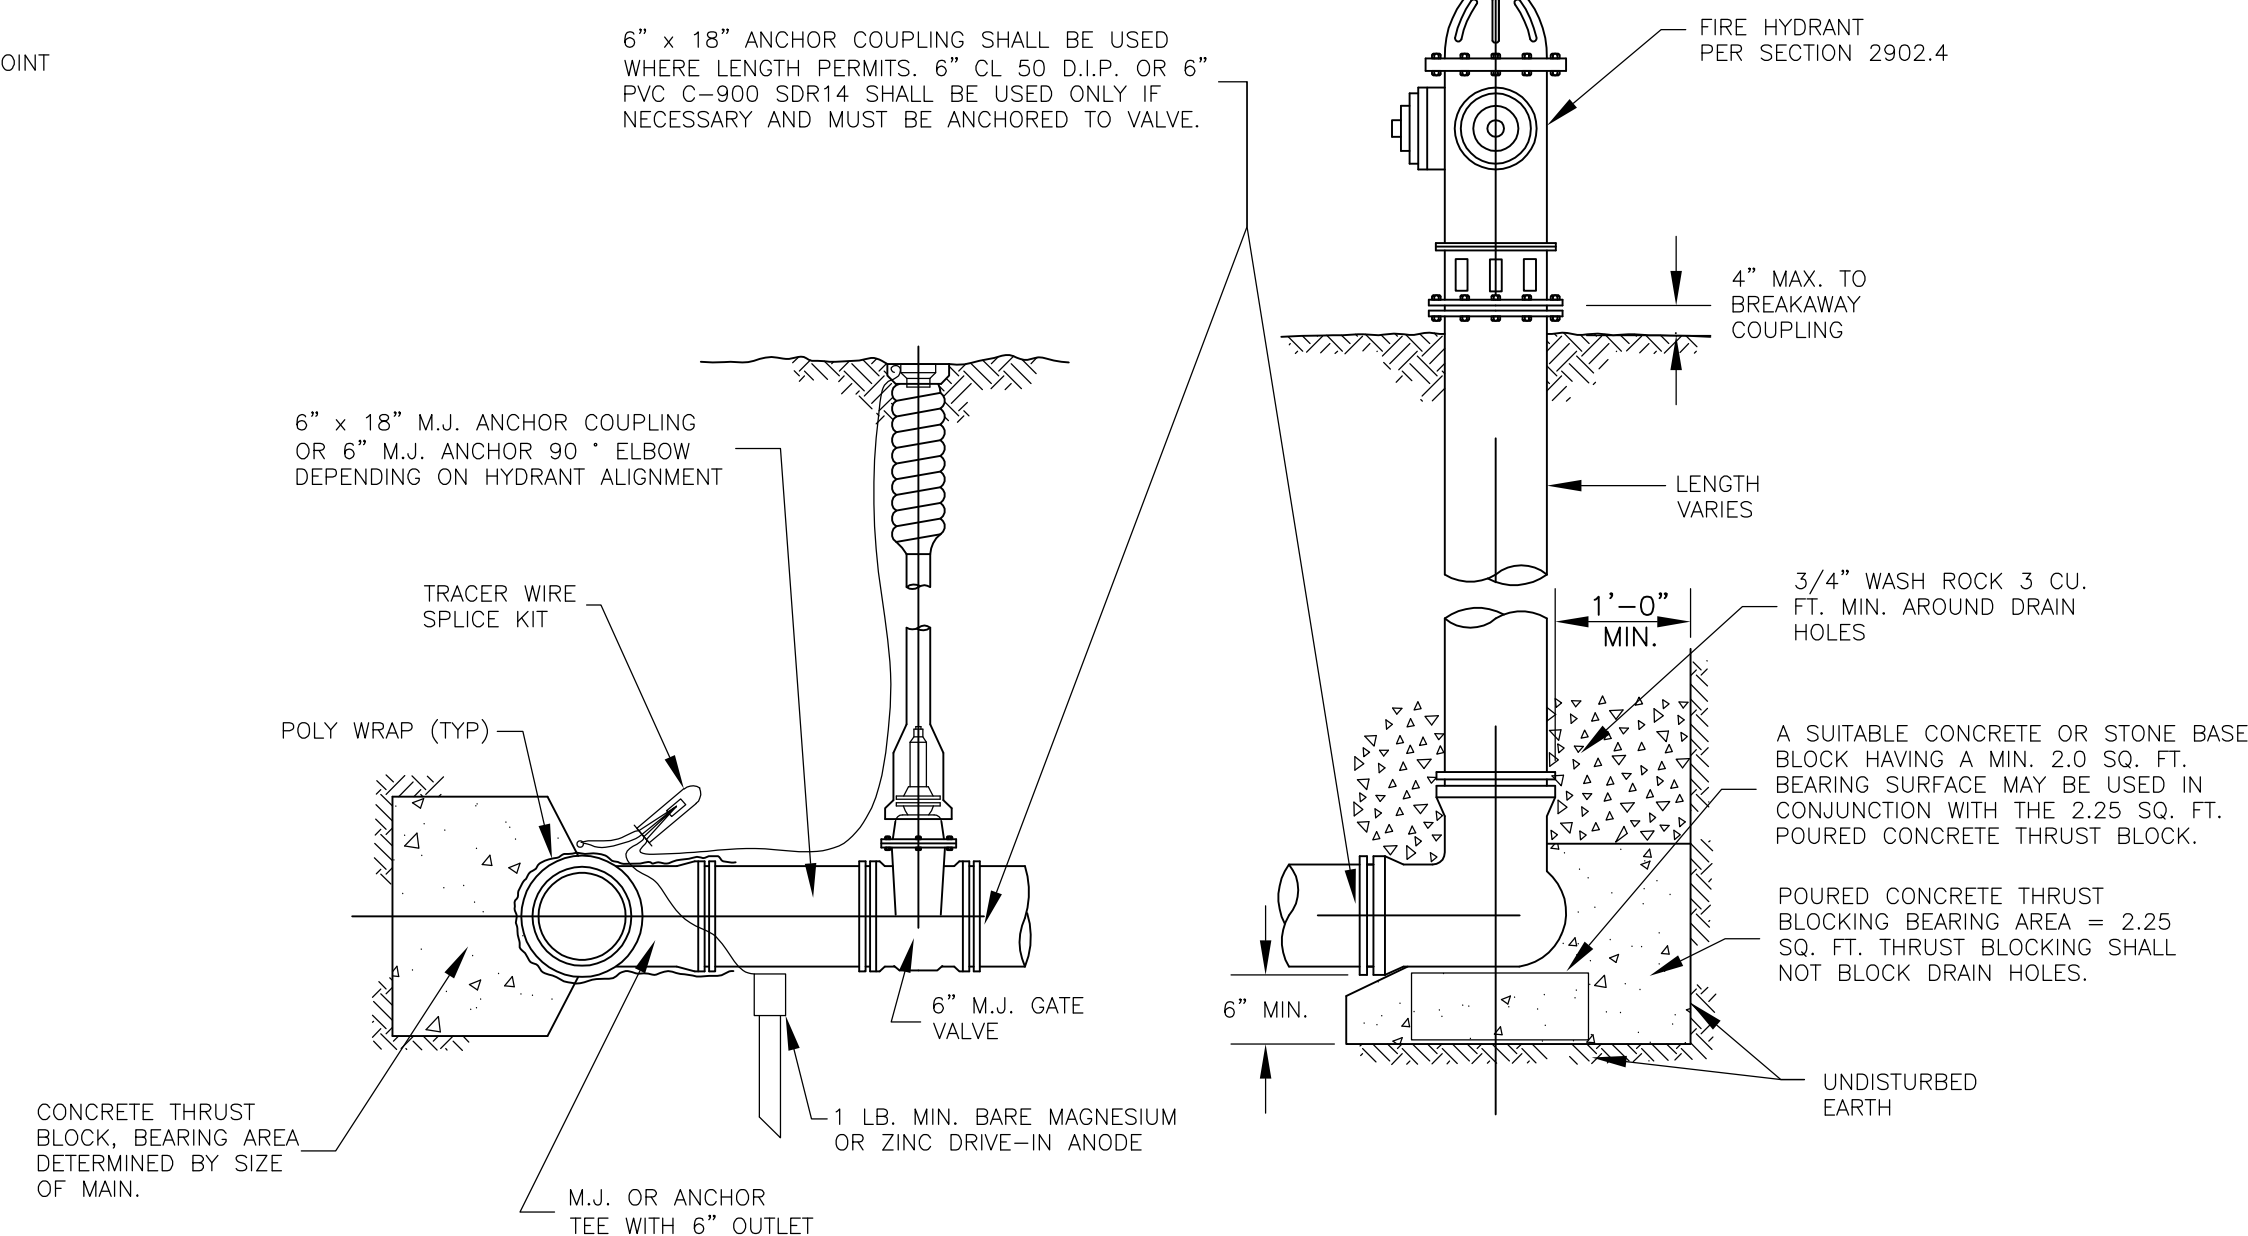

FIRE HYDRANT ASSEMBLY DETAIL WITH TEST STATION
N.T.S.

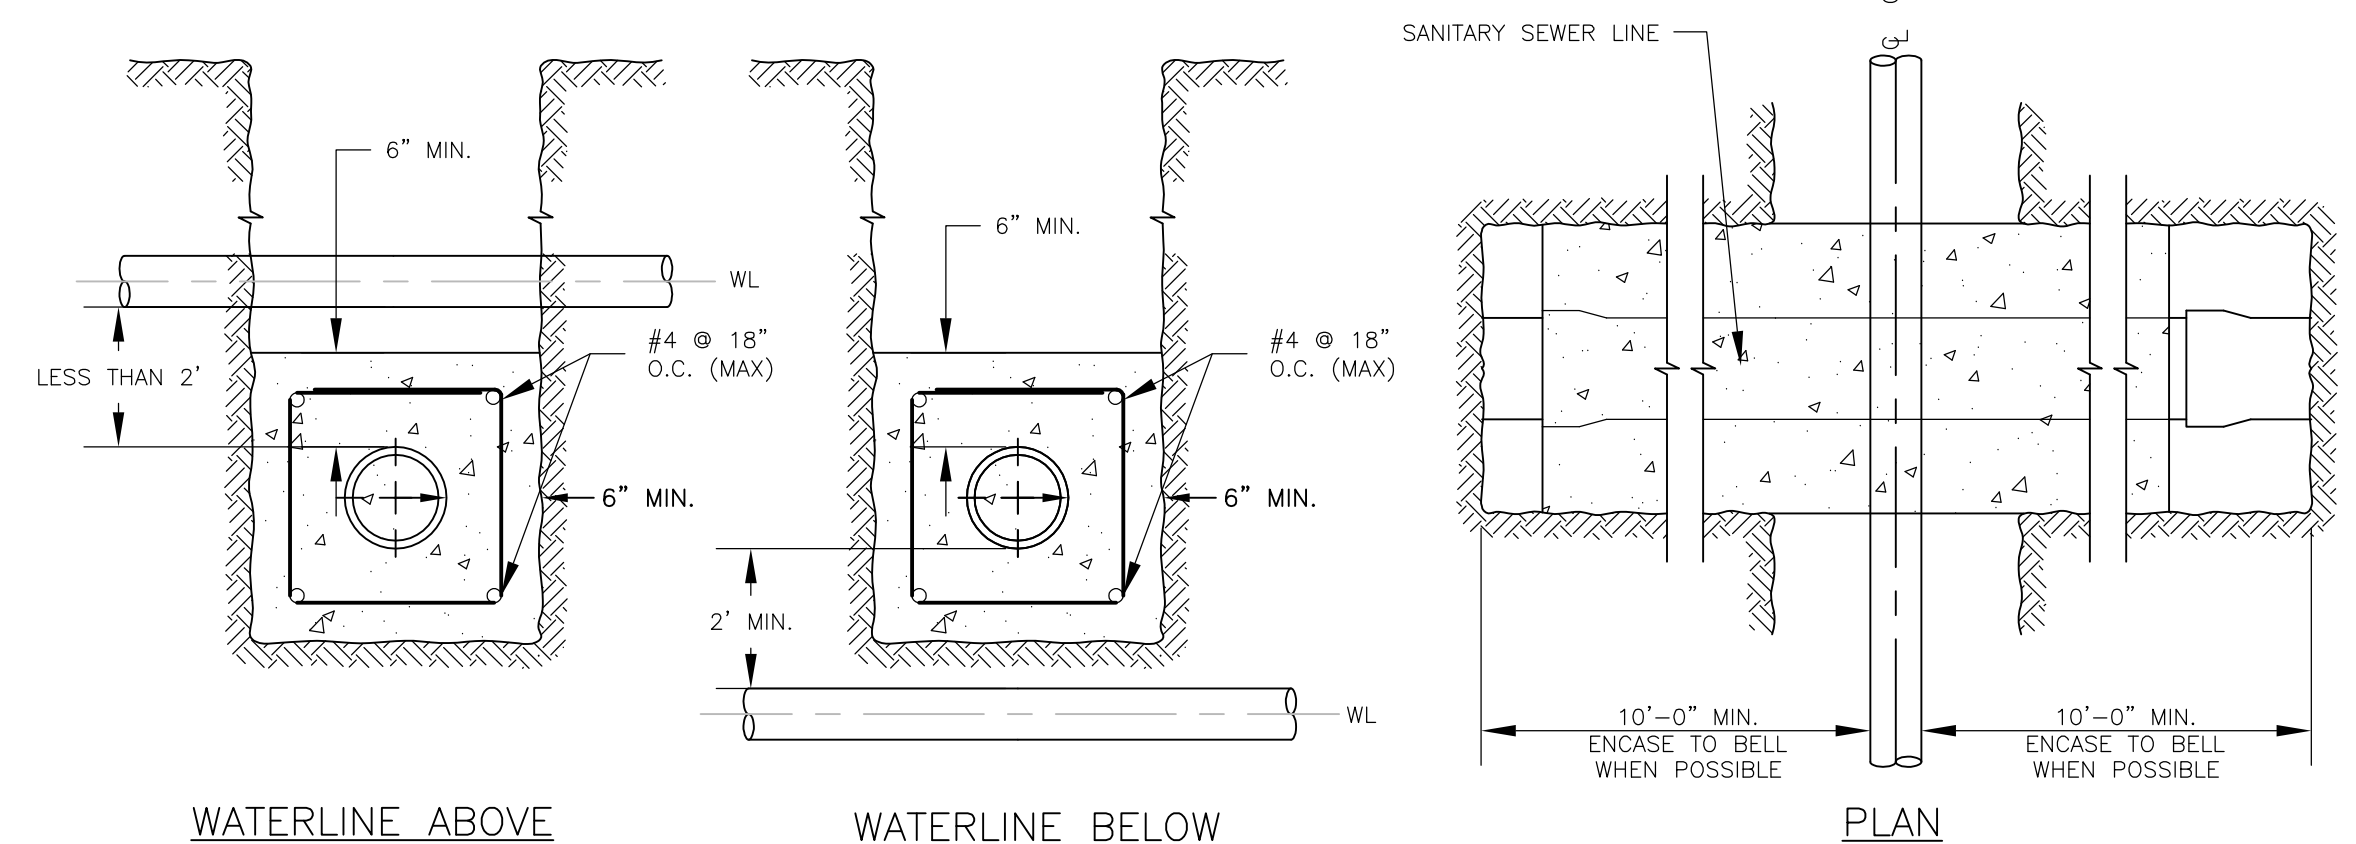

CONCRETE ENCASEMENT OF SANITARY SEWER LINE
CROSSING WATER LINE
N.T.S. 2022 EDITION

2022 EDITION

SHEET 47 OF 49

DATE	BY	REVISION
03-01-22	LJM	REPLACES ALL PREVIOUS VERSIONS OF WATERLINE DETAILS
03-01-21	LJM	REPLACES ALL PREVIOUS VERSIONS OF WATERLINE DETAILS



STANDARD DETAILS FOR WATERLINE


2 OF 2


ANDREW P. ENS
PROGRAM MANAGER

CRAIG S. OWENS
CITY MANAGER



1. STANDARD DRAWINGS SHALL APPLY ONLY TO STRUCTURES WITH THE FOLLOWING LIMITS:
A. INSIDE PLAN DIMENSIONS SHALL NOT EXCEED 40 SQUARE FEET.
B. WALL HEIGHT SHALL NOT EXCEED 10 VERTICAL FEET..
2. THE MINIMUM WIDTH OF ALL STRUCTURES SHALL BE 4 FEET OR AS REQUIRED FOR PIPE CLEARANCE.
3. STEPS ARE REQUIRED IN ALL STRUCTURES WITH WALL HEIGHT GREATER THAN 4 FEET.
4. FRAMES, LIDS, CASTINGS, STEPS, INVERT, SUBSURFACE DRAINS, PIPE CONNECTIONS AND OTHER ITEMS SHOWN SHALL BE CONSIDERED SUBSIDIARY TO EACH STANDARD STRUCTURE.
5. SUBSURFACE DRAINS ARE REQUIRED IN ALL STRUCTURES IN THE PUBLIC RIGHT-OF-WAY WITH WALL HEIGHT GREATER THAN 3 FEET. ONE DRAIN PER WALL SHALL BE INSTALLED ONLY IN WALLS WHICH ARE PERPENDICULAR TO THE STREET CENTERLINE.
6. CURB INLETS WITH INSIDE PLAN DIMENSIONS EXCEEDING 25 SQUARE FEET SHALL HAVE TYPE II RING AND COVER. CURB INLETS IN PAVED AREAS SHALL HAVE TYPE II RING AND COVER.
7. WHERE SIDEWALKS ADJOIN STORM SEWER STRUCTURES, #4 DOWELS SHALL BE PLACED 18" ON CENTER. DOWELS SHALL BE 18" LONG WITH 6" IN THE STRUCTURE TOP, THROUGH ISOLATION JOINTS.
8. CURB INLET DIMENSIONS SHALL BE STATED AS "LENGTH" x "WIDTH" ON ALL CONSTRUCTION NOTES.
9. THE MINIMUM LENGTH OF CURB INLET OPENING SHALL BE 5 FEET.
10. CURB INLET FRAME TOP CHANNEL SHALL BE FABRICATED FROM 0.15 MAX. CARBON, FORMING QUALITY, OR A36 HOT ROLLED STEEL PLATE.
11. ALL FLAT PLATE AND RODS SHALL BE M1020 MERCHANT QUALITY OR A36 HOT ROLLED STEEL.
12. ALL CURB INLET FRAME MATERIALS SHALL BE FREE FROM RUST AND MILL SCALE.
13. ALL WELDING SHALL CONFORM TO THE PROVISIONS OF THE AWS "STRUCTURAL WELDING CODE."
14. CURB INLET FRAMES SHALL BE HOT-DIP GALVANIZED AFTER FABRICATION PER ASTM A123.
15. CURB INLET FRAMES SHALL BE SLOPED TO MATCH THE STREET CENTERLINE GRADE.
16. STAMPING TOOLS SHALL BE APPROVED PRIOR TO USE. A FULL SIZE FABRICATION PATTERN MAY BE OBTAINED FROM THE MUNICIPAL SERVICES AND OPERATIONS DEPARTMENT. FOR CAST-IN-PLACE INLETS, A STAMPING TOOL MAY BE BORROWED FROM THE DEPARTMENT PER AN APPROVED SCHEDULE.
17. ALL DIMENSIONS AND SIDE SLOPES SHOWN WITHIN THE "TYPICAL TRENCH SECTION DETAILS" ARE TYPICAL. ANY DEVIATION FROM THESE DIMENSIONS MUST BE APPROVED BY THE PROJECT ENGINEER PRIOR TO BEGINNING THE TRENCHING WORK, OR AS SOON AS PRACTICABLE.
18. FLOWABLE FILL QUANTITY IS CALCULATED BASED ON A TYPICAL TRENCH SIDE SLOPE OF 1:1. A SIDE SLOPE FLATTER THAN 1:1 (IF REQUIRED) TO ENSURE STABILITY AND SAFETY OF THE TRENCH MUST BE APPROVED BY THE PROJECT ENGINEER IN THE FIELD PRIOR TO BEGINNING EXCAVATION TRENCHES, OR AS SOON AS PRACTICABLE. THE INTENT IS TO KEEP THE FLOWABLE FILL QUANTITY TO A MINIMUM.
19. FLOWABLE FILL SHALL BE PLACED TO BOTTOM OF THE PAVEMENT, STABILIZED BASE, OR GRADATION AS DIRECTED BY ENGINEER.
20. CONCRETE FOR INVERT AND COLLARS SHALL MEET CITY SPECIFICATIONS SECTION 2000 - CONCRETE.
21. LIFT HOLES IN PRE-CAST STRUCTURES SHALL BE PATCHED WITH NON-SHRINK GROUT.



2021 EDITION		SHEET 48 OF 49	
DATE	BY	REVISION	
03-01-21	LJM	REPLACES ALL PREVIOUS VERSIONS OF STORM SEWER CURB INLET DETAILS	
03-01-20	LJM	REPLACES ALL PREVIOUS VERSIONS OF STORM SEWER CURB INLET DETAILS	
 <div> <p>City of Lawrence</p> <p>MUNICIPAL SERVICES & OPERATIONS</p> </div>			
<p>STANDARD DETAILS FOR</p> <p>STORM SEWER CURB INLETS</p>			
<p>DAVID P. CRONIN</p> <p>CITY ENGINEER</p>		<p>CRAIG S. OWENS</p> <p>CITY MANAGER</p>	

1. STANDARD DRAWINGS SHALL APPLY ONLY TO STRUCTURES WITH THE FOLLOWING LIMITS:
A. INSIDE PLANE DIMENSIONS SHALL NOT EXCEED 40 SQUARE FEET.
B. WALL HEIGHT SHALL NOT EXCEED TO VERTICAL FEET.
2. THE MINIMUM WIDTH OF ALL STRUCTURES SHALL BE 4 FEET OR AS REQUIRED FOR PIPE CLEARANCE.
3. STEPS ARE REQUIRED IN ALL STRUCTURES WITH WALL HEIGHT GREATER THAN 4 FEET.
4. FRAMES, LIDS, CASTINGS, STEPS, INVERT, SUBSURFACE DRAINS, PIPE CONNECTIONS AND OTHER ITEMS SHOWN SHALL BE CONSIDERED SUBSIDIARY TO EACH STANDARD STRUCTURE.
5. SUBSURFACE DRAINS ARE REQUIRED IN ALL STRUCTURES IN THE PUBLIC RIGHT-OF-WAY WITH WALL HEIGHT GREATER THAN 3 FEET. ONE DRAIN PER WALL SHALL BE INSTALLED ONLY IN WALLS WHICH ARE PERPENDICULAR TO THE STREET CENTERLINE.
6. JUNCTION BOXES WITH INSIDE PLANE DIMENSIONS EXCEEDING 25 SQUARE FEET SHALL HAVE TYPE II RING AND COVER. JUNCTION BOXES IN PAVED AREAS SHALL HAVE TYPE II RING AND COVER.
7. NO JUNCTION BOX TO BE LOCATED IN PAVEMENT WITHOUT APPROVAL OF THE CITY ENGINEER.
8. ALL FLAT PLATE AND RODS SHALL BE M1020 MERCHANT QUALITY OR A36 HOT ROLLED STEEL.
9. ALL WELDING SHALL CONFORM TO THE PROVISIONS OF THE AWS "STRUCTURAL WELDING CODE."
10. STAMPING TOOLS SHALL BE APPROVED PRIOR TO USE. A FULL SIZE FABRICATION PATTERN MAY BE OBTAINED FROM THE MUNICIPAL SERVICES AND OPERATIONS DEPARTMENT. FOR CAST-IN-PLACE CONCRETE, A STAMPING TOOL MAY BE BORROWED FROM THE DEPARTMENT PER AN APPROVED SCHEDULE.
11. ALL DIMENSIONS AND SIDE SLOPES SHOWN WITHIN THE "TYPICAL TRENCH SECTION DETAIL" ARE TYPICAL. ANY DEVIATION FROM THESE DIMENSIONS MUST BE APPROVED BY THE PROJECT ENGINEER PRIOR TO BEGINNING THE TRENCHING WORK, OR AS SOON AS PRACTICABLE.
12. FLOWABLE FILL QUANTITY IS CALCULATED BASED ON A TYPICAL TRENCH SIDE SLOPE OF 1:1. SIDE SLOPE FLATTER THAN 1:1 (IF REQUIRED TO ENSURE STABILITY AND SAFETY OF THE TRENCHES) MUST BE APPROVED BY THE PROJECT ENGINEER IN THE FIELD PRIOR TO BEGINNING EXCAVATION FOR TRENCHES, OR AS SOON AS PRACTICABLE. THE INTENT IS TO KEEP THE FLOWABLE FILL QUANTITY TO A MINIMUM.
13. FLOWABLE FILL SHALL BE PLACED TO BOTTOM OF THE PAVEMENT, STABILIZED BASE, OR GRANULAR BASE AS DIRECTED BY ENGINEER.
14. CONCRETE FOR INVERTS AND COLLARS SHALL MEET CITY SPECIFICATIONS SECTION 2000 - CONCRETE.
15. LIFT HOLES IN PRE-CAST STRUCTURES SHALL BE PATCHED WITH NON-SHRINK GROUT.



OUTSIDE PAVEMENT



* NOTE: THE END OF THE PIPE SHOULD EXTEND A MINIMUM OF 4", UP TO A MAXIMUM OF 6", BEYOND THE INTERIOR WALL FACE.

STANDARD JUNCTION BOX



City of Lawrence
MUNICIPAL SERVICES & OPERATIONS

DAVID P. CRONIN
CITY ENGINEER

CRAIG S. OWENS
CITY MANAGER

